

SPECIFICATIONS AND BID ITEMS

FOR THE

Reconstruction of East County Road 120 (Phase II)
FROM SH 158 TO FM 1379

COUNTY JUDGE

Terry Johnson

COUNTY COMMISSIONERS

Scott Ramsey – Precinct 1

Robin Donnelly – Precinct 2

Luis D. Sanchez – Precinct 3

Randy Prude – Precinct 4

PREPARED BY



Dunaway No. B005663.001

October 2022

TABLE OF CONTENTS

PART A – Standard Specifications

PART B – Special Specifications

PART C – Guide Schedule of Sampling and Testing – June 2019**

PART D –Geotechnical Report of Existing Conditions

PART E – Bid Quantities

**Laboratory and Field Testing to be provided by the County and is not considered a part of this bid.

PART A

STANDARD SPECIFICATIONS

Item 100

Preparing Right of Way



1. DESCRIPTION

Prepare the right of way and designated easements for construction operations by removing and disposing of all obstructions when removal of such obstructions is not specifically shown on the plans to be paid by other Items.

2. CONSTRUCTION

Protect designated features on the right of way and prune trees and shrubs as directed. Do not park equipment, service equipment, store materials, or disturb the root area under the branches of trees designated for preservation. Treat cuts on trees with an approved tree wound dressing within 20 min. of making a pruning cut or otherwise causing damage to the tree when shown on the plans. Follow all local and state regulations when burning. Pile and burn brush at approved locations as directed. Coordinate work with state and federal authorities when working in state or national forests or parks. Test, remove, and dispose of hazardous materials in accordance with Article 6.10., "Hazardous Materials."

Clear areas shown on the plans of all obstructions, except those landscape features that are to be preserved. Such obstructions include remains of houses and other structures, foundations, floor slabs, concrete, brick, lumber, plaster, septic tank drain fields, basements, abandoned utility pipes or conduits, equipment, fences, retaining walls, and other items as specified on the plans. Remove vegetation and other landscape features not designated for preservation, curb and gutter, driveways, paved parking areas, miscellaneous stone, sidewalks, drainage structures, manholes, inlets, abandoned railroad tracks, scrap iron, and debris, whether above or below ground. Removal of live utility facilities is not included in this Item. Remove culverts, storm sewers, manholes, and inlets in proper sequence to maintain traffic and drainage.

Notify the Engineer in writing when items not shown on the plans and not reasonably detectable (buried with no obvious indication of presence) are encountered and required to be removed. These items will be handled in accordance with Article 4.5., "Differing Site Conditions."

Remove obstructions not designated for preservation to 2 ft. below natural ground in areas receiving embankment. Remove obstructions to 2 ft. below the excavation level in areas to be excavated. Remove obstructions to 1 ft. below natural ground in all other areas. Cut trees and stumps off to ground level when allowed by the plans or directed. Plug the remaining ends of abandoned underground structures over 3 in. in diameter with concrete to form a tight closure. Backfill, compact, and restore areas where obstructions have been removed unless otherwise directed. Use approved material for backfilling. Dispose of wells in accordance with Item 103, "Disposal of Wells."

Accept ownership, unless otherwise directed, and dispose of removed materials and debris at locations off the right of way in accordance with local, state, and federal requirements.

3. MEASUREMENT

This Item will be measured by the acre; by the 100-ft. station, regardless of the width of the right of way; or by each tree removed.

4. PAYMENT

For "acre" and "station" measurement, the work performed in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Preparing Right of Way." For "each"

measurement, the work performed in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Preparing Right of Way (Tree)" of the diameter specified. This price is full compensation for pruning of designated trees and shrubs; removal and disposal of structures and obstructions; backfilling of holes; furnishing and placing concrete for plugs; and equipment, labor, tools, and incidentals.

Total payment of this Item will not exceed 10% of the original contract amount until final acceptance. The remainder will be paid on the estimate after the final acceptance under Article 5.12., "Final Acceptance."

Item 216

Proof Rolling



1. DESCRIPTION

Proof-roll earthwork, base, or both to locate unstable areas.

2. EQUIPMENT

- 2.1. **Specified Equipment.** Furnish rollers that weigh at least 25 tons when loaded. The maximum acceptable load is 50 tons. Provide rollers that meet the requirements of Section 210.2.4., "Pneumatic Tire Rollers."
- 2.2. **Alternative Equipment.** The Contractor may use alternate compaction equipment that produces results equivalent to the specified equipment in the same period of time as approved. Discontinue the use of the alternative equipment and furnish the specified equipment if the desired results are not achieved.

3. CONSTRUCTION

Perform proof rolling as directed. Adjust the load and tire inflation pressures within the range of the manufacturer's charts or tabulations, as directed. Make at least 2 coverages with the proof roller. Offset each trip of the roller by at most one tire width. Operate rollers at a speed between 2 and 6 mph, as directed. Correct unstable or nonuniform areas, if found, in accordance with the applicable Item.

4. MEASUREMENT

Rolling will be measured by the hour operated on surfaces being tested.

5. PAYMENT

The work performed and equipment furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Proof Rolling." This price is full compensation for furnishing and operating equipment and for labor, materials, tools, and incidentals.

Item 247

Flexible Base



1. DESCRIPTION

Construct a foundation course composed of flexible base.

2. MATERIALS

Furnish uncontaminated materials of uniform quality that meet the requirements of the plans and specifications. Notify the Engineer of the proposed material sources and of changes to material sources. The Engineer may sample and test project materials at any time before compaction throughout the duration of the project to assure specification compliance. Use [Tex-100-E](#) material definitions.

- 2.1. **Aggregate.** Furnish aggregate of the type and grade shown on the plans and meeting the requirements of Table 1. Each source must meet Table 1 requirements for liquid limit, plasticity index, and wet ball mill for the grade specified. Do not use additives, such as but not limited to lime, cement, or fly ash to modify aggregates to meet the requirements of Table 1 unless shown on the plans.

Table 1
Material Requirements

Property	Test Method	Grade 1-2	Grade 3	Grade 4 ²	Grade 5
Sampling	Tex-400-A				
Master gradation sieve size (cumulative % retained)	Tex-110-E			As shown on the plans	
2-1/2"		0	0		0
1-3/4"		0-10	0-10		0-5
7/8"		10-35	-		10-35
3/8"		30-65	-		35-65
#4		45-75	45-75		45-75
#40	65-90	50-85	70-90		
Liquid Limit, % Max	Tex-104-E	40	40	As shown on the plans	35
Plasticity Index, Max ¹	Tex-106-E	10	12	As shown on the plans	10
Plasticity index, Min ¹		As shown on the plans			
Wet ball mill, % Max	Tex-116-E	40	-	As shown on the plans	40
Wet ball mill, % Max increase passing the #40 sieve		20	-	As shown on the plans	20
Min compressive strength, psi	Tex-117-E			As shown on the plans	
lateral pressure 0 psi		35	-		-
lateral pressure 3 psi		-	-		90
lateral pressure 15 psi		175	-		175

- Determine plastic index in accordance with [Tex-107-E](#) (linear shrinkage) when liquid limit is unattainable as defined in [Tex-104-E](#).
- Grade 4 may be further designated as Grade 4A, Grade 4B, etc.

- 2.1.1. **Material Tolerances.** The Engineer may accept material if no more than 1 of the 5 most recent gradation tests has an individual sieve outside the specified limits of the gradation.

When target grading is required by the plans, no single failing test may exceed the master grading by more than 5 percentage points on sieves No. 4 and larger or 3 percentage points on sieves smaller than No. 4.

The Engineer may accept material if no more than 1 of the 5 most recent plasticity index tests is outside the specified limit. No single failing test may exceed the allowable limit by more than 2 points.

- 2.1.2. **Material Types.** Do not use fillers or binders unless approved. Furnish the type specified on the plans in accordance with the following:
- 2.1.2.1. **Type A.** Crushed stone produced and graded from oversize quarried aggregate that originates from a single, naturally occurring source. Do not use gravel or multiple sources.
- 2.1.2.2. **Type B.** Crushed or uncrushed gravel. Blending of 2 or more sources is allowed.
- 2.1.2.3. **Type C.** Crushed gravel with a minimum of 60% of the particles retained on a No. 4 sieve with 2 or more crushed faces as determined by [Tex-460-A](#), Part I. Blending of 2 or more sources is allowed.
- 2.1.2.4. **Type D.** Type A material or crushed concrete. Crushed concrete containing gravel will be considered Type D material. Crushed concrete must meet the requirements in Section 247.2.1.3.2., "Recycled Material (Including Crushed Concrete) Requirements," and be managed in a way to provide for uniform quality. The Engineer may require separate dedicated stockpiles in order to verify compliance.
- 2.1.2.5. **Type E.** Caliche, iron ore or as otherwise shown on the plans.
- 2.1.3. **Recycled Material.** Reclaimed asphalt pavement (RAP) and other recycled materials may be used when shown on the plans. Request approval to blend 2 or more sources of recycled materials.
- 2.1.3.1. **Limits on Percentage.** Do not exceed 20% RAP by weight, when RAP is allowed, unless otherwise shown on the plans. The percentage limitations for other recycled materials will be as shown on the plans.
- 2.1.3.2. **Recycled Material (Including Crushed Concrete) Requirements.**
- 2.1.3.2.1. **Contractor-Furnished Recycled Materials.** Provide recycled materials, other than RAP, that have a maximum sulfate content of 3,000 ppm when tested in accordance with [Tex-145-E](#). When the Contractor furnishes the recycled materials, including crushed concrete, the final product will be subject to the requirements of Table 1 for the grade specified. Certify compliance with [DMS-11000](#), "Evaluating and Using Nonhazardous Recyclable Materials Guidelines," for Contractor furnished recycled materials. In addition, recycled materials must be free from reinforcing steel and other objectionable material and have at most 1.5% deleterious material when tested in accordance with [Tex-413-A](#). For RAP, do not exceed a maximum percent loss from decantation of 5.0% when tested in accordance with [Tex-406-A](#). Test RAP without removing the asphalt.
- 2.1.3.2.2. **Department-Furnished Required Recycled Materials.** When the Department furnishes and requires the use of recycled materials, unless otherwise shown on the plans:
- Department-required recycled material will not be subject to the requirements in Table 1,
 - Contractor-furnished materials are subject to the requirements in Table 1 and this Item,
 - the final product, blended, will be subject to the requirements in Table 1, and
 - for final product, unblended (100% Department-furnished required recycled material), the liquid limit, plasticity index, wet ball mill, and compressive strength is waived.
- Crush Department-furnished RAP so that 100% passes the 2 in. sieve. The Contractor is responsible for uniformly blending to meet the percentage required.
- 2.1.3.2.3. **Department-Furnished and Allowed Recycled Materials.** When the Department furnishes and allows the use of recycled materials or allows the Contractor to furnish recycled materials, the final blended product is subject to the requirements of Table 1 and the plans.

- 2.1.3.3. **Recycled Material Sources.** Department-owned recycled material is available to the Contractor only when shown on the plans. Return unused Department-owned recycled materials to the Department stockpile location designated by the Engineer unless otherwise shown on the plans.

The use of Contractor-owned recycled materials is allowed when shown on the plans. Contractor-owned surplus recycled materials remain the property of the Contractor. Remove Contractor-owned recycled materials from the project and dispose of them in accordance with federal, state, and local regulations before project acceptance. Do not intermingle Contractor-owned recycled material with Department-owned recycled material unless approved.

- 2.2. **Water.** Furnish water free of industrial wastes and other objectionable matter.
- 2.3. **Material Sources.** Expose the vertical faces of all strata of material proposed for use when non-commercial sources are used. Secure and process the material by successive vertical cuts extending through all exposed strata, when directed.

3. EQUIPMENT

Provide machinery, tools, and equipment necessary for proper execution of the work.

- 3.1. Provide rollers in accordance with Item 210, "Rolling." Provide proof rollers in accordance with Item 216, "Proof Rolling," when required.
- 3.2. When ride quality measurement is required, provide a high speed or lightweight inertial profiler certified at the Texas A&M Transportation Institute. Provide equipment certification documentation. Display a current decal on the equipment indicating the certification expiration date.

4. CONSTRUCTION

Construct each layer uniformly, free of loose or segregated areas, and with the required density and moisture content. Provide a smooth surface that conforms to the typical sections, lines, and grades shown on the plans or as directed.

Stockpile base material temporarily at an approved location before delivery to the roadway. Build stockpiles in layers no greater than 2 ft. thick. Stockpiles must have a total height between 10 and 16 ft. unless otherwise approved. After construction and acceptance of the stockpile, loading from the stockpile for delivery is allowed. Load by making successive vertical cuts through the entire depth of the stockpile.

Do not add or remove material from temporary stockpiles that require sampling and testing before delivery unless otherwise approved. Charges for additional sampling and testing required as a result of adding or removing material will be deducted from the Contractor's estimates.

Haul approved flexible base in clean trucks. Deliver the required quantity to each 100-ft. station or designated stockpile site as shown on the plans. Prepare stockpile sites as directed. When delivery is to the 100-ft. station, manipulate in accordance with the applicable Items.

- 4.1. **Preparation of Subgrade or Existing Base.** Remove or scarify existing asphalt concrete pavement in accordance with Item 105, "Removing Treated and Untreated Base and Asphalt Pavement," when shown on the plans or as directed. Shape the subgrade or existing base to conform to the typical sections shown on the plans or as directed.

When new base is required to be mixed with existing base, deliver, place, and spread the new flexible base in the required amount per station. Manipulate and thoroughly mix the new base with existing material to provide a uniform mixture to the specified depth before shaping.

Proof roll the roadbed in accordance with Item 216, "Proof Rolling," before pulverizing or scarifying when shown on the plans or directed. Correct soft spots as directed.

- 4.2. **Placing.** Spread and shape flexible base into a uniform layer with an approved spreader the same day as delivered unless otherwise approved. Construct layers to the thickness shown on the plans. Maintain the shape of the course. Control dust by sprinkling, as directed. Correct or replace segregated areas as directed, at no additional expense to the Department.

Place successive base courses and finish courses using the same construction methods required for the first course.

- 4.3. **Compaction.** Compact using density control unless otherwise shown on the plans. Multiple lifts are permitted when shown on the plans or approved. Bring each layer to the moisture content directed. When necessary, sprinkle the material in accordance with Item 204, "Sprinkling."

Begin rolling longitudinally at the sides and proceed towards the center, overlapping on successive trips by at least 1/2 the width of the roller unit. Begin rolling at the low side and progress toward the high side on superelevated curves. Offset alternate trips of the roller. Operate rollers at a speed between 2 and 6 mph as directed.

Rework, recompact, and refinish material that fails to meet or that loses required moisture, density, stability, or finish requirements before the next course is placed or the project is accepted. Continue work until specification requirements are met. Perform the work at no additional expense to the Department.

Before final acceptance, the Engineer will select the locations of tests and measure the flexible base depth in accordance with [Tex-140-E](#). Correct areas deficient by more than 1/2 in. in thickness by scarifying, adding material as required, reshaping, recompacting, and refinishing at the Contractor's expense.

- 4.3.1. **Ordinary Compaction.** Roll with approved compaction equipment as directed. Correct irregularities, depressions, and weak spots immediately by scarifying the areas affected, adding or removing approved material as required, reshaping, and recompacting.

- 4.3.2. **Density Control.** Compact to at least 100% of the maximum dry density determined by [Tex-113-E](#), unless otherwise shown on the plans. Maintain moisture during compaction within ± 2 percentage points of the optimum moisture content as determined by [Tex-113-E](#). Measure the moisture content of the material in accordance with [Tex-115-E](#) or [Tex-103-E](#) during compaction daily and report the results the same day to the Engineer, unless otherwise shown on the plans or directed. Do not achieve density by drying the material after compaction.

The Engineer will determine roadway density and moisture content of completed sections in accordance with [Tex-115-E](#). The Engineer may accept the section if no more than 1 of the 5 most recent density tests is below the specified density and the failing test is no more than 3 pcf below the specified density.

- 4.4. **Finishing.** After completing compaction, clip, skin, or tight-blade the surface with a maintainer or subgrade trimmer to a depth of approximately 1/4 in. Remove loosened material and dispose of it at an approved location. Seal the clipped surface immediately by rolling with a pneumatic tire roller until a smooth surface is attained. Add small increments of water as needed during rolling. Shape and maintain the course and surface in conformity with the typical sections, lines, and grades as shown on the plans or as directed.

Correct grade deviations greater than 1/4 in. in 16 feet measured longitudinally or greater than 1/4 in. over the entire width of the cross-section in areas where surfacing is to be placed. Correct by loosening and adding, or removing material. Reshape and re-compact in accordance with Section 247.4.3., "Compaction."

- 4.5. **Curing.** Cure the finished section until the moisture content is at least 2 percentage points below optimum or as directed before applying the next successive course or prime coat.

- 4.6. **Ride Quality.** This section applies to the final travel lanes that receive a 1 or 2 course surface treatment for the final surface, unless otherwise shown on the plans. Measure ride quality of the base course after placement of the prime coat and before placement of the surface treatment, unless otherwise approved. Use a certified profiler operator from the Department's MPL. When requested, furnish the Engineer documentation for the person certified to operate the profiler.

Provide all profile measurements to the Engineer in electronic data files within 3 days after placement of the prime coat using the format specified in [Tex-1001-S](#). The Engineer will use Department software to evaluate longitudinal profiles to determine areas requiring corrective action. Correct 0.1-mi.sections having an average international roughness index (IRI) value greater than 100.0 in. per mile to an IRI value of 100.0 in. per mile or less for each wheel path, unless otherwise shown on the plans.

Re-profile and correct sections that fail to maintain ride quality until placement of the next course, as directed. Correct re-profiled sections until specification requirements are met, as approved. Perform this work at no additional expense to the Department.

5. MEASUREMENT

Flexible base will be measured as follows:

- **Flexible Base (Complete In Place).** The ton, square yard, or any cubic yard method.
- **Flexible Base (Roadway Delivery).** The ton or any cubic yard method.
- **Flexible Base (Stockpile Delivery).** The ton, cubic yard in vehicle, or cubic yard in stockpile.

Measurement by the cubic yard in final position and square yard is a plans quantity measurement. The quantity to be paid for is the quantity shown in the proposal unless modified by Article 9.2., "Plans Quantity Measurement." Additional measurements or calculations will be made if adjustments of quantities are required.

Measurement is further defined for payment as follows.

- 5.1. **Cubic Yard in Vehicle.** By the cubic yard in vehicles of uniform capacity at the point of delivery.
- 5.2. **Cubic Yard in Stockpile.** By the cubic yard in the final stockpile position by the method of average end areas.
- 5.3. **Cubic Yard in Final Position.** By the cubic yard in the completed and accepted final position. The volume of base course is computed in place by the method of average end areas between the original subgrade or existing base surfaces and the lines, grades, and slopes of the accepted base course as shown on the plans.
- 5.4. **Square Yard.** By the square yard of surface area in the completed and accepted final position. The surface area of the base course is based on the width of flexible base as shown on the plans.
- 5.5. **Ton.** By the ton of dry weight in vehicles as delivered. The dry weight is determined by deducting the weight of the moisture in the material at the time of weighing from the gross weight of the material. The Engineer will determine the moisture content in the material in accordance with [Tex-103-E](#) from samples taken at the time of weighing.

When material is measured in trucks, the weight of the material will be determined on certified scales, or the Contractor must provide a set of standard platform truck scales at a location approved by the Engineer. Scales must conform to the requirements of Item 520, "Weighing and Measuring Equipment."

6. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for the types of work shown below. No additional payment

will be made for thickness or width exceeding that shown on the typical section or provided on the plans for cubic yard in the final position or square yard measurement.

Sprinkling and rolling, except proof rolling, will not be paid for directly but will be subsidiary to this Item unless otherwise shown on the plans. When proof rolling is shown on the plans or directed, it will be paid for in accordance with Item 216, "Proof Rolling."

Where subgrade is constructed under this Contract, correction of soft spots in the subgrade will be at the Contractor's expense. Where subgrade is not constructed under this Contract, correction of soft spots in the subgrade will be paid in accordance with pertinent Items or Article 4.4., "Changes in the Work."

- 6.1. **Flexible Base (Complete In Place).** Payment will be made for the type and grade specified. For cubic yard measurement, "In Vehicle," "In Stockpile," or "In Final Position" will be specified. For square yard measurement, a depth will be specified. This price is full compensation for furnishing materials, temporary stockpiling, assistance provided in stockpile sampling and operations to level stockpiles for measurement, loading, hauling, delivery of materials, spreading, blading, mixing, shaping, placing, compacting, reworking, finishing, correcting locations where thickness is deficient, curing, furnishing scales and labor for weighing and measuring, and equipment, labor, tools, and incidentals.
- 6.2. **Flexible Base (Roadway Delivery).** Payment will be made for the type and grade specified. For cubic yard measurement, "In Vehicle," "In Stockpile," or "In Final Position" will be specified. The unit price bid will not include processing at the roadway. This price is full compensation for furnishing materials, temporary stockpiling, assistance provided in stockpile sampling and operations to level stockpiles for measurement, loading, hauling, delivery of materials, furnishing scales and labor for weighing and measuring, and equipment, labor, tools, and incidentals.
- 6.3. **Flexible Base (Stockpile Delivery).** Payment will be made for the type and grade specified. For cubic yard measurement, "In Vehicle" or "In Stockpile" will be specified. The unit price bid will not include processing at the roadway. This price is full compensation for furnishing and disposing of materials, preparing the stockpile area, temporary or permanent stockpiling, assistance provided in stockpile sampling and operations to level stockpiles for measurement, loading, hauling, delivery of materials to the stockpile, furnishing scales and labor for weighing and measuring, and equipment, labor, tools, and incidentals.

Item 300

Asphalts, Oils, and Emulsions



1. DESCRIPTION

Provide asphalt cements, cutback and emulsified asphalts, performance-graded asphalt binders, and other miscellaneous asphalt materials as specified on the plans.

2. MATERIALS

Provide asphalt materials that meet the stated requirements when tested in accordance with the referenced Department, AASHTO, and ASTM test methods. Use asphalt containing recycled materials only if the recycled components meet the requirements of Article 6.9, "Recycled Materials." Provide asphalt materials that have been preapproved for use by the Construction Division in accordance with [Tex-545-C](#).

Acronyms used in this Item are defined in Table 1.

Table 1
Acronyms

Acronym	Definition
Test Procedure Designations	
Tex	Department
T or R	AASHTO
D	ASTM
Polymer Modifier Designations	
P	polymer-modified
SBR or L	styrene-butadiene rubber (latex)
SBS	styrene-butadiene-styrene block co-polymer
TR	tire rubber (from ambient temperature grinding of truck and passenger tires)
AC	asphalt cement
AE	asphalt emulsion
AE-P	asphalt emulsion prime
A-R	asphalt-rubber
C	cationic
EAP&T	emulsified asphalt prime and tack
H-suffix	harder residue (lower penetration)
HF	high float
MC	medium-curing
MS	medium-setting
PCE	prime, cure, and erosion control
PG	performance grade
RC	rapid-curing
RS	rapid-setting
S-suffix	stockpile usage
SCM	special cutback material
SS	slow-setting

- 2.1. **Asphalt Cement.** Provide asphalt cement that is homogeneous, water-free, and nonfoaming when heated to 347°F, and meets the requirements in Table 2.

Table 2
Asphalt Cement

Property	Test Procedure	Viscosity Grade									
		AC-0.6		AC-1.5		AC-3		AC-5		AC-10	
		Min	Max	Min	Max	Min	Max	Min	Max	Min	Max
Viscosity 140°F, poise 275°F, poise	T 202	40 0.4	80 –	100 0.7	200 –	250 1.1	350 –	400 1.4	600 –	800 1.9	1,200 –
Penetration, 77°F, 100g, 5 sec.	T 49	350	–	250	–	210	–	135	–	85	–
Flash point, C.O.C., °F	T 48	425	–	425	–	425	–	425	–	450	–
Solubility in trichloroethylene, %	T 44	99.0	–	99.0	–	99.0	–	99.0	–	99.0	–
Spot test	Tex-509-C	Neg.		Neg.		Neg.		Neg.		Neg.	
Tests on residue from Thin-Film Oven Test: Viscosity, 140°F, poise Ductility, ¹ 77°F 5 cm/min., cm	T 179 T 202 T 51	– – 100	180 – –	– – 100	450 – –	– – 100	900 – –	– – 100	1,500 – –	– – 100	3,000 – –

1. If AC-0.6 or AC-1.5 ductility at 77°F is less than 100 cm, material is acceptable if ductility at 60°F is more than 100 cm.

- 2.2. **Polymer-Modified Asphalt Cement.** Provide polymer-modified asphalt cement that is smooth, homogeneous, and meets the requirements of Table 3. Supply samples of the base asphalt cement and polymer additives if requested.

Table 3
Polymer-Modified Asphalt Cement

Property	Test Procedure	Polymer-Modified Viscosity Grade											
		AC-5 w/2% SBR		AC-10 w/2% SBR		AC-15P		AC-20XP		AC-10-2TR		AC-20-5TR	
		Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max
Polymer		SBR		SBR		SBS		SBS		TR		TR	
Polymer content, % (solids basis)	Tex-533-C	2.0	–	2.0	–	3.0	–	–	–	2.0	–	5.0	–
Dynamic shear, G*/sin δ, 64°C, 10 rad/s, kPa	T 315	–	–	–	–	–	–	1.0	–	–	–	1.0	–
Dynamic shear, G*/sin δ, 58°C, 10 rad/s, kPa	T 315	–	–	–	–	–	–	–	–	1.0	–	–	–
Viscosity 140°F, poise 275°F, poise	T 202 T 202	700 –	– 7.0	1,300 –	– 8.0	1,500 –	– 8.0	2,000 –	– –	1,000 –	– 8.0	2,000 –	– 10.0
Penetration, 77°F, 100 g, 5 sec.	T 49	120	–	80	–	100	150	75	115	95	130	75	115
Ductility, 5cm/min., 39.2°F, cm	T 51	70	–	60	–	–	–	–	–	–	–	–	–
Elastic recovery, 50°F, %	Tex-539-C	–	–	–	–	55	–	55	–	30	–	55	–
Softening point, °F	T 53	–	–	–	–	–	–	120	–	110	–	120	–
Polymer separation, 48 hr.	Tex-540-C	None		None		None		None		None		None	
Flash point, C.O.C., °F	T 48	425	–	425	–	425	–	425	–	425	–	425	–
Tests on residue from RTFOT aging and pressure aging: Creep stiffness S, -18°C, MPa m-value, -18°C	Tex-541-C and R 28 T 313	–	–	–	–	–	300	–	300	–	300	–	300
		–	–	–	–	0.300	–	0.300	–	0.300	–	0.300	–

- 2.3. **Cutback Asphalt.** Provide cutback asphalt that meets the requirements of Tables 4, 5, and 6 for the specified type and grade. Supply samples of the base asphalt cement and polymer additives if requested.

Table 4
Rapid-Curing Cutback Asphalt

Property	Test Procedure	Type-Grade					
		RC-250		RC-800		RC-3000	
		Min	Max	Min	Max	Min	Max
Kinematic viscosity, 140°F, cSt	T 201	250	400	800	1,600	3,000	6,000
Water, %	D95	–	0.2	–	0.2	–	0.2
Flash point, T.O.C., °F	T 79	80	–	80	–	80	–
Distillation test:	T 78						
Distillate, percentage by volume of total distillate to 680°F							
to 437°F		40	75	35	70	20	55
to 500°F		65	90	55	85	45	75
to 600°F		85	–	80	–	70	–
Residue from distillation, volume %		70	–	75	–	82	–
Tests on distillation residue:							
Viscosity, 140°F, poise	T 202	600	2400	600	2400	600	2400
Ductility, 5 cm/min., 77°F, cm	T 51	100	–	100	–	100	–
Solubility in trichloroethylene, %	T 44	99.0	–	99.0	–	99.0	–
Spot test	Tex-509-C		Neg.		Neg.		Neg.

Table 5
Medium-Curing Cutback Asphalt

Property	Test Procedure	Type-Grade							
		MC-30		MC-250		MC-800		MC-3000	
		Min	Max	Min	Max	Min	Max	Min	Max
Kinematic viscosity, 140°F, cSt	T 201	30	60	250	500	800	1,600	3,000	6,000
Water, %	D95	–	0.2	–	0.2	–	0.2	–	0.2
Flash point, T.O.C., °F	T 79	95	–	122	–	140	–	149	–
Distillation test:	T 78								
Distillate, percentage by volume of total distillate to 680°F									
to 437°F		–	35	–	20	–	–	–	–
to 500°F		30	75	5	55	–	40	–	15
to 600°F		75	95	60	90	45	85	15	75
Residue from distillation, volume %		50	–	67	–	75	–	80	–
Tests on distillation residue:									
Viscosity, 140°F, poise	T 202	300	1200	300	1200	300	1200	300	1200
Ductility, 5 cm/min., 77°F, cm	T 51	100	–	100	–	100	–	100	–
Solubility in trichloroethylene, %	T 44	99.0	–	99.0	–	99.0	–	99.0	–
Spot test	Tex-509-C		Neg.		Neg.		Neg.		Neg.

Table 6
Special-Use Cutback Asphalt

Property	Test Procedure	Type-Grade					
		MC-2400L		SCM I		SCM II	
		Min	Max	Min	Max	Min	Max
Kinematic viscosity, 140°F, cSt	T 201	2,400	4,800	500	1,000	1,000	2,000
Water, %	D95	–	0.2	–	0.2	–	0.2
Flash point, T.O.C., °F	T 79	150	–	175	–	175	–
Distillation test:	T 78						
Distillate, percentage by volume of total distillate to 680°F to 437°F		–	–	–	–	–	–
to 500°F		–	35	–	0.5	–	0.5
to 600°F		35	80	20	60	15	50
Residue from distillation, volume %		78	–	76	–	82	–
Tests on distillation residue:							
Polymer		SBR					
Polymer content, % (solids basis)	Tex-533-C	2.0	–	–	–	–	–
Penetration, 100 g, 5 sec., 77°F	T 49	150	300	180	–	180	–
Ductility, 5 cm/min., 39.2°F, cm	T 51	50	–	–	–	–	–
Solubility in trichloroethylene, %	T 44	99.0	–	99.0	–	99.0	–

2.4.

Emulsified Asphalt. Provide emulsified asphalt that is homogeneous, does not separate after thorough mixing, and meets the requirements for the specified type and grade in Tables 7, 8, 9, and 10.

Table 7
Emulsified Asphalt

Property	Test Procedure	Type-Grade									
		Rapid-Setting		Medium-Setting				Slow-Setting			
		HFRS-2		MS-2		AES-300		SS-1		SS-1H	
		Min	Max	Min	Max	Min	Max	Min	Max	Min	Max
Viscosity, Saybolt Furol	T 72										
77°F, sec.		–	–	–	–	75	400	20	100	20	100
122°F, sec.		150	400	100	300	–	–	–	–	–	–
Sieve test, %	T 59	–	0.1	–	0.1	–	0.1	–	0.1	–	0.1
Miscibility	T 59	–	–	–	–	–	–	Pass		Pass	
Cement mixing, %	T 59	–	–	–	–	–	–	–	2.0	–	2.0
Coating ability and water resistance:	T 59										
Dry aggregate/after spray		–	–	–	–	Good/Fair		–	–	–	–
Wet aggregate/after spray		–	–	–	–	Fair/Fair		–	–	–	–
Demulsibility, 35 mL of 0.02 N CaCl ₂ , %	T 59	50	–	–	30	–	–	–	–	–	–
Storage stability, 1 day, %	T 59	–	1	–	1	–	1	–	1	–	1
Freezing test, 3 cycles ¹	T 59	–	–	Pass		–	–	Pass		Pass	
Distillation test:	T 59										
Residue by distillation, % by wt.		65	–	65	–	65	–	60	–	60	–
Oil distillate, % by volume of emulsion		–	0.5	–	0.5	–	5	–	0.5	–	0.5
Tests on residue from distillation:											
Penetration, 77°F, 100 g, 5 sec.	T 49	100	140	120	160	300	–	120	160	70	100
Solubility in trichloroethylene, %	T 44	97.5	–	97.5	–	97.5	–	97.5	–	97.5	–
Ductility, 77°F, 5 cm/min., cm	T 51	100	–	100	–	–	–	100	–	80	–
Float test, 140°F, sec.	T 50	1,200	–	–	–	1,200	–	–	–	–	–

1. Applies only when the Engineer designates material for winter use.

Table 8
Cationic Emulsified Asphalt

Property	Test Procedure	Type-Grade											
		Rapid-Setting				Medium-Setting				Slow-Setting			
		CRS-2		CRS-2H		CMS-2		CMS-2S		CSS-1		CSS-1H	
		Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max
Viscosity, Saybolt Furol 77°F, sec.	T 72	-	-	-	-	-	-	-	-	20	100	20	100
		150	400	150	400	100	300	100	300	-	-	-	-
Sieve test, %	T 59	-	0.1	-	0.1	-	0.1	-	0.1	-	0.1	-	0.1
Cement mixing, %	T 59	-	-	-	-	-	-	-	-	-	2.0	-	2.0
Coating ability and water resistance: Dry aggregate/after spray	T 59	-	-	-	-	Good/Fair	Good/Fair	-	-	-	-	-	-
		-	-	-	-	Fair/Fair	Fair/Fair	-	-	-	-	-	-
Wet aggregate/after spray													
Demulsibility, 35 mL of 0.8% Sodium dioctyl sulfosuccinate, %	T 59	70	-	70	-	-	-	-	-	-	-	-	-
Storage stability, 1 day, %	T 59	-	1	-	1	-	1	-	1	-	1	-	1
Particle charge	T 59	Positive		Positive		Positive		Positive		Positive		Positive	
Distillation test: Residue by distillation, % by wt.	T 59	65	-	65	-	65	-	65	-	60	-	60	-
		-	0.5	-	0.5	-	7	-	5	-	0.5	-	0.5
Oil distillate, % by volume of emulsion													
Tests on residue from distillation: Penetration, 77°F, 100 g, 5 sec.	T 49	120	160	70	110	120	200	300	-	120	160	70	110
	T 44	97.5	-	97.5	-	97.5	-	97.5	-	97.5	-	97.5	-
	T 51	100	-	80	-	100	-	-	-	100	-	80	-
Solubility in trichloroethylene, %													
Ductility, 77°F, 5 cm/min., cm													

Table 9
Polymer-Modified Emulsified Asphalt

Property	Test Procedure	Type-Grade											
		Rapid-Setting				Medium-Setting				Slow-Setting			
		RS-1P		HFRS-2P		AES-150P		AES-300P		AES-300S		SS-1P	
		Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max
Viscosity, Saybolt Furol 77°F, sec.	T 72	-	-	-	-	75	400	75	400	75	400	30	100
		50	200	150	400	-	-	-	-	-	-	-	-
122°F, sec.													
Sieve test, %	T 59	-	0.1	-	0.1	-	0.1	-	0.1	-	0.1	-	0.1
Miscibility	T 59	-	-	-	-	-	-	-	-	-	-	Pass	
Coating ability and water resistance: Dry aggregate/after spray	T 59	-	-	-	-	Good/Fair	Good/Fair	Good/Fair	Good/Fair	Good/Fair	Good/Fair	-	-
		-	-	-	-	Fair/Fair	Fair/Fair	Fair/Fair	Fair/Fair	Fair/Fair	Fair/Fair	-	-
Wet aggregate/after spray													
Demulsibility, 35 mL of 0.02 N CaCl ₂ , %	T 59	60	-	50	-	-	-	-	-	-	-	-	-
Storage stability, 1 day, %	T 59	-	1	-	1	-	1	-	1	-	1	-	1
Breaking index, g	Tex-542-C	-	80	-	-	-	-	-	-	-	-	-	-
Distillation test: ¹ Residue by distillation, % by wt.	T 59	65	-	65	-	65	-	65	-	65	-	60	-
		-	3	-	0.5	-	3	-	5	-	7	-	0.5
Oil distillate, % by volume of emulsion													
Tests on residue from distillation: Polymer content, wt. % (solids basis)	Tex-533-C	-	-	3.0	-	-	-	-	-	-	-	3.0	-
	T 49	225	300	90	140	150	300	300	-	300	-	100	140
	T 44	97.0	-	97.0	-	97.0	-	97.0	-	97.0	-	97.0	-
	T 202	-	-	1,500	-	-	-	-	-	-	-	1,300	-
	T 50	-	-	1,200	-	1,200	-	1,200	-	1,200	-	-	-
	T 51	-	-	50	-	-	-	-	-	-	-	50	-
	Tex-539-C	55	-	55	-	-	-	-	-	-	-	-	-
Penetration, 77°F, 100 g, 5 sec.													
Solubility in trichloroethylene, %													
Viscosity, 140°F, poise													
Float test, 140°F, sec.													
Ductility, ² 39.2°F, 5 cm/min., cm													
Elastic recovery, ² 50°F, %													
Tests on RTFO curing of distillation residue	Tex-541-C Tex-539-C	-	-	-	-	50	-	50	-	30	-	-	-

- Exception to T 59: Bring the temperature on the lower thermometer slowly to 350°F ±10°F. Maintain at this temperature for 20 min. Complete total distillation in 60 min. (±5 min.) from the first application of heat.
- HFRS-2P must meet one of either the ductility or elastic recovery requirements.

Table 10
Polymer-Modified Cationic Emulsified Asphalt

Property	Test Procedure	Type-Grade											
		Rapid-Setting						Medium-Setting				Slow-Setting	
		CRS-1P		CRS-2P		CHFRS-2P		CMS-1P ³		CMS-2P ³		CSS-1P	
		Min	Max	Min	Max	Min	Max	Min	Max	Min	Max	Min	Max
Viscosity, Saybolt Furol 77°F, sec. 122°F, sec.	T 72	-	-	-	-	-	-	20	100	-	-	20	100
Sieve test, %	T 59	-	0.1	-	0.1	-	0.1	-	0.1	-	0.1	-	0.1
Demulsibility, 35 mL of 0.8% Sodium dioctyl sulfosuccinate, %	T 59	60	-	70	-	60	-	-	-	-	-	-	-
Storage stability, 1 day, %	T 59	-	1	-	1	-	1	-	-	-	-	-	1
Breaking index, g	Tex-542-C	-	80	-	-	-	-	-	-	-	-	-	-
Particle charge	T 59	Positive		Positive		Positive		Positive		Positive		Positive	
Distillation test: ¹ Residue by distillation, % by weight Oil distillate, % by volume of emulsion	T 59	65	-	65	-	65	-	65	-	65	-	62	-
		-	3	-	0.5	-	0.5	-	0.5	-	0.5	-	0.5
Tests on residue from distillation: Polymer content, wt. % (solids basis)	Tex-533-C	-	-	3.0	-	3.0	-	-	-	-	-	3.0	-
Penetration, 77°F, 100 g, 5 sec.	T 49	225	300	90	150	80	130	40	-	40	-	55	90
Viscosity, 140°F, poise	T 202	-	-	1,300	-	1,300	-	-	5,000	-	5,000	-	-
Solubility in trichloroethylene, %	T 44	97.0	-	97.0	-	95.0	-	-	-	-	-	97.0	-
Softening point, °F	T 53	-	-	-	-	130	-	-	-	-	-	135	-
Ductility, 77°F, 5 cm/min., cm	T 51	-	-	-	-	-	-	-	-	-	-	70	-
Float test, 140°F, sec.	T 50	-	-	-	-	1,800	-	-	-	-	-	-	-
Ductility, ² 39.2°F, 5 cm/min., cm	T 51	-	-	50	-	-	-	-	-	-	-	-	-
Elastic recovery, ² 50°F, %	Tex-539-C	45	-	55	-	55	-	45	-	45	-	-	-
Tests on rejuvenating agent: Viscosity, 140°F, cSt	T 201	-	-	-	-	-	-	50	175	50	175	-	-
Flash point, C.O.C., °F	T 48	-	-	-	-	-	-	380	-	380	-	-	-
Saturates, % by weight	D2007	-	-	-	-	-	-	-	30	-	30	-	-
Solubility in n-pentane, % by weight	D2007	-	-	-	-	-	-	99	-	99	-	-	-
Tests on rejuvenating agent after TFO or RTFO: Weight Change, %	T 240 or T 179	-	-	-	-	-	-	-	6.5	-	6.5	-	-
Viscosity Ratio		-	-	-	-	-	-	-	3.0	-	3.0	-	-
Tests on latex: ⁴ Tensile strength, die C dumbbell, psi	D412 ⁵	-	-	-	-	-	-	500	-	500	-	-	-
Change in mass after immersion in rejuvenating agent, %	D471	-	-	-	-	-	-	-	40 ⁶	-	40 ⁶	-	-

- Exception to T 59: Bring the temperature on the lower thermometer slowly to 350°F (±0°F). Maintain at this temperature for 20 min. Complete total distillation in 60 min. (±5 min.) from the first application of heat.
- CRS-2P must meet one of either the ductility or elastic recovery requirements.
- With all precertification samples of CMS-1P or CMS-2P, submit certified test reports showing that the rejuvenating agent and latex meet the stated requirements. Submit samples of these raw materials if requested by the Engineer.
- Preparation of latex films: Use any substrate which produces a film of uniform cross-section. Apply latex using a drawdown tool that will deliver enough material to achieve desired residual thickness. Cure films for 14 days at 75°F and 50% relative humidity.
- Cut samples for tensile strength determination using a crosshead speed of 20 in./min.
- Specimen must remain intact after exposure and removal of excess rejuvenating agent.

- 2.5. **Specialty Emulsions.** Provide specialty emulsion that is either asphalt-based or resin-based and meets the requirements of Table 11.

Table 11
Specialty Emulsions

Property	Test Procedure	Type-Grade					
		Medium-Setting				Slow-Setting	
		AE-P		EAP&T		PCE ¹	
		Min	Max	Min	Max	Min	Max
Viscosity, Saybolt Furol 77°F, sec. 122°F, sec.	T 72	– 15	– 150	– –	– –	10 –	100 –
Sieve test, %	T 59	–	0.1	–	0.1	–	0.1
Miscibility ²	T 59	–	–	Pass	–	Pass	–
Demulsibility, 35 mL of 0.10 N CaCl ₂ , %	T 59	–	70	–	–	–	–
Storage stability, 1 day, %	T 59	–	1	–	1	–	–
Particle size, ⁵ % by volume < 2.5 μm	Tex-238-F³	–	–	90	–	90	–
Asphalt emulsion distillation to 500°F followed by Cutback asphalt distillation of residue to 680°F: Residue after both distillations, % by wt. Total oil distillate from both distillations, % by volume of emulsion	T 59 & T 78	40 25	– 40	– –	– –	– –	– –
Residue by distillation, % by wt.	T 59	–	–	60	–	–	–
Residue by evaporation, ⁴ % by wt.	T 59	–	–	–	–	60	–
Tests on residue after all distillation(s): Viscosity, 140°F, poise Kinematic viscosity, ⁵ 140°F, cSt Flash point C.O.C., °F Solubility in trichloroethylene, % Float test, 122°F, sec.	T 202 T 201 T 48 T 44 T 50	– – – 97.5 50	– – – – 200	800 – – – –	– – – – –	– 100 400 – –	– 350 – – –

Supply with each shipment of PCE:

- a copy of a lab report from an approved analytical lab, signed by a lab official, indicating the PCE formulation does not meet any characteristics of a Resource Conservation Recovery Act (RCRA) hazardous waste;
- a certification from the producer that the formulation supplied does not differ from the one tested and that no listed RCRA hazardous wastes or Polychlorinated Biphenyls (PCBs) have been mixed with the product; and
- a Safety Data Sheet.

Exception to T 59: In dilution, use 350 mL of distilled or deionized water and a 1,000-mL beaker.

Use [Tex-238-F](#), beginning at "Particle Size Analysis by Laser Diffraction," with distilled or deionized water as a medium and no dispersant, or use another approved method.

Exception to T 59: Leave sample in the oven until foaming ceases, then cool and weigh.

PCE must meet either the kinematic viscosity requirement or the particle size requirement.

- 2.6. **Recycling Agent.** Recycling agent and emulsified recycling agent must meet the requirements in Table 12. Additionally, recycling agent and residue from emulsified recycling agent, when added in the specified proportions to the recycled asphalt, must meet the properties specified on the plans.

Table 12
Recycling Agent and Emulsified Recycling Agent

Property	Test Procedure	Recycling Agent		Emulsified Recycling Agent	
		Min	Max	Min	Max
Viscosity, Saybolt Furol, 77°F, sec.	T 72	–	–	15	100
Sieve test, %	T 59	–	–	–	0.1
Miscibility ¹	T 59	–		No coagulation	
Residue by evaporation, ² % by wt.	T 59	–	–	60	–
Tests on recycling agent or residue from evaporation:					
Flash point, C.O.C., °F	T 48	400	–	400	–
Kinematic viscosity, 140°F, cSt	T 201	75	200	75	200
275°F, cSt		–	10.0	–	10.0

1. Exception to T 59: Use 0.02 N CaCl₂ solution in place of water.
2. Exception to T 59: Maintain sample at 300°F until foaming ceases, then cool and weigh.

2.7. **Crumb Rubber Modifier.** Crumb rubber modifier (CRM) consists of automobile and truck tires processed by ambient temperature grinding.

CRM must be:

- free from contaminants including fabric, metal, and mineral and other nonrubber substances;
- free-flowing; and
- nonfoaming when added to hot asphalt binder.

Ensure rubber gradation meets the requirements of the grades in Table 13 when tested in accordance with [Tex-200-F](#), Part I, using a 50-g sample.

Table 13
CRM Gradations

Sieve Size (% Passing)	Grade A		Grade B		Grade C		Grade D	Grade E
	Min	Max	Min	Max	Min	Max		
#8	100	–	–	–	–	–	As shown on the plans	As approved
#10	95	100	100	–	–	–		
#16	–	–	70	100	100	–		
#30	–	–	25	60	90	100		
#40	–	–	–	–	45	100		
#50	0	10	–	–	–	–		
#200	–	–	0	5	–	–		

2.8. **Crack Sealer.** Provide polymer-modified asphalt-emulsion crack sealer meeting the requirements of Table 14. Provide rubber-asphalt crack sealer meeting the requirements of Table 15.

Table 14
Polymer-Modified Asphalt-Emulsion Crack Sealer

Property	Test Procedure	Min	Max
Rotational viscosity, 77°F, cP	D 2196, Method A	10,000	25,000
Sieve test, %	T 59	–	0.1
Storage stability, 1 day, %	T 59	–	1
Evaporation Residue by evaporation, % by wt.	Tex-543-C	65	–
Tests on residue from evaporation:			
Penetration, 77°F, 100 g, 5 sec.	T 49	35	75
Softening point, °F	T 53	140	–
Ductility, 39.2°F, 5 cm/min., cm	T 51	100	–

Table 15
Rubber-Asphalt Crack Sealer

Property	Test Procedure	Class A		Class B	
		Min	Max	Min	Max
CRM content, Grade A or B, % by wt.	Tex-544-C	22	26	–	–
CRM content, Grade B, % by wt.	Tex-544-C	–	–	13	17
Virgin rubber content, ¹ % by wt.		–	–	2	–
Flash point, ² C.O.C., °F	T 48	400	–	400	–
Penetration, ³ 77°F, 150 g, 5 sec.	T 49	30	50	30	50
Penetration, ³ 32°F, 200 g, 60 sec.	T 49	12	–	12	–
Softening point, °F	T 53	–	–	170	–
Bond Test, non-immersed, 0.5 in specimen, 50% extension, 20°F ⁴	D5329	–		Pass	

1. Provide certification that the Min % virgin rubber was added.
2. Agitate the sealing compound with a 3/8- to 1/2-in. (9.5- to 12.7-mm) wide, square-end metal spatula to bring the material on the bottom of the cup to the surface (i.e., turn the material over) before passing the test flame over the cup. Start at one side of the thermometer, move around to the other, and then return to the starting point using 8 to 10 rapid circular strokes. Accomplish agitation in 3 to 4 sec. Pass the test flame over the cup immediately after stirring is completed.
3. Exception to T 49: Substitute the cone specified in D 217 for the penetration needle.
4. Allow no crack in the crack sealing materials or break in the bond between the sealer and the mortar blocks over 1/4 in. deep for any specimen after completion of the test.

2.9.

Asphalt-Rubber Binders. Provide asphalt-rubber (A-R) binders that are mixtures of asphalt binder and CRM, which have been reacted at elevated temperatures. Provide A-R binders meeting D6114 and containing a minimum of 15% CRM by weight. Provide Types I or II, containing CRM Grade C, for use in hot-mixed aggregate mixtures. Provide Types II or III, containing CRM Grade B, for use in surface treatment binder. Ensure binder properties meet the requirements of Table 16.

Table 16
A-R Binders

Property	Test Procedure	Binder Type					
		Type I		Type II		Type III	
		Min	Max	Min	Max	Min	Max
Apparent viscosity, 347°F, cP	D2196, Method A	1,500	5,000	1,500	5,000	1,500	5,000
Penetration, 77°F, 100 g, 5 sec.	T 49	25	75	25	75	50	100
Penetration, 39.2°F, 200 g, 60 sec.	T 49	10	–	15	–	25	–
Softening point, °F	T 53	135	–	130	–	125	–
Resilience, 77°F, %	D5329	25	–	20	–	10	–
Flash point, C.O.C., °F	T 48	450	–	450	–	450	–
Tests on residue from Thin-Film Oven Test:	T 179						
Retained penetration ratio, 39.2°F, 200 g, 60 sec., % of original	T 49	75	–	75	–	75	–

2.10.

Performance-Graded Binders. Provide PG binders that are smooth and homogeneous, show no separation when tested in accordance with [Tex-540-C](#), and meet the requirements of Table 17.

Separation testing is not required if:

- a modifier is introduced separately at the mix plant either by injection in the asphalt line or mixer,
- the binder is blended on site in continuously agitated tanks, or
- binder acceptance is based on field samples taken from an in-line sampling port at the hot-mix plant after the addition of modifiers.

Table 17
Performance-Graded Binders

Property and Test Method	Performance Grade																	
	PG 58			PG 64			PG 70			PG 76			PG 82					
	-22	-28	-34	-16	-22	-28	-34	-16	-22	-28	-34	-16	-22	-28	-34	-16	-22	-28
Average 7-day max pavement design temperature, °C ¹	< 58			< 64			< 70			< 76			< 82					
Min pavement design temperature, °C ¹	>-22	>-28	>-34	>-16	>-22	>-28	>-34	>-16	>-22	>-28	>-34	>-16	>-22	>-28	>-34	>-16	>-22	>-28
Original Binder																		
Flash point, T 48, Min, °C	230																	
Viscosity, T 316: ^{2,3} Max, 3.0 Pa·s, test temperature, °C	135																	
Dynamic shear, T 315: ⁴ G*/sin(δ), Min, 1.00 kPa, Max, 2.00 kPa, ⁷ Test temperature @ 10 rad/sec., °C	58			64			70			76			82					
Elastic recovery, D 6084, 50°F, % Min	-	-	30	-	-	30	50	-	30	50	60	30	50	60	70	50	60	70
Rolling Thin-Film Oven (Tex-541-C)																		
Mass loss, Tex-541-C, Max, %	1.0																	
Dynamic shear, T 315: G*/sin(δ), Min, 2.20 kPa, Max, 5.00 kPa, ⁷ Test temperature @ 10 rad/sec., °C	58			64			70			76			82					
Pressure Aging Vessel (PAV) Residue (R 28)																		
PAV aging temperature, °C	100																	
Dynamic shear, T 315: G*·sin(δ), Max, 5,000 kPa Test temperature @ 10 rad/sec., °C	25	22	19	28	25	22	19	28	25	22	19	28	25	22	19	28	25	22
Creep stiffness, T 313: ^{5,6} S, max, 300 MPa, m-value, Min, 0.300 Test temperature @ 60 sec., °C	-12	-18	-24	-6	-12	-18	-24	-6	-12	-18	-24	-6	-12	-18	-24	-6	-12	-18
Direct tension, T 314: ⁶ Failure strain, Min, 1.0% Test temperature @ 1.0 mm/min., °C	-12	-18	-24	-6	-12	-18	-24	-6	-12	-18	-24	-6	-12	-18	-24	-6	-12	-18

- Pavement temperatures are estimated from air temperatures using an algorithm contained in a Department-supplied computer program, may be provided by the Department, or by following the procedures outlined in AASHTO MP 2 and PP 28.
- This requirement may be waived at the Department's discretion if the supplier warrants that the asphalt binder can be adequately pumped, mixed, and compacted at temperatures that meet all applicable safety, environmental, and constructability requirements. At test temperatures where the binder is a Newtonian fluid, any suitable standard means of viscosity measurement may be used, including capillary (T 201 or T 202) or rotational viscometry (T 316).
- Viscosity at 135°C is an indicator of mixing and compaction temperatures that can be expected in the lab and field. High values may indicate high mixing and compaction temperatures. Additionally, significant variation can occur from batch to batch. Contractors should be aware that variation could significantly impact their mixing and compaction operations. Contractors are therefore responsible for addressing any constructability issues that may arise.
- For quality control of unmodified asphalt binder production, measurement of the viscosity of the original asphalt binder may be substituted for dynamic shear measurements of G*/sin(δ) at test temperatures where the asphalt is a Newtonian fluid. Any suitable standard means of viscosity measurement may be used, including capillary (T 201 or T 202) or rotational viscometry (T 316).
- Silicone beam molds, as described in AASHTO TP 1-93, are acceptable for use.
- If creep stiffness is below 300 MPa, direct tension test is not required. If creep stiffness is between 300 and 600 MPa, the direct tension failure strain requirement can be used instead of the creep stiffness requirement. The m-value requirement must be satisfied in both cases.
- Maximum values for unaged and RTFO aged dynamic shear apply only to materials used as substitute binders, as described in specification Items 340, "Dense-Graded Hot-Mix Asphalt (Small Quantity)," 341, "Dense-Graded Hot-Mix Asphalt," and 344, "Superpave Mixtures."

3. EQUIPMENT

Provide all equipment necessary to transport, store, sample, heat, apply, and incorporate asphalts, oils, and emulsions.

4. CONSTRUCTION

Typical Material Use. Use materials shown in Table 18, unless otherwise determined by the Engineer.

Table 18
Typical Material Use

Material Application	Typically Used Materials
Hot-mixed, hot-laid asphalt mixtures	PG binders, A-R binders Types I and II
Surface treatment	AC-5, AC-10, AC-5 w/2% SBR, AC-10 w/2% SBR, AC-15P, AC-20XP, AC-10-2TR, AC-20-5TR, HFRS-2, MS-2, CRS-2, CRS-2H, HFRS-2P, CRS-2P, CHFRS-2P, A-R binders Types II and III
Surface treatment (cool weather)	RS-1P, CRS-1P, RC-250, RC-800, RC-3000, MC-250, MC-800, MC-3000, MC-2400L
Precoating	AC-5, AC-10, PG 64-22, SS-1, SS-1H, CSS-1, CSS-1H
Tack coat	PG Binders, SS-1H, CSS-1H, EAP&T
Fog seal	SS-1, SS-1H, CSS-1, CSS-1H
Hot-mixed, cold-laid asphalt mixtures	AC-0.6, AC-1.5, AC-3, AES-300, AES-300P, CMS-2, CMS-2S
Patching mix	MC-800, SCM I, SCM II, AES-300S
Recycling	AC-0.6, AC-1.5, AC-3, AES-150P, AES-300P, recycling agent, emulsified recycling agent
Crack sealing	SS-1P, polymer mod AE crack sealant, rubber asphalt crack sealers (Class A, Class B)
Microsurfacing	CSS-1P
Prime	MC-30, AE-P, EAP&T, PCE
Curing membrane	SS-1, SS-1H, CSS-1, CSS-1H, PCE
Erosion control	SS-1, SS-1H, CSS-1, CSS-1H, PCE

4.1.

Storage and Application Temperatures. Use storage and application temperatures in accordance with Table 19. Store and apply materials at the lowest temperature yielding satisfactory results. Follow the manufacturer's instructions for any agitation requirements in storage. Manufacturer's instructions regarding recommended application and storage temperatures supersede those of Table 19.

Table 19
Storage and Application Temperatures

Type-Grade	Application		Storage Maximum (°F)
	Recommended Range (°F)	Maximum Allowable (°F)	
AC-0.6, AC-1.5, AC-3	200–300	350	350
AC-5, AC-10	275–350	350	350
AC-5 w/2% SBR, AC-10 w/2% SBR, AC-15P, AC-20-5TR	300–375	375	360
RC-250	125–180	200	200
RC-800	170–230	260	260
RC-3000	215–275	285	285
MC-30, AE-P	70–150	175	175
MC-250	125–210	240	240
MC-800, SCM I, SCM II	175–260	275	275
MC-3000, MC-2400L	225–275	290	290
HFRS-2, MS-2, CRS-2, CRS-2H, HFRS-2P, CRS-2P, CMS-2, CMS-2S, AES-300, AES-300S, AES-150P, AES-300P	120–160	180	180
SS-1, SS-1H, CSS-1, CSS-1H, PCE, EAP&T, SS-1P, RS-1P, CRS-1P, CSS-1P, recycling agent, emulsified recycling agent, polymer mod AE crack sealant	50–130	140	140
PG binders	275–350	350	350
Rubber asphalt crack sealers (Class A, Class B)	350–375	400	–
A-R binders Types I, II, and III	325–425	425	425

5. MEASUREMENT AND PAYMENT

The work performed, materials furnished, equipment, labor, tools, and incidentals will not be measured or paid for directly but is subsidiary or is included in payment for other pertinent items.

Item 310

Prime Coat



1. DESCRIPTION

Prepare and treat existing or newly constructed surface with an asphalt binder or other specialty prime coat binder material. Apply blotter material as required.

2. MATERIALS

- 2.1. **Binder.** Use material of the type and grade shown on the plans in accordance with Item 300, "Asphalts, Oils, and Emulsions," or as listed in the Department's MPL for prime coat binders.
- 2.2. **Blotter.** Use either base course sweepings obtained from cleaning the base or native sand as blotter materials unless otherwise shown on the plans or approved.

3. EQUIPMENT

Provide applicable equipment in accordance with Article 316.3., "Equipment."

4. CONSTRUCTION

- 4.1. **General.** Apply the mixture when the air temperature is at or above 60°F, or above 50°F and rising. Measure the air temperature in the shade away from artificial heat. The Engineer will determine when weather conditions are suitable for application.
- Do not permit traffic, hauling, or placement of subsequent courses over freshly constructed prime coats. Maintain the primed surface until placement of subsequent courses or acceptance of the work.
- 4.2. **Surface Preparation.** Prepare the surface by sweeping or other approved methods. Lightly sprinkle the surface with water before applying bituminous material, when directed, to control dust and ensure absorption.
- 4.3. **Application.**
- 4.3.1. **Binder.** The Engineer will select the application temperature within the limits recommended in Item 300, "Asphalts, Oils, and Emulsions," or by the material manufacturer. Apply material within 15°F of the selected temperature but do not exceed the maximum allowable temperature.
- Distribute the material smoothly and evenly at the rate selected by the Engineer. Roll the freshly applied prime coat with a pneumatic-tire roller to ensure penetration when directed.
- 4.3.2. **Blotter.** Spread blotter material before allowing traffic to use a primed surface. Apply blotter material to primed surface at the specified rate when "Prime Coat and Blotter" is shown on the plans as a bid item or as directed. Apply blotter to spot locations when "Prime Coat" is shown on the plans as a bid item or as directed to accommodate traffic movement through the work area. Remove blotter material before placing the surface. Dispose of blotter material according to applicable state and federal requirements.

5. MEASUREMENT

This Item will be measured by the gallon of binder placed and accepted.

6. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Prime Coat" or "Prime Coat and Blotter" of the type and grade of binder specified. This price is full compensation for cleaning and sprinkling the area to be primed; materials, including blotter material; and rolling, equipment, labor, tools, and incidentals.

Item 340

Dense-Graded Hot-Mix Asphalt (Small Quantity)



1. DESCRIPTION

Construct a hot-mix asphalt (HMA) pavement layer composed of a compacted, dense-graded mixture of aggregate and asphalt binder mixed hot in a mixing plant. This specification is intended for small quantity (SQ) HMA projects, typically under 5,000 tons total production.

2. MATERIALS

Furnish uncontaminated materials of uniform quality that meet the requirements of the plans and specifications.

Notify the Engineer of all material sources and before changing any material source or formulation. The Engineer will verify that the specification requirements are met when the Contractor makes a source or formulation change, and may require a new laboratory mixture design, trial batch, or both. The Engineer may sample and test project materials at any time during the project to verify specification compliance in accordance with Item 6, "Control of Materials."

- 2.1. **Aggregate.** Furnish aggregates from sources that conform to the requirements shown in Table 1 and as specified in this Section. Aggregate requirements in this Section, including those shown in Table 1, may be modified or eliminated when shown on the plans. Additional aggregate requirements may be specified when shown on the plans. Provide aggregate stockpiles that meet the definitions in this Section for coarse, intermediate, or fine aggregate. Aggregate from reclaimed asphalt pavement (RAP) is not required to meet Table 1 requirements unless otherwise shown on the plans. Supply aggregates that meet the definitions in [Tex-100-E](#) for crushed gravel or crushed stone. The Engineer will designate the plant or the quarry as the sampling location. Provide samples from materials produced for the project. The Engineer will establish the Surface Aggregate Classification (SAC) and perform Los Angeles abrasion, magnesium sulfate soundness, and Micro-Deval tests. Perform all other aggregate quality tests listed in Table 1. Document all test results on the mixture design report. The Engineer may perform tests on independent or split samples to verify Contractor test results. Stockpile aggregates for each source and type separately. Determine aggregate gradations for mixture design and production testing based on the washed sieve analysis given in [Tex-200-F](#), Part II.

- 2.1.1. **Coarse Aggregate.** Coarse aggregate stockpiles must have no more than 20% material passing the No. 8 sieve. Aggregates from sources listed in the Department's *Bituminous Rated Source Quality Catalog* (BRSQC) are preapproved for use. Use only the rated values for hot-mix listed in the BRSQC. Rated values for surface treatment (ST) do not apply to coarse aggregate sources used in hot-mix asphalt.

For sources not listed on the Department's BRSQC:

- build an individual stockpile for each material;
- request the Department test the stockpile for specification compliance; and
- once approved, do not add material to the stockpile unless otherwise approved.

Provide aggregate from non-listed sources only when tested by the Engineer and approved before use. Allow 30 calendar days for the Engineer to sample, test, and report results for non-listed sources.

Provide coarse aggregate with at least the minimum SAC shown on the plans. SAC requirements only apply to aggregates used on the surface of travel lanes. SAC requirements apply to aggregates used on surfaces other than travel lanes when shown on the plans. The SAC for sources on the Department's *Aggregate Quality Monitoring Program* (AQMP) ([Tex-499-A](#)) is listed in the BRSQC.

- 2.1.1.1. **Blending Class A and Class B Aggregates.** Class B aggregate meeting all other requirements in Table 1 may be blended with a Class A aggregate to meet requirements for Class A materials. Ensure that at least 50% by weight, or volume if required, of the material retained on the No. 4 sieve comes from the Class A aggregate source when blending Class A and B aggregates to meet a Class A requirement. Blend by volume if the bulk specific gravities of the Class A and B aggregates differ by more than 0.300. Coarse aggregate from RAP and Recycled Asphalt Shingles (RAS) will be considered as Class B aggregate for blending purposes.

The Engineer may perform tests at any time during production, when the Contractor blends Class A and B aggregates to meet a Class A requirement, to ensure that at least 50% by weight, or volume if required, of the material retained on the No. 4 sieve comes from the Class A aggregate source. The Engineer will use the Department's mix design template, when electing to verify conformance, to calculate the percent of Class A aggregate retained on the No. 4 sieve by inputting the bin percentages shown from readouts in the control room at the time of production and stockpile gradations measured at the time of production. The Engineer may determine the gradations based on either washed or dry sieve analysis from samples obtained from individual aggregate cold feed bins or aggregate stockpiles. The Engineer may perform spot checks using the gradations supplied by the Contractor on the mixture design report as an input for the template; however, a failing spot check will require confirmation with a stockpile gradation determined by the Engineer.

- 2.1.2. **Intermediate Aggregate.** Aggregates not meeting the definition of coarse or fine aggregate will be defined as intermediate aggregate. Supply intermediate aggregates, when used that are free from organic impurities.

The Engineer may test the intermediate aggregate in accordance with [Tex-408-A](#) to verify the material is free from organic impurities. Supply intermediate aggregate from coarse aggregate sources, when used that meet the requirements shown in Table 1 unless otherwise approved.

Test the stockpile if 10% or more of the stockpile is retained on the No. 4 sieve, and verify that it meets the requirements in Table 1 for crushed face count ([Tex-460-A](#)) and flat and elongated particles ([Tex-280-F](#)).

- 2.1.3. **Fine Aggregate.** Fine aggregates consist of manufactured sands, screenings, and field sands. Fine aggregate stockpiles must meet the gradation requirements in Table 2. Supply fine aggregates that are free from organic impurities. The Engineer may test the fine aggregate in accordance with [Tex-408-A](#) to verify the material is free from organic impurities. No more than 15% of the total aggregate may be field sand or other uncrushed fine aggregate. Use fine aggregate, with the exception of field sand, from coarse aggregate sources that meet the requirements shown in Table 1 unless otherwise approved.

Test the stockpile if 10% or more of the stockpile is retained on the No. 4 sieve, and verify that it meets the requirements in Table 1 for crushed face count ([Tex-460-A](#)) and flat and elongated particles ([Tex-280-F](#)).

Table 1
Aggregate Quality Requirements

Property	Test Method	Requirement
Coarse Aggregate		
SAC	Tex-499-A (AQMP)	As shown on the plans
Deleterious material, %, Max	Tex-217-F, Part I	1.5
Decantation, %, Max	Tex-217-F, Part II	1.5
Micro-Deval abrasion, %	Tex-461-A	Note 1
Los Angeles abrasion, %, Max	Tex-410-A	40
Magnesium sulfate soundness, 5 cycles, %, Max	Tex-411-A	30
Crushed face count, ² %, Min	Tex-460-A, Part I	85
Flat and elongated particles @ 5:1, %, Max	Tex-280-F	10
Fine Aggregate		
Linear shrinkage, %, Max	Tex-107-E	3
Combined Aggregate³		
Sand equivalent, %, Min	Tex-203-F	45

1. Not used for acceptance purposes. Optional test used by the Engineer as an indicator of the need for further investigation.
2. Only applies to crushed gravel.
3. Aggregates, without mineral filler, RAP, RAS, or additives, combined as used in the job-mix formula (JMF).

Table 2
Gradation Requirements for Fine Aggregate

Sieve Size	% Passing by Weight or Volume
3/8"	100
#8	70–100
#200	0–30

- 2.2. **Mineral Filler.** Mineral filler consists of finely divided mineral matter such as agricultural lime, crusher fines, hydrated lime, or fly ash. Mineral filler is allowed unless otherwise shown on the plans. Use no more than 2% hydrated lime or fly ash unless otherwise shown on the plans. Use no more than 1% hydrated lime if a substitute binder is used unless otherwise shown on the plans or allowed. Test all mineral fillers except hydrated lime and fly ash in accordance with [Tex-107-E](#) to ensure specification compliance. The plans may require or disallow specific mineral fillers. Provide mineral filler, when used, that:
- is sufficiently dry, free-flowing, and free from clumps and foreign matter as determined by the Engineer;
 - does not exceed 3% linear shrinkage when tested in accordance with [Tex-107-E](#); and
 - meets the gradation requirements in Table 3.

Table 3
Gradation Requirements for Mineral Filler

Sieve Size	% Passing by Weight or Volume
#8	100
#200	55–100

- 2.3. **Baghouse Fines.** Fines collected by the baghouse or other dust-collecting equipment may be reintroduced into the mixing drum.
- 2.4. **Asphalt Binder.** Furnish the type and grade of performance-graded (PG) asphalt specified on the plans.
- 2.5. **Tack Coat.** Furnish CSS-1H, SS-1H, or a PG binder with a minimum high-temperature grade of PG 58 for tack coat binder in accordance with Item 300, "Asphalts, Oils, and Emulsions." Specialized or preferred tack coat materials may be allowed or required when shown on the plans. Do not dilute emulsified asphalts at the terminal, in the field, or at any other location before use.

The Engineer will obtain at least one sample of the tack coat binder per project in accordance with [Tex-500-C](#), Part III, and test it to verify compliance with Item 300, "Asphalts, Oils, and Emulsions." The Engineer will obtain the sample from the asphalt distributor immediately before use.

- 2.6. **Additives.** Use the type and rate of additive specified when shown on the plans. Additives that facilitate mixing, compaction, or improve the quality of the mixture are allowed when approved. Provide the Engineer with documentation, such as the bill of lading, showing the quantity of additives used in the project unless otherwise directed.
- 2.6.1. **Lime and Liquid Antistripping Agent.** When lime or a liquid antistripping agent is used, add in accordance with Item 301, "Asphalt Antistripping Agents." Do not add lime directly into the mixing drum of any plant where lime is removed through the exhaust stream unless the plant has a baghouse or dust collection system that reintroduces the lime into the drum.
- 2.6.2. **Warm Mix Asphalt (WMA).** Warm Mix Asphalt (WMA) is defined as HMA that is produced within a target temperature discharge range of 215°F and 275°F using approved WMA additives or processes from the Department's MPL.

WMA is allowed for use on all projects and is required when shown on the plans. When WMA is required, the maximum placement or target discharge temperature for WMA will be set at a value below 275°F.

Department-approved WMA additives or processes may be used to facilitate mixing and compaction of HMA produced at target discharge temperatures above 275°F; however, such mixtures will not be defined as WMA.

- 2.7. **Recycled Materials.** Use of RAP and RAS is permitted unless otherwise shown on the plans. Do not exceed the maximum allowable percentages of RAP and RAS shown in Table 4. The allowable percentages shown in Table 4 may be decreased or increased when shown on the plans. Determine asphalt binder content and gradation of the RAP and RAS stockpiles for mixture design purposes in accordance with [Tex-236-F](#). The Engineer may verify the asphalt binder content of the stockpiles at any time during production. Perform other tests on RAP and RAS when shown on the plans. Asphalt binder from RAP and RAS is designated as recycled asphalt binder. Calculate and ensure that the ratio of the recycled asphalt binder to total binder does not exceed the percentages shown in Table 5 during mixture design and HMA production when RAP or RAS is used. Use a separate cold feed bin for each stockpile of RAP and RAS during HMA production.

Surface, intermediate, and base mixes referenced in Tables 4 and 5 are defined as follows:

- **Surface.** The final HMA lift placed at or near the top of the pavement structure;
- **Intermediate.** Mixtures placed below an HMA surface mix and less than or equal to 8.0 in. from the riding surface; and
- **Base.** Mixtures placed greater than 8.0 in. from the riding surface.

- 2.7.1. **RAP.** RAP is salvaged, milled, pulverized, broken, or crushed asphalt pavement. Crush or break RAP so that 100% of the particles pass the 2 in. sieve. Fractionated RAP is defined as 2 or more RAP stockpiles, divided into coarse and fine fractions.

Use of Contractor-owned RAP, including HMA plant waste, is permitted unless otherwise shown on the plans. Department-owned RAP stockpiles are available for the Contractor's use when the stockpile locations are shown on the plans. If Department-owned RAP is available for the Contractor's use, the Contractor may use Contractor-owned fractionated RAP and replace it with an equal quantity of Department-owned RAP. This allowance does not apply to a Contractor using unfractionated RAP. Department-owned RAP generated through required work on the Contract is available for the Contractor's use when shown on the plans. Perform any necessary tests to ensure Contractor- or Department-owned RAP is appropriate for use. The Department will not perform any tests or assume any liability for the quality of the Department-owned RAP unless otherwise shown on the plans. The Contractor will retain ownership of RAP generated on the project when shown on the plans.

The coarse RAP stockpile will contain only material retained by processing over a 3/8-in. or 1/2-in. screen unless otherwise approved. The fine RAP stockpile will contain only material passing the 3/8-in. or 1/2-in. screen unless otherwise approved. The Engineer may allow the Contractor to use an alternate to the 3/8-in.

or 1/2-in. screen to fractionate the RAP. The maximum percentages of fractionated RAP may be comprised of coarse or fine fractionated RAP or the combination of both coarse and fine fractionated RAP.

Do not use Department- or Contractor-owned RAP contaminated with dirt or other objectionable materials. Do not use Department- or Contractor-owned RAP if the decantation value exceeds 5% and the plasticity index is greater than 8. Test the stockpiled RAP for decantation in accordance with [Tex-406-A](#), Part I. Determine the plasticity index in accordance with [Tex-106-E](#) if the decantation value exceeds 5%. The decantation and plasticity index requirements do not apply to RAP samples with asphalt removed by extraction or ignition.

Do not intermingle Contractor-owned RAP stockpiles with Department-owned RAP stockpiles. Remove unused Contractor-owned RAP material from the project site upon completion of the project. Return unused Department-owned RAP to the designated stockpile location.

Table 4
Maximum Allowable Amounts of RAP¹

Maximum Allowable Fractionated RAP ² (%)			Maximum Allowable Unfractionated RAP ³ (%)		
Surface	Intermediate	Base	Surface	Intermediate	Base
20.0	30.0	40.0	10.0	10.0	10.0

1. Must also meet the recycled binder to total binder ratio shown in Table 5.
2. Up to 5% RAS may be used separately or as a replacement for fractionated RAP.
3. Unfractionated RAP may not be combined with fractionated RAP or RAS.

2.7.2.

RAS. Use of post-manufactured RAS or post-consumer RAS (tear-offs) is permitted unless otherwise shown on the plans. Up to 5% RAS may be used separately or as a replacement for fractionated RAP in accordance with Table 4 and Table 5. RAS is defined as processed asphalt shingle material from manufacturing of asphalt roofing shingles or from re-roofing residential structures. Post-manufactured RAS is processed manufacturer's shingle scrap by-product. Post-consumer RAS is processed shingle scrap removed from residential structures. Comply with all regulatory requirements stipulated for RAS by the TCEQ. RAS may be used separately or in conjunction with RAP.

Process the RAS by ambient grinding or granulating such that 100% of the particles pass the 3/8 in. sieve when tested in accordance with [Tex-200-F](#), Part I. Perform a sieve analysis on processed RAS material before extraction (or ignition) of the asphalt binder.

Add sand meeting the requirements of Table 1 and Table 2 or fine RAP to RAS stockpiles if needed to keep the processed material workable. Any stockpile that contains RAS will be considered a RAS stockpile and be limited to no more than 5.0% of the HMA mixture in accordance with Table 4.

Certify compliance of the RAS with [DMS-11000](#), "Evaluating and Using Nonhazardous Recyclable Materials Guidelines." Treat RAS as an established nonhazardous recyclable material if it has not come into contact with any hazardous materials. Use RAS from shingle sources on the Department's MPL. Remove substantially all materials before use that are not part of the shingle, such as wood, paper, metal, plastic, and felt paper. Determine the deleterious content of RAS material for mixture design purposes in accordance with [Tex-217-F](#), Part III. Do not use RAS if deleterious materials are more than 0.5% of the stockpiled RAS unless otherwise approved. Submit a sample for approval before submitting the mixture design. The Department will perform the testing for deleterious material of RAS to determine specification compliance.

2.8.

Substitute Binders. Unless otherwise shown on the plans, the Contractor may use a substitute PG binder listed in Table 5 instead of the PG binder originally specified, if the substitute PG binder and mixture made with the substitute PG binder meet the following:

- the substitute binder meets the specification requirements for the substitute binder grade in accordance with Section 300.2.10., "Performance-Graded Binders;" and
- the mixture has less than 10.0 mm of rutting on the Hamburg Wheel test ([Tex-242-F](#)) after the number of passes required for the originally specified binder. Use of substitute PG binders may only be allowed at the discretion of the Engineer if the Hamburg Wheel test results are between 10.0 mm and 12.5 mm.

Table 5
Allowable Substitute PG Binders and Maximum Recycled Binder Ratios

Originally Specified PG Binder	Allowable Substitute PG Binder	Maximum Ratio of Recycled Binder ¹ to Total Binder (%)		
		Surface	Intermediate	Base
HMA				
76-22 ²	70-22 or 64-22	20.0	20.0	20.0
	70-28 or 64-28	30.0	35.0	40.0
70-22 ²	64-22	20.0	20.0	20.0
	64-28 or 58-28	30.0	35.0	40.0
64-22 ²	58-28	30.0	35.0	40.0
76-28 ²	70-28 or 64-28	20.0	20.0	20.0
	64-34	30.0	35.0	40.0
70-28 ²	64-28 or 58-28	20.0	20.0	20.0
	64-34 or 58-34	30.0	35.0	40.0
64-28 ²	58-28	20.0	20.0	20.0
	58-34	30.0	35.0	40.0
WMA³				
76-22 ²	70-22 or 64-22	30.0	35.0	40.0
70-22 ²	64-22 or 58-28	30.0	35.0	40.0
64-22 ⁴	58-28	30.0	35.0	40.0
76-28 ²	70-28 or 64-28	30.0	35.0	40.0
70-28 ²	64-28 or 58-28	30.0	35.0	40.0
64-28 ⁴	58-28	30.0	35.0	40.0

1. Combined recycled binder from RAP and RAS.
2. Use no more than 20.0% recycled binder when using this originally specified PG binder.
3. WMA as defined in Section 340.2.6.2., "Warm Mix Asphalt (WMA)."
4. When used with WMA, this originally specified PG binder is allowed for use at the maximum recycled binder ratios shown in this table.

3. EQUIPMENT

Provide required or necessary equipment in accordance with Item 320, "Equipment for Asphalt Concrete Pavement."

4. CONSTRUCTION

Produce, haul, place, and compact the specified paving mixture. In addition to tests required by the specification, Contractors may perform other QC tests as deemed necessary. At any time during the project, the Engineer may perform production and placement tests as deemed necessary in accordance with Item 5, "Control of the Work." Schedule and participate in a pre-paving meeting with the Engineer on or before the first day of paving unless otherwise directed.

- 4.1. **Certification.** Personnel certified by the Department-approved hot-mix asphalt certification program must conduct all mixture designs, sampling, and testing in accordance with Table 6. Supply the Engineer with a list of certified personnel and copies of their current certificates before beginning production and when personnel changes are made. Provide a mixture design developed and signed by a Level 2 certified specialist.

Table 6
Test Methods, Test Responsibility, and Minimum Certification Levels

Test Description	Test Method	Contractor	Engineer	Level ¹
1. Aggregate and Recycled Material Testing				
Sampling	Tex-221-F	✓	✓	1A
Dry sieve	Tex-200-F, Part I	✓	✓	1A
Washed sieve	Tex-200-F, Part II	✓	✓	1A
Deleterious material	Tex-217-F, Parts I & III	✓	✓	1A
Decantation	Tex-217-F, Part II	✓	✓	1A
Los Angeles abrasion	Tex-410-A		✓	TxDOT
Magnesium sulfate soundness	Tex-411-A		✓	TxDOT
Micro-Deval abrasion	Tex-461-A		✓	2
Crushed face count	Tex-460-A	✓	✓	2
Flat and elongated particles	Tex-280-F	✓	✓	2
Linear shrinkage	Tex-107-E	✓	✓	2
Sand equivalent	Tex-203-F	✓	✓	2
Organic impurities	Tex-408-A	✓	✓	2
2. Asphalt Binder & Tack Coat Sampling				
Asphalt binder sampling	Tex-500-C, Part II	✓	✓	1A/1B
Tack coat sampling	Tex-500-C, Part III	✓	✓	1A/1B
3. Mix Design & Verification				
Design and JMF changes	Tex-204-F	✓	✓	2
Mixing	Tex-205-F	✓	✓	2
Molding (TGC)	Tex-206-F	✓	✓	1A
Molding (SGC)	Tex-241-F	✓	✓	1A
Laboratory-molded density	Tex-207-F	✓	✓	1A
VMA ² (calculation only)	Tex-204-F	✓	✓	2
Rice gravity	Tex-227-F	✓	✓	1A
Ignition oven correction factors ³	Tex-236-F	✓	✓	2
Indirect tensile strength	Tex-226-F	✓	✓	2
Hamburg Wheel test	Tex-242-F	✓	✓	2
Boil test	Tex-530-C	✓	✓	1A
4. Production Testing				
Mixture sampling	Tex-222-F	✓	✓	1A
Molding (TGC)	Tex-206-F		✓	1A
Molding (SGC)	Tex-241-F		✓	1A
Laboratory-molded density	Tex-207-F		✓	1A
VMA ² (calculation only)	Tex-204-F		✓	1A
Rice gravity	Tex-227-F		✓	1A
Gradation & asphalt binder content ³	Tex-236-F		✓	1A
Moisture content	Tex-212-F		✓	1A
Hamburg Wheel test	Tex-242-F		✓	2
Boil test	Tex-530-C		✓	1A
5. Placement Testing				
Trimming roadway cores	Tex-207-F	✓	✓	1A/1B
In-place air voids	Tex-207-F		✓	1A/1B
Establish rolling pattern	Tex-207-F	✓		1B
Ride quality measurement	Tex-1001-S	✓	✓	Note 4

1. Level 1A, 1B, and 2 are certification levels provided by the Hot Mix Asphalt Center certification program.
2. Voids in mineral aggregates.
3. Refer to Section 340.4.8.3., "Production Testing," for exceptions to using an ignition oven.
4. Profiler and operator are required to be certified at the Texas A&M Transportation Institute facility when Surface Test Type B is specified.

4.2.

Reporting, Testing, and Responsibilities. Use Department-provided templates to record and calculate all test data pertaining to the mixture design. The Engineer will use Department templates for any production and placement testing. Obtain the current version of the templates at <http://www.txdot.gov/inside-txdot/forms-publications/consultants-contractors/forms/site-manager.html> or from the Engineer.

The maximum allowable time for the Engineer to exchange test data with the Contractor is as given in Table 7 unless otherwise approved. The Engineer will immediately report to the Contractor any test result that requires suspension of production or placement or that fails to meet the specification requirements.

Subsequent mix placed after test results are available to the Contractor, which require suspension of operations, may be considered unauthorized work. Unauthorized work will be accepted or rejected at the discretion of the Engineer in accordance with Article 5.3., "Conformity with Plans, Specifications, and Special Provisions."

Table 7
Reporting Schedule

Description	Reported By	Reported To	To Be Reported Within
Production Testing			
Gradation	Engineer	Contractor	1 working day of completion of the test
Asphalt binder content			
Laboratory-molded density			
VMA (calculation)			
Hamburg Wheel test			
Moisture content			
Boil test			
Binder tests			
Placement Testing			
In-place air voids	Engineer	Contractor	1 working day of completion of the test ¹

1. 2 days are allowed if cores cannot be dried to constant weight within 1 day.

4.3. Mixture Design.

4.3.1. **Design Requirements.** The Contractor may design the mixture using a Texas Gyrotory Compactor (TGC) or a Superpave Gyrotory Compactor (SGC) unless otherwise shown on the plans. Use the dense-graded design procedure provided in [Tex-204-F](#). Design the mixture to meet the requirements listed in Tables 1, 2, 3, 4, 5, 8, 9, and 10.

4.3.1.1. **Target Laboratory-Molded Density When The TGC Is Used.** Design the mixture at a 96.5% target laboratory-molded density. Increase the target laboratory-molded density to 97.0% or 97.5% at the Contractor's discretion or when shown on the plans or specification.

4.3.1.2. **Design Number of Gyration (Ndesign) When The SGC Is Used.** Design the mixture at 50 gyrations (Ndesign). Use a target laboratory-molded density of 96.0% to design the mixture; however, adjustments can be made to the Ndesign value as noted in Table 9. The Ndesign level may be reduced to no less than 35 gyrations at the Contractor's discretion.

Use an approved laboratory from the Department's MPL to perform the Hamburg Wheel test in accordance with [Tex-242-F](#), and provide results with the mixture design, or provide the laboratory mixture and request that the Department perform the Hamburg Wheel test. The Engineer will be allowed 10 working days to provide the Contractor with Hamburg Wheel test results on the laboratory mixture design.

The Engineer will provide the mixture design when shown on the plans. The Contractor may submit a new mixture design at any time during the project. The Engineer will verify and approve all mixture designs (JMF1) before the Contractor can begin production.

Provide the Engineer with a mixture design report using the Department-provided template. Include the following items in the report:

- the combined aggregate gradation, source, specific gravity, and percent of each material used;
- asphalt binder content and aggregate gradation of RAP and RAS stockpiles;
- the target laboratory-molded density (or Ndesign level when using the SGC);
- results of all applicable tests;

- the mixing and molding temperatures;
- the signature of the Level 2 person or persons that performed the design;
- the date the mixture design was performed; and
- a unique identification number for the mixture design.

Table 8
Master Gradation Limits (% Passing by Weight or Volume) and VMA Requirements

Sieve Size	A Coarse Base	B Fine Base	C Coarse Surface	D Fine Surface	F Fine Mixture
2"	100.0 ¹	–	–	–	–
1-1/2"	98.0–100.0	100.0 ¹	–	–	–
1"	78.0–94.0	98.0–100.0	100.0 ¹	–	–
3/4"	64.0–85.0	84.0–98.0	95.0–100.0	100.0 ¹	–
1/2"	50.0–70.0	–	–	98.0–100.0	100.0 ¹
3/8"	–	60.0–80.0	70.0–85.0	85.0–100.0	98.0–100.0
#4	30.0–50.0	40.0–60.0	43.0–63.0	50.0–70.0	70.0–90.0
#8	22.0–36.0	29.0–43.0	32.0–44.0	35.0–46.0	38.0–48.0
#30	8.0–23.0	13.0–28.0	14.0–28.0	15.0–29.0	12.0–27.0
#50	3.0–19.0	6.0–20.0	7.0–21.0	7.0–20.0	6.0–19.0
#200	2.0–7.0	2.0–7.0	2.0–7.0	2.0–7.0	2.0–7.0
Design VMA, % Minimum					
–	12.0	13.0	14.0	15.0	16.0
Production (Plant-Produced) VMA, % Minimum					
–	11.5	12.5	13.5	14.5	15.5

1. Defined as maximum sieve size. No tolerance allowed.

Table 9
Laboratory Mixture Design Properties

Mixture Property	Test Method	Requirement
Target laboratory-molded density, % (TGC)	Tex-207-F	96.5 ¹
Design gyrations (N _{design} for SGC)	Tex-241-F	50 ²
Indirect tensile strength (dry), psi	Tex-226-F	85–200 ³
Boil test ⁴	Tex-530-C	–

1. Increase to 97.0% or 97.5% at the Contractor's discretion or when shown on the plans or specification.
2. Adjust within a range of 35–100 gyrations when shown on the plans or specification or when mutually agreed between the Engineer and Contractor.
3. The Engineer may allow the IDT strength to exceed 200 psi if the corresponding Hamburg Wheel rut depth is greater than 3.0 mm and less than 12.5 mm.
4. Used to establish baseline for comparison to production results. May be waived when approved.

Table 10
Hamburg Wheel Test Requirements

High-Temperature Binder Grade	Test Method	Minimum # of Passes @ 12.5 mm ¹ Rut Depth, Tested @ 50°C
PG 64 or lower	Tex-242-F	10,000 ²
PG 70		15,000 ³
PG 76 or higher		20,000

1. When the rut depth at the required minimum number of passes is less than 3 mm, the Engineer may require the Contractor to increase the target laboratory-molded density (TGC) by 0.5% to no more than 97.5% or lower the N_{design} level (SGC) to no less than 35 gyrations.
2. May be decreased to no less than 5,000 passes when shown on the plans.
3. May be decreased to no less than 10,000 passes when shown on the plans.

4.3.2.

Job-Mix Formula Approval. The job-mix formula (JMF) is the combined aggregate gradation, target laboratory-molded density (or N_{design} level), and target asphalt percentage used to establish target values for hot-mix production. JMF1 is the original laboratory mixture design used to produce the trial batch. When

WMA is used, JMF1 may be designed and submitted to the Engineer without including the WMA additive. When WMA is used, document the additive or process used and recommended rate on the JMF1 submittal. Furnish a mix design report (JMF1) with representative samples of all component materials and request approval to produce the trial batch. Provide approximately 10,000 g of the design mixture and request that the Department perform the Hamburg Wheel test if opting to have the Department perform the test. The Engineer will verify JMF1 based on plant-produced mixture from the trial batch unless otherwise determined. The Engineer may accept an existing mixture design previously used on a Department project and may waive the trial batch to verify JMF1. Provide split samples of the mixtures and blank samples used to determine the ignition oven correction factors. The Engineer will determine the aggregate and asphalt correction factors from the ignition oven used for production testing in accordance with [Tex-236-F](#).

The Engineer will use a TGC calibrated in accordance with [Tex-914-K](#) in molding production samples. Provide an SGC at the Engineer's field laboratory for use in molding production samples if the SGC is used to design the mix.

The Engineer may perform [Tex-530-C](#) and retain the tested sample for comparison purposes during production. The Engineer may waive the requirement for the boil test.

4.3.3. **JMF Adjustments.** If JMF adjustments are necessary to achieve the specified requirements, the adjusted JMF must:

- be provided to the Engineer in writing before the start of a new lot;
- be numbered in sequence to the previous JMF;
- meet the mixture requirements in Table 4 and Table 5;
- meet the master gradation limits shown in Table 8; and
- be within the operational tolerances of the current JMF listed in Table 11.

The Engineer may adjust the asphalt binder content to maintain desirable laboratory density near the optimum value while achieving other mix requirements.

Table 11
Operational Tolerances

Description	Test Method	Allowable Difference Between Trial Batch and JMF1 Target	Allowable Difference from Current JMF Target
Individual % retained for #8 sieve and larger	Tex-200-F	Must be within master grading limits in Table 8	$\pm 5.0^{1,2}$
Individual % retained for sieves smaller than #8 and larger than #200	or Tex-236-F		$\pm 3.0^{1,2}$
% passing the #200 sieve			$\pm 2.0^{1,2}$
Asphalt binder content, %	Tex-236-F	± 0.5	$\pm 0.3^2$
Laboratory-molded density, %	Tex-207-F	± 1.0	± 1.0
VMA, %, min	Tex-204-F	Note 3	Note 3

1. When within these tolerances, mixture production gradations may fall outside the master grading limits; however, the % passing the #200 will be considered out of tolerance when outside the master grading limits.
2. Only applies to mixture produced for Lot 1 and higher.
3. Mixture is required to meet Table 8 requirements.

4.4. **Production Operations.** Perform a new trial batch when the plant or plant location is changed. Take corrective action and receive approval to proceed after any production suspension for noncompliance to the specification. Submit a new mix design and perform a new trial batch when the asphalt binder content of:

- any RAP stockpile used in the mix is more than 0.5% higher than the value shown on the mixture design report; or
- RAS stockpile used in the mix is more than 2.0% higher than the value shown on the mixture design report.

4.4.1. **Storage and Heating of Materials.** Do not heat the asphalt binder above the temperatures specified in Item 300, "Asphalts, Oils, and Emulsions," or outside the manufacturer's recommended values. Provide the Engineer with daily records of asphalt binder and hot-mix asphalt discharge temperatures (in legible and

discernible increments) in accordance with Item 320, "Equipment for Asphalt Concrete Pavement," unless otherwise directed. Do not store mixture for a period long enough to affect the quality of the mixture, nor in any case longer than 12 hr. unless otherwise approved.

- 4.4.2. **Mixing and Discharge of Materials.** Notify the Engineer of the target discharge temperature and produce the mixture within 25°F of the target. Monitor the temperature of the material in the truck before shipping to ensure that it does not exceed 350°F (or 275°F for WMA) and is not lower than 215°F. The Department will not pay for or allow placement of any mixture produced above 350°F.

Produce WMA within the target discharge temperature range of 215°F and 275°F when WMA is required. Take corrective action any time the discharge temperature of the WMA exceeds the target discharge range. The Engineer may suspend production operations if the Contractor's corrective action is not successful at controlling the production temperature within the target discharge range. Note that when WMA is produced, it may be necessary to adjust burners to ensure complete combustion such that no burner fuel residue remains in the mixture.

Control the mixing time and temperature so that substantially all moisture is removed from the mixture before discharging from the plant. The Engineer may determine the moisture content by oven-drying in accordance with [Tex-212-F](#), Part II, and verify that the mixture contains no more than 0.2% of moisture by weight. The Engineer will obtain the sample immediately after discharging the mixture into the truck, and will perform the test promptly.

- 4.5. **Hauling Operations.** Clean all truck beds before use to ensure that mixture is not contaminated. Use a release agent shown on the Department's MPL to coat the inside bed of the truck when necessary.

Use equipment for hauling as defined in Section 340.4.6.3.2., "Hauling Equipment." Use other hauling equipment only when allowed.

- 4.6. **Placement Operations.** Collect haul tickets from each load of mixture delivered to the project and provide the Department's copy to the Engineer approximately every hour, or as directed. Use a hand-held thermal camera or infrared thermometer to measure and record the internal temperature of the mixture as discharged from the truck or Material Transfer Device (MTD) before or as the mix enters the paver and an approximate station number or GPS coordinates on each ticket unless otherwise directed. Calculate the daily yield and cumulative yield for the specified lift and provide to the Engineer at the end of paving operations for each day unless otherwise directed. The Engineer may suspend production if the Contractor fails to produce and provide haul tickets and yield calculations by the end of paving operations for each day.

Prepare the surface by removing raised pavement markers and objectionable material such as moisture, dirt, sand, leaves, and other loose impediments from the surface before placing mixture. Remove vegetation from pavement edges. Place the mixture to meet the typical section requirements and produce a smooth, finished surface with a uniform appearance and texture. Offset longitudinal joints of successive courses of hot-mix by at least 6 in. Place mixture so that longitudinal joints on the surface course coincide with lane lines, or as directed. Ensure that all finished surfaces will drain properly.

Place the mixture at the rate or thickness shown on the plans. The Engineer will use the guidelines in Table 12 to determine the compacted lift thickness of each layer when multiple lifts are required. The thickness determined is based on the rate of 110 lb./sq. yd. for each inch of pavement unless otherwise shown on the plans.

Table 12
Compacted Lift Thickness and Required Core Height

Mixture Type	Compacted Lift Thickness Guidelines		Minimum Untrimmed Core Height (in.) Eligible for Testing
	Minimum (in.)	Maximum (in.)	
A	3.00	6.00	2.00
B	2.50	5.00	1.75
C	2.00	4.00	1.50
D	1.50	3.00	1.25
F	1.25	2.50	1.25

- 4.6.1. **Weather Conditions.** Place mixture when the roadway surface temperature is at or above 60°F unless otherwise approved. Measure the roadway surface temperature with a hand-held thermal camera or infrared thermometer. The Engineer may allow mixture placement to begin before the roadway surface reaches the required temperature if conditions are such that the roadway surface will reach the required temperature within 2 hr. of beginning placement operations. Place mixtures only when weather conditions and moisture conditions of the roadway surface are suitable as determined by the Engineer. The Engineer may restrict the Contractor from paving if the ambient temperature is likely to drop below 32°F within 12 hr. of paving.
- 4.6.2. **Tack Coat.** Clean the surface before placing the tack coat. The Engineer will set the rate between 0.04 and 0.10 gal. of residual asphalt per square yard of surface area. Apply a uniform tack coat at the specified rate unless otherwise directed. Apply the tack coat in a uniform manner to avoid streaks and other irregular patterns. Apply a thin, uniform tack coat to all contact surfaces of curbs, structures, and all joints. Allow adequate time for emulsion to break completely before placing any material. Prevent splattering of tack coat when placed adjacent to curb, gutter, and structures. Roll the tack coat with a pneumatic-tire roller to remove streaks and other irregular patterns when directed.
- 4.6.3. **Lay-Down Operations.**
- 4.6.3.1. **Windrow Operations.** Operate windrow pickup equipment so that when hot-mix is placed in windrows substantially all the mixture deposited on the roadbed is picked up and loaded into the paver.
- 4.6.3.2. **Hauling Equipment.** Use belly dumps, live bottom, or end dump trucks to haul and transfer mixture; however, with exception of paving miscellaneous areas, end dump trucks are only allowed when used in conjunction with an MTD with remixing capability unless otherwise allowed.
- 4.6.3.3. **Screed Heaters.** Turn off screed heaters, to prevent overheating of the mat, if the paver stops for more than 5 min.
- 4.7. **Compaction.** Compact the pavement uniformly to contain between 3.8% and 8.5% in-place air voids.
- Furnish the type, size, and number of rollers required for compaction as approved. Use a pneumatic-tire roller to seal the surface unless excessive pickup of fines occurs. Use additional rollers as required to remove any roller marks. Use only water or an approved release agent on rollers, tamps, and other compaction equipment unless otherwise directed.
- Use the control strip method shown in [Tex-207-E](#), Part IV, on the first day of production to establish the rolling pattern that will produce the desired in-place air voids unless otherwise directed.
- Use tamps to thoroughly compact the edges of the pavement along curbs, headers, and similar structures and in locations that will not allow thorough compaction with rollers. The Engineer may require rolling with a trench roller on widened areas, in trenches, and in other limited areas.
- Complete all compaction operations before the pavement temperature drops below 160°F unless otherwise allowed. The Engineer may allow compaction with a light finish roller operated in static mode for pavement temperatures below 160°F.

Allow the compacted pavement to cool to 160°F or lower before opening to traffic unless otherwise directed. Sprinkle the finished mat with water or limewater, when directed, to expedite opening the roadway to traffic.

4.8. **Production Acceptance.**

4.8.1. **Production Lot.** Each day of production is defined as a production lot. Lots will be sequentially numbered and correspond to each new day of production. Note that lots are not subdivided into sublots for this specification.

4.8.2. **Production Sampling.**

4.8.2.1. **Mixture Sampling.** The Engineer may obtain mixture samples in accordance with [Tex-222-F](#) at any time during production.

4.8.2.2. **Asphalt Binder Sampling.** The Engineer may obtain or require the Contractor to obtain 1 qt. samples of the asphalt binder at any time during production from a port located immediately upstream from the mixing drum or pug mill in accordance with [Tex-500-C](#), Part II. The Engineer may test any of the asphalt binder samples to verify compliance with Item 300, "Asphalts, Oils, and Emulsions."

4.8.3. **Production Testing.** The Engineer will test at the frequency listed in the Department's *Guide Schedule of Sampling and Testing* and this specification. The Engineer may suspend production if production tests do not meet specifications or are not within operational tolerances listed in Table 11. Take immediate corrective action if the Engineer's laboratory-molded density on any sample is less than 95.0% or greater than 98.0%, to bring the mixture within these tolerances. The Engineer may suspend operations if the Contractor's corrective actions do not produce acceptable results. The Engineer will allow production to resume when the proposed corrective action is likely to yield acceptable results.

The Engineer may use alternate methods for determining the asphalt binder content and aggregate gradation if the aggregate mineralogy is such that [Tex-236-F](#) does not yield reliable results. Use the applicable test procedure if an alternate test method is selected.

Table 13
Production and Placement Testing

Description	Test Method
Individual % retained for #8 sieve and larger	Tex-200-F
Individual % retained for sieves smaller than #8 and larger than #200	or
% passing the #200 sieve	Tex-236-F
Laboratory-molded density	Tex-207-F
Laboratory-molded bulk specific gravity	
In-Place air voids	
VMA	Tex-204-F
Moisture content	Tex-212-F , Part II
Theoretical maximum specific (Rice) gravity	Tex-227-F
Asphalt binder content	Tex-236-F
Hamburg Wheel test	Tex-242-F
Recycled Asphalt Shingles (RAS) ¹	Tex-217-F , Part III
Asphalt binder sampling and testing	Tex-500-C
Tack coat sampling and testing	Tex-500-C , Part III
Boil test	Tex-530-C

1. Testing performed by the Construction Division or designated laboratory.

4.8.3.1. **Void in Mineral Aggregates (VMA).** The Engineer may determine the VMA for any production lot. Take immediate corrective action if the VMA value for any lot is less than the minimum VMA requirement for production listed in Table 8. Suspend production and shipment of the mixture if the Engineer's VMA result is more than 0.5% below the minimum VMA requirement for production listed in Table 8. In addition to suspending production, the Engineer may require removal and replacement or may allow the lot to be left in place without payment.

- 4.8.3.2. **Hamburg Wheel Test.** The Engineer may perform a Hamburg Wheel test at any time during production, including when the boil test indicates a change in quality from the materials submitted for JMF1. In addition to testing production samples, the Engineer may obtain cores and perform Hamburg Wheel tests on any areas of the roadway where rutting is observed. Suspend production until further Hamburg Wheel tests meet the specified values when the production or core samples fail the Hamburg Wheel test criteria in Table 10. Core samples, if taken, will be obtained from the center of the finished mat or other areas excluding the vehicle wheel paths. The Engineer may require up to the entire lot of any mixture failing the Hamburg Wheel test to be removed and replaced at the Contractor's expense.

If the Department's or Department-approved laboratory's Hamburg Wheel test results in a "remove and replace" condition, the Contractor may request that the Department confirm the results by re-testing the failing material. The Construction Division will perform the Hamburg Wheel tests and determine the final disposition of the material in question based on the Department's test results.

- 4.8.4. **Individual Loads of Hot-Mix.** The Engineer can reject individual truckloads of hot-mix. When a load of hot-mix is rejected for reasons other than temperature, contamination, or excessive uncoated particles, the Contractor may request that the rejected load be tested. Make this request within 4 hr. of rejection. The Engineer will sample and test the mixture. If test results are within the operational tolerances shown in Table 11, payment will be made for the load. If test results are not within operational tolerances, no payment will be made for the load.

4.9. **Placement Acceptance.**

- 4.9.1. **Placement Lot.** A placement lot is defined as the area placed during a production lot (one day's production). Placement lot numbers will correspond with production lot numbers.

- 4.9.2. **Miscellaneous Areas.** Miscellaneous areas include areas that typically involve significant handwork or discontinuous paving operations, such as temporary detours, driveways, mailbox turnouts, crossovers, gores, spot level-up areas, and other similar areas. Miscellaneous areas also include level-ups and thin overlays when the layer thickness specified on the plans is less than the minimum untrimmed core height eligible for testing shown in Table 12. The specified layer thickness is based on the rate of 110 lb./sq. yd. for each inch of pavement unless another rate is shown on the plans. Compact miscellaneous areas in accordance with Section 340.4.7., "Compaction." Miscellaneous areas are not subject to in-place air void determination except for temporary detours when shown on the plans.

- 4.9.3. **Placement Sampling.** Provide the equipment and means to obtain and trim roadway cores on site. On site is defined as in close proximity to where the cores are taken. Obtain the cores within one working day of the time the placement lot is completed unless otherwise approved. Obtain two 6-in. diameter cores side-by-side at each location selected by the Engineer for in-place air void determination unless otherwise shown on the plans. For Type D and Type F mixtures, 4-in. diameter cores are allowed. Mark the cores for identification, measure and record the untrimmed core height, and provide the information to the Engineer. The Engineer will witness the coring operation and measurement of the core thickness.

Visually inspect each core and verify that the current paving layer is bonded to the underlying layer. Take corrective action if an adequate bond does not exist between the current and underlying layer to ensure that an adequate bond will be achieved during subsequent placement operations.

Trim the cores immediately after obtaining the cores from the roadway in accordance with [Tex-207-F](#) if the core heights meet the minimum untrimmed value listed in Table 12. Trim the cores on site in the presence of the Engineer. Use a permanent marker or paint pen to record the date and lot number on each core as well as the designation as Core A or B. The Engineer may require additional information to be marked on the core and may choose to sign or initial the core. The Engineer will take custody of the cores immediately after they are trimmed and will retain custody of the cores until the Department's testing is completed. Before turning the trimmed cores over to the Engineer, the Contractor may wrap the trimmed cores or secure them in a manner that will reduce the risk of possible damage occurring during transport by the Engineer. After testing, the Engineer will return the cores to the Contractor.

The Engineer may have the cores transported back to the Department's laboratory at the HMA plant via the Contractor's haul truck or other designated vehicle. In such cases where the cores will be out of the Engineer's possession during transport, the Engineer will use Department-provided security bags and the Roadway Core Custody protocol located at <http://www.txdot.gov/business/specifications.htm> to provide a secure means and process that protects the integrity of the cores during transport.

Instead of the Contractor trimming the cores on site immediately after coring, the Engineer and the Contractor may mutually agree to have the trimming operations performed at an alternate location such as a field laboratory or other similar location. In such cases, the Engineer will take possession of the cores immediately after they are obtained from the roadway and will retain custody of the cores until testing is completed. Either the Department or Contractor representative may perform trimming of the cores. The Engineer will witness all trimming operations in cases where the Contractor representative performs the trimming operation.

Dry the core holes and tack the sides and bottom immediately after obtaining the cores. Fill the hole with the same type of mixture and properly compact the mixture. Repair core holes with other methods when approved.

4.9.4. **Placement Testing.** The Engineer may measure in-place air voids at any time during the project to verify specification compliance.

4.9.4.1. **In-Place Air Voids.** The Engineer will measure in-place air voids in accordance with [Tex-207-F](#) and [Tex-227-F](#). Cores not meeting the height requirements in Table 12 will not be tested. Before drying to a constant weight, cores may be pre-dried using a Corelok or similar vacuum device to remove excess moisture. The Engineer will use the corresponding theoretical maximum specific gravity to determine the air void content of each core. The Engineer will use the average air void content of the 2 cores to determine the in-place air voids at the selected location.

The Engineer will use the vacuum method to seal the core if required by [Tex-207-F](#). The Engineer will use the test results from the unsealed core if the sealed core yields a higher specific gravity than the unsealed core. After determining the in-place air void content, the Engineer will return the cores and provide test results to the Contractor.

Take immediate corrective action when the in-place air voids exceed the range of 3.8% and 8.5% to bring the operation within these tolerances. The Engineer may suspend operations or require removal and replacement if the in-place air voids are less than 2.7% or greater than 9.9%. The Engineer will allow paving to resume when the proposed corrective action is likely to yield between 3.8% and 8.5% in-place air voids. Areas defined in Section 340.9.2., "Miscellaneous Areas," are not subject to in-place air void determination.

4.9.5. **Irregularities.** Identify and correct irregularities including segregation, rutting, raveling, flushing, fat spots, mat slippage, irregular color, irregular texture, roller marks, tears, gouges, streaks, uncoated aggregate particles, or broken aggregate particles. The Engineer may also identify irregularities, and in such cases, the Engineer will promptly notify the Contractor. If the Engineer determines that the irregularity will adversely affect pavement performance, the Engineer may require the Contractor to remove and replace (at the Contractor's expense) areas of the pavement that contain irregularities and areas where the mixture does not bond to the existing pavement. If irregularities are detected, the Engineer may require the Contractor to immediately suspend operations or may allow the Contractor to continue operations for no more than one day while the Contractor is taking appropriate corrective action.

4.9.6. **Ride Quality.** Use Surface Test Type A to evaluate ride quality in accordance with Item 585, "Ride Quality for Pavement Surfaces," unless otherwise shown on the plans.

5. MEASUREMENT

Hot mix will be measured by the ton of composite hot-mix, which includes asphalt, aggregate, and additives. Measure the weight on scales in accordance with Item 520, "Weighing and Measuring Equipment."

6. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under Article 340.5., "Measurement," will be paid for at the unit bid price for "Dense Graded Hot-Mix Asphalt (SQ)" of the mixture type, SAC, and binder specified. These prices are full compensation for surface preparation, materials including tack coat, placement, equipment, labor, tools, and incidentals.

Trial batches will not be paid for unless they are included in pavement work approved by the Department.

Payment adjustment for ride quality, if applicable, will be determined in accordance with Item 585, "Ride Quality for Pavement Surfaces."

PART B

SPECIAL SPECIFICATIONS

Special Specification 6176

Solar Powered LED Stop Sign



1. DESCRIPTION

Fabricate, furnish and install solar powered light emitting diode (LED), embedded stop signs consisting of embedded LED lights, and solar panels and batteries for each sign. This solar LED embedded stop sign function is to warn motorists of stop condition to flash sequentially.

2. MATERIALS

Furnish and construct materials in accordance with the following:

- Item 636, "Signs," and
- Item 644, "Small Roadside Sign Supports and Assemblies."

Provide signs that meet TMUTCD. Provide sign substrate that meets Department Material Specification DMS-7110. Provide reflective sheeting on stop sign that meets AASHTO Type D or ASTM Type XI sheeting with anti-graffiti overlay. Provide sign with embedded LED lights. Provide high powered 1 W LEDs wired in a manner that all LEDs continue to flash in the event of failure of an individual LED. Sign must output 550 candelas at daytime peak ensuring sign is daylight visible. Provide LEDs that have dimming capabilities and automatically adjust flash brightness to varying light conditions. Provide solar panels and batteries sized to allow system to work as needed 24 hr. per day based on the 20 yr. projected traffic count of the location. Unless otherwise noted, system must be provided with solar panels by the manufacturer. Unless otherwise noted, batteries must be provided by the manufacturer, and should be installed in a box mounted on a pole underneath the solar panel.

3. CONSTRUCTION

Install sign posts in accordance to Item 644, "Small Roadside Sign Assemblies."

Install each stop sign as shown on the plans and in accordance with SMD (GEN)-08 and SMD (SLIP-2)-08.

4. WARRANTY

The system as a whole will have a minimum 5 yr. warranty from the time of installation and acceptance of the system. Batteries must have a 5 yr. lifespan while operating 24 hr. per day. LED will be rated to operate at least 100,000 hr. Manufacturer will ship replacement parts at no cost as required during 5 yr. warranty period, except when installation has been damaged by outside forces.

5. MEASUREMENT

This Item will be measured by each solar powered LED stop sign.

6. PAYMENT

The work performed and materials furnished in accordance with this Item and measured as provided under "Measurement" will be paid for at the unit price bid for "Solar Powered LED Stop Sign."

This price is full compensation for furnishing and installing complete solar powered LED stop signs including sign connections and all hardware; attaching stop signs to the supports; washing and cleaning the stop signs; testing of the LED stop sign and making adjustments as needed; installing solar panels to ensure optimal recharging of batteries and solar powered batteries to the satisfaction of the Engineer; and all equipment, materials, labor, tools, and incidentals.

Installation of sign post and foundations will be paid for under Item 644, "Small Roadside Sign Assemblies."

PART C

GUIDE SCHEDULE OF SAMPLING AND TESTING

GUIDE SCHEDULE OF SAMPLING & TESTING FOR DESIGN BID-BUILD (DBB) PROJECTS - (DBB Guide Schedule)

JUNE 28, 2019



Using the Guide Schedule

Research of sampling and testing rates, listed for project tests in the following Guide Schedule, show that the Department's and the Contractor's risk of either rejecting "good" material or accepting "bad" material range from 20% to 40%.

To reduce this risk, we recommend that the sampling rate be increased during initial production. A four-fold increase in testing frequency will generally reduce risk to approximately 5%. The intent of increasing testing, at the start of production, is to insure the Contractor's processes are in control and to establish acceptability requirements early.

There is a need to increase the frequency of testing for high-variability materials and when testing results do not meet specifications. The Engineer may require the Contractor to reimburse the Department for costs resulting from failing test results, in accordance with the specifications.

Materials incorporated in TxDOT projects are subjected to various quality assurance procedures such as testing (as outlined in this document), certification, quality monitoring, approved lists, etc. The Engineer and testing staff should familiarize themselves with materials to be used before work begins by reviewing the specifications and this document. Discuss material testing requirements with the Contractor.

Other testing required by the specifications, but not shown in the DBB Guide Schedule, should be performed at a frequency necessary to provide adequate confidence that materials meet specifications.

NOTE—The TxDOT District Area Engineer or Director of Construction must submit a "Materials Certification Letter" at final acceptance of the project. The intent of this letter is to ensure that the quality of all materials incorporated into the project is in conformance with the plans and specifications, thus ensuring a service life equivalent to the design life. Any material represented by an acceptance test, that does not meet the criteria contained in the plans and specifications, is considered an exception. Exceptions must be listed in the materials certification letter. For projects with federal oversight, submit the materials certification letter (See Appendix D of DBB QAP) to the FHWA division administrator, with a copy to **the Materials and Tests Division (MTD)**. For non-federal oversight projects, submit the material certification letter (Appendix E of DBB QAP) to the TxDOT District Engineer, with a copy to **MTD**. Refer to section 4.1 of the "Quality Assurance Program for Design-Bid-Build Projects" (DBB QAP).

Assuring the quality of the product and proper incorporation of materials into the project begins with proper sampling practices. Sampling, testing, and construction inspection must be performed collaboratively to assure the specific attributes of the finished product reflect quality workmanship. Sampling guidance for hot-mix asphalt is contained in Tex-225-F, "Random Selection of Bituminous Mixture Samples," and the respective specification for that material. All remaining materials are covered by method and materials specifications, to which the following applies.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows:

- Soils/flexible base: Vary sampling between stockpiling operations, completed stockpile, windrow, and project site. Vary the time of day sampling is performed.
- Aggregates: Sample aggregates nearest the point of incorporation into the work. Vary sampling between stockpiling operations, completed stockpile, belt sampling, and if deemed necessary, railroad cars/trucks. Vary the time of day sampling is performed.
- Concrete (structural and miscellaneous): Always sample as near as practicable to the point of placement. For strength testing, vary the time of day or the number of truck from which the concrete is sampled. Tests for slump, air, and temperature should be done often to ensure the consistent control of the concrete production (not applicable to miscellaneous concrete).

This Guide Schedule is applicable to all contracts associated with the 2014 Standard Specifications.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE I – EMBANKMENTS, SUBGRADES, BACKFILL, AND BASE COURSES

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (F)	REMARKS
EMBANKMENT (CUTS & FILLS)	Liquid Limit (A)	Tex-104-E	During stockpiling operations, from completed stockpile, or project site (B)	Materials with PI ≤ 15: 10,000 CY	For Type A embankment or when required by the plans. This test may be waived for embankment cuts as directed by the Engineer . Determine a new liquid limit and plasticity index for each different material or notable change in material. Sample in accordance with Tex-100-E. When shown on plans. This test may be waived for embankment cuts, as directed by the Engineer. Sample in accordance with Tex-100-E. Not required for ordinary compaction. Determine a new optimum moisture and maximum density for each different material or notable change in material. Sample in accordance with Tex-100-E. Not required for ordinary compaction. Determine a new optimum moisture and maximum density according to Tex-114-E for each different material or notable change in material. Correct the moisture contents measured by nuclear density gauge in Tex-115-E with the moisture contents determined in accordance with Tex-103-E, as necessary for control, for each different material or notable change in material and adjust the density accordingly. Materials such as RAP, gypsum, lime, cement, and iron ore tend to bias the counts for nuclear density gauges.
	Plasticity Index (A)	Tex-106-E		Materials with PI > 15: 5,000 CY	
	Gradation	Tex-110-E		Each 10,000 CY	
	Moisture/Density	Tex-114-E		As directed by the Engineer	
	In-place Density (A)	Tex-115-E	As directed by the Engineer	Fill: each 5,000 CY min. 1 per lift.	
Cut: each 6,000 LF					
RETAINING WALL (NON-SELECT BACKFILL)	As shown above for Embankment (Cuts and Fills)		As shown above for Embankment (Cuts and Fills)	As shown above for Embankment (Cuts and Fills)	Sample in accordance with Tex-100-E.
RETAINING WALL (SELECT BACKFILL)	Plasticity Index (A)	Tex-106-E	During stockpiling operations, from completed stockpile, or project site (B)	Each 5,000 CY	Required only for Type CS backfill . Test the fraction of material finer than the No. 200 sieve. Sample in accordance with Tex-400-E.
	Gradation	Tex-110-E	During stockpiling operations, from completed stockpile, or project site (B)	Each 5,000 CY	Required only for Drainage Aggregate. Sample in accordance with Tex-400-A.
		Tex-401-A			Required only for Select Backfill. Sample in accordance with Tex-400-A.
Resistivity (A)	Tex-129-E	During stockpiling operations, from completed stockpile, or project site (B)	Each 5,000 CY	For material with resistivity between 1,500 and 3,000 ohm-cm, determine chloride and sulfate content, as specified in Item 423. Sample in accordance with Tex-400-A.	

This is a guide for minimum sampling and testing.
 Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE I – EMBANKMENTS, SUBGRADES, BACKFILL, AND BASE COURSES

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (F)	REMARKS
RETAINING WALL (SELECT BACKFILL) (continued)	pH (A)	Tex-128-E	During stockpiling operations, from completed stockpile, or project site (B)	Each 5,000 CY	Sample in accordance with Tex-400-A.
	Magnesium Soundness	Tex-411-A	During stockpiling operations, or from completed stockpile	1 per source, per project	Test when backfill sources appear to contain particles such as shale, caliche, or other soft, poor-durability particles. Sample in accordance with Tex-400-A.
	Micro-Deval	Tex-461-A	During stockpiling operations, or from completed stockpile	1 per source, per project	May be used as an alternate to the magnesium soundness only when the % loss from the micro-deval is not greater than 20%. When the % loss from the micro-deval is greater than 20%, the magnesium soundness governs aggregate verification. Sample in accordance with Tex-400-A.
	In-place Density (A)	Tex-115-E	As directed by the Engineer.	1 per backfill lift, per wall	Not required for rock backfill. For walls greater than 500 ft. in length, perform one test per lift for every 500 ft. in length. (F) Correct the moisture contents measured by nuclear density gauge in Tex-115-E with the moisture contents determined in accordance with Tex-103-E for each different material or notable change in material and adjust the density accordingly.
UNTREATED BASE COURSES	Liquid Limit (A)	Tex-104-E	During stockpiling operations, from completed stockpile, or windrow (B)	Each 5,000 CY	Sample in accordance with Tex-400-A.
	Plasticity Index (A)	Tex-106-E	During stockpiling operations, from completed stockpile, or windrow (B)	Each 5,000 CY	
	Gradation (A)	Tex-110-E	During stockpiling operations, from completed stockpile, or windrow (B)	Each 5,000 CY	Sample in accordance with Tex-400-A.
	Moisture/Density	Tex-113-E	From completed stockpile at the source (E)	Each 20,000 CY	Not required for ordinary compaction. Sample in accordance with Tex-400-A.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE I – EMBANKMENTS, SUBGRADES, BACKFILL, AND BASE COURSES

			PROJECT TESTS			
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (F)	REMARKS	
UNTREATED BASE COURSES (Continued)	Wet Ball Mill (A)	Tex-116-E	From completed stockpile at the source (E)	Each 20,000 CY	Required for Grades 1–2 and 5, and as shown on the plans for Grade 4. Sample in accordance with Tex-400-A.	
	Strength (A)	Tex-117-E	From completed stockpile at the source (E)	Each 20,000 CY	Required for Grades 1–2 and 5, and as shown on the plans for Grade 4. When base material is from a source where the District has a record of satisfactory triaxial results, the frequency of testing may be reduced to one per 30,000 CY. If any one test falls below the minimum value required, the frequency of testing will return to the original frequency of 20,000 CY. Sample in accordance with Tex-400-A.	
	In-place Density (A)	Tex-115-E	As directed by the Engineer	Each 3,000 CY, min. 1 per lift	Correct the moisture contents measured by nuclear density gauge in Tex-115-E with the moisture contents determined in accordance with Tex-103-E, as necessary for control, for each different material or notable change in material and adjust the density accordingly. Materials such as RAP, gypsum, lime, cement, and iron ore tend to bias the counts for nuclear density gauges.	
	Thickness (A)	Tex-140-E	As directed by the Engineer	Each 3,000 CY	Not required where survey grade control documents are compliant.	
	Ride Quality (A)	Tex-1001-S Surface Test, Type B	Final riding surface of travel lanes		This applies to the final travel lanes that receive a 1- or 2-course surface treatment for the final surface, unless otherwise shown on the plans.	
TREATED SUBGRADE AND BASE COURSES	SUBGRADE BEFORE TREATMENT	Organic Content	Tex-148-E	As directed by the Engineer	1 per project, per source or as directed by the Engineer	Required for existing subgrade material and material imported from a borrow source. Soil survey and geologic maps may be used to determine sampling locations. Sample in accordance with Tex-100-E.
	SUBGRADE BEFORE TREATMENT	Sulfate Content	Tex-145-E	As directed by the Engineer	1 per 500 feet or 5,000 CY	Required for existing subgrade material and material imported from a borrow source. Soil survey and geologic maps may be used to determine sampling locations. Sample in accordance with Tex-100-E.
	NEW BASE MATERIAL	Liquid Limit (A)	Tex-104-E	During stockpiling operations, from completed stockpile, or windrow (B)	Each 5,000 CY	When central mix site or plant is used, windrow sampling may be waived. Sample in accordance with Tex-400-A.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE I – EMBANKMENTS, SUBGRADES, BACKFILL, AND BASE COURSES

			PROJECT TESTS			
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (F)	REMARKS	
TREATED SUBGRADE AND BASE COURSES (Continued)	NEW BASE MATERIAL (Continued)	Plasticity Index (A)	Tex-106-E	During stockpiling operations, from completed stockpile, or windrow (B)	Each 5,000 CY	
		Gradation (A)	Tex-110-E	During stockpiling operations, from completed stockpile, or windrow (B)	Each 5,000 CY	Sample in accordance with Tex-400-A.
		Wet Ball Mill (A)	Tex-116-E	From completed stockpile at the source (E)	Each 20,000 CY	Required for Grades 1–2 and 5, and as shown on the plans for Grade 4. Sample in accordance with Tex-400-A.
		Strength (A)	Tex-117-E	From completed stockpile at the source (E)	Each 20,000 CY	Required for Grades 1–2 and 5, and as shown on the plans for Grade 4. When base material is from a source where the District has a record of satisfactory triaxial results, the frequency of testing may be reduced to one per 30,000 CY. If any one test falls below the minimum value required, the frequency of testing will return to the original frequency of 20,000 CY.
	LIME	Compliance with DMS-6350	Tex-600-J	During delivery to project	Commercial Lime Slurry: each 200 tons of lime Carbide Lime Slurry: each 100 tons of lime	Sample in accordance with Tex-600-J. Verify the source is listed on the current Material Producer List for Lime . Only materials appearing on the Material Producer List will be accepted. Sample frequency for Carbide Lime Slurry may be increased as directed by the Engineer. For Hydrated Lime and Quick Lime, project testing is not required but it is encouraged to sample and test the material at a rate of 1 per project as a best practice.
	CEMENT	Compliance with DMS-4600		Railroad car, truck, or cement bins		Verify the source is listed on the current Material Producer List for Cement. If not, sample and test in accordance with DMS-4600. (C)
	FLY ASH MATERIAL	Compliance with DMS-4615		Project samples at location directed by the Engineer		Verify the source is listed on the current Material Producer List for Fly Ash . Only materials from MTD approved sources appearing on the Material Producer List for Fly Ash will be accepted. Project testing is not required but it is encouraged to sample and test the material at a rate of 1 per project as a best practice. (C)

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE I – EMBANKMENTS, SUBGRADES, BACKFILL, AND BASE COURSES

MATERIAL OR PRODUCT		TEST FOR	TEST NUMBER	PROJECT TESTS		REMARKS
				LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (F)	
TREATED SUBGRADE AND BASE COURSES (Continued)	COMPLETE MIXTURE	Pulverization Gradation	Tex-101-E, Part III	Roadway, after pulverization and mixing	As necessary for control	At the beginning of the project, one test must be made for each 4,500 CY or 6,000 tons until the Engineer is satisfied that acceptable pulverization results are being obtained. Sample in accordance with Tex-100-E.
		Moisture/Density Curve and Strength	Tex-120-E, Part II, or Tex-121-E, Part II	From roadway windrow after treatment (E)	Each 20,000 CY	Not required for ordinary compaction. Determine a new moisture/density curve for each different or notable change in material. Perform Tex-120-E, Part II, for Cement Treated Material, and Tex-121-E, Part II, for Lime, Lime-Fly Ash, or Fly Ash Treated Material. If Tex-120-E, Part I, Tex-121-E, Part I, or Tex-127-E is performed before the project, this test may be waived. Sample in accordance with Tex-100-E.
		Moisture/Density Curve and Strength	Tex-120-E, Part I, Tex-121-E, Part I, or Tex-127-E	From roadway before treatment	As necessary for control	Perform Tex-120-E, Part I, on cement treated material, and Tex-121-E, Part I, for lime-fly ash or fly ash treated material. Verifies the field strength by comparing results from the mix design. Performed at the direction of the Engineer and when notable change in material, as described above for Part II of the test procedures. Sample in accordance with Tex-100-E.
		In-place Density (A)	Tex-115-E	As directed by the Engineer	Each 3,000 CY, min 1 per lift	Determine the appropriate moisture/density curve for each different material or notable change in material. Correct the moisture contents measured by nuclear density gauge in Tex-115-E with the moisture contents determined in accordance with Tex-103-E, as necessary for control, for each different material or notable change in material and adjust the density accordingly. Stabilizers and materials such as RAP, gypsum, and iron ore tend to bias the counts for nuclear density gauges.
		Thickness (A)	Tex-140-E	As directed by the Engineer	Each 3,000 CY	Not required where survey grade control documents are used for compliance.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE I – EMBANKMENTS, SUBGRADES, BACKFILL, AND BASE COURSES					
			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (F)	REMARKS
RECLAIMED ASPHALT PAVEMENT (RAP), CRUSHED CONCRETE, and RECYCLED MATERIALS	Sulfate Content	Tex-145-E	During stockpiling operations, from completed stockpile, or windrow	Each 5,000 CY	Required only for contractor furnished recycled material, including crushed concrete. Not required for RAP. Sample in accordance with Tex-400-A.
	Deleterious Material	Tex-413-A		Each 5,000 CY	Required only for contractor furnished recycled material, including crushed concrete. Sample in accordance with Tex-400-A.
	Decantation	Tex-406-A	During stockpiling operations, from completed stockpile, or windrow	Each 5,000 CY	Required only for contractor furnished RAP. Sample in accordance with Tex-400-A.

TABLE I – FOOTNOTES	
A	When this project acceptance test fails, but the product is accepted, document the reasons for acceptance in SiteManager (SM), in the remarks field, and on the end of the Project Materials Certification Letter.
B	Engineer will select any of these locations or any combinations thereof with the provision that the initial sample will be obtained from the completed stockpile at the source and at least one out of ten consecutive samples will be taken at the project site (from the windrow for treated and untreated bases and embankments when possible).
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
D	For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows: <ul style="list-style-type: none"> • Soils/Flexible Base: For gradation, liquid limit, and plastic limit, vary sampling between stockpiling operations, completed stockpile, windrow, and project site. Vary the time of day sampling is performed. • Aggregates: Sample aggregates nearest the point of incorporation into the work. Vary sampling between stockpiling operations, completed stockpile, belt sampling, and if deemed necessary, railroad cars/trucks. Vary the time of day sampling is performed.
E	The Engineer will sample from the completed stockpile at the source and test before placement.
F	Each test performed that is based on a quantity of material is considered “or fraction thereof” for calculating number of tests.

This is a guide for minimum sampling and testing.
 Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IA – ASPHALT TREATED BASE (Plant Mix)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (C)	FREQUENCY OF SAMPLING (D)	REMARKS
AGGREGATE	Liquid Limit (A)	Tex-104-E	During stockpiling operations, from completed stockpile, or before mixing	Each 5,000 CY	Sample in accordance with Tex-400-A.
	Plasticity Index (A)	Tex-106-E	During stockpiling operations, from completed stockpile, or before mixing	Each 5,000 CY	
	Wet Ball Mill (A)	Tex-116-E	During stockpiling operations, from completed stockpile, or before mixing	1 per project, per source	Sample in accordance with Tex-400-A. (B)
LIME	Compliance with DMS-6350		During delivery to the project	Hydrated Lime: 1 per project Commercial Lime Slurry: each 200 tons of lime (D) Carbide Lime Slurry: each 100 tons of lime (D) Quick Lime: 1 per project	On projects requiring less than 50 tons, material from MTD approved sources may be accepted on the basis of Producer's Certification without sampling.
RECLAIMED ASPHALT PAVEMENT (RAP), and RECYCLED AGGREGATE	Decantation	Tex-406-A, Part I	During stockpiling operations, from completed stockpile, or before mixing	Each 10,000 CY	Sample in accordance with Tex-400-A.
RECYCLED ASPHALT SHINGLES (RAS)	Decantation	Tex-217-F, Part III	During stockpiling operations, from completed stockpile, or before mixing	Each 10,000 CY	Sample in accordance with Tex-400-A.
ASPHALT BINDER	Compliance with Item 300		Sampling port nearest the storage tank	1 per project, per grade, per source	Test a minimum of one sample taken from the project. Sample binder in accordance with Tex-500-C, Part II. Verify that the binder is from a preapproved source when it arrives on the project, and that the lab number on the shipping ticket is within the valid dates shown on the MTD QM test report or in the SiteManager (SM) Assistant. The Engineer must associate one QM sample per project in SM.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IA – ASPHALT TREATED BASE (Plant Mix)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (C)	FREQUENCY OF SAMPLING (D)	REMARKS
TACK COAT	Compliance with Item 300		Distributor	1 per project, per grade, per source	<p>Test a minimum of one sample taken from the project. Sample tack coat in accordance with Tex-500-C, Part III.</p> <p>Verify that the binder is from a preapproved source when it arrives on the project, and that the lab number on the shipping ticket is within the valid dates shown on the MTD QM test report or in the SM Assistant.</p> <p>The Engineer must associate one QM sample per project in SM.</p>
COMPLETE MIXTURE	Gradation (A)	Tex-200-F, Part I	Plant Mix (C)	20,000 CY (25,000 tons)	<p>Sample in accordance with Tex-222-F.</p> <p>Determine the gradation of the aggregate from the complete mixture tested in accordance with Tex-236-F.</p>
	Laboratory Density (A)	Tex-126-E	Plant Mix (C)	20,000 CY (25,000 tons)	Sample in accordance with Tex-222-F.
	Percent Asphalt (A)	Tex-236-F	Plant Mix (C)	Each 1,500 CY (2,000 tons) or days production	Determine an asphalt content correction factor for ignition oven at a minimum of one per project. Sample in accordance with Tex-222-F.
	Indirect Tensile Strength – Dry	Tex-226-F	Plant Mix	1 per project, per design	Sample in accordance with Tex-222-F.
	Moisture Susceptibility	Tex-530-C	As directed by the Engineer	1 per project, per design	This test may be waived, when shown on the plans. Sample in accordance with Tex-222-F.
ROADWAY	In-Place Air Voids (A)	Tex-207-F	Roadway cores, as directed by the Engineer (C, D)	Each 3,000 CY, min 1 per lift	Not required for ordinary compaction or when air void requirements are waived. Sample in accordance with Tex-222-F.
	Ride Quality	Tex-1001-S Surface Test, Type A	On Finished Surface		Unless otherwise shown on the plans.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IA – FOOTNOTES	
A	When this project acceptance test fails, but the product is accepted, document the reasons for acceptance in SiteManager (SM), in the remarks field, and on the end of the Project Materials Certification Letter.
B	Engineer will select any of these locations or any combinations thereof with the provision that at least one out of ten consecutive samples will be taken at the project site (from the windrow for treated and untreated bases and embankments when possible).
C	For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows: <ul style="list-style-type: none">• Soils/Flexible Base: Vary sampling between stockpiling operations, completed stockpile, windrow, and project site. Vary the time of day sampling is performed.• Aggregates: Sample aggregates nearest the point of incorporation into the work. Vary sampling between stockpiling operations, completed stockpile, belt sampling, and if deemed necessary, railroad cars/trucks. Vary the time of day sampling is performed.
D	Each test performed, that is based on a quantity of material, is considered “or fraction thereof” for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE II – SEAL COAT					
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	PROJECT TESTS		REMARKS
			LOCATION OR TIME OF SAMPLING (C)	FREQUENCY OF SAMPLING (D)	
AGGREGATE	Gradation (A)	Tex-200-F, Part I	Stockpile (At source or at point of delivery)	Each 1,000 CY	Rate may be reduced to each 2,000 CY if the Engineer approves a contractor quality control plan. Sample in accordance with Tex-221-F.
	L. A. Abrasion (A)	Tex-410-A	Stockpile	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer List for BRSQC , meets the project specifications. If not, sample and test at 1 per 20,000 CY before use. Sample in accordance with Tex-221-F. (B)
	Magnesium Soundness (A)	Tex-411-A	Stockpile	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer List for BRSQC , meets the project specifications. If not, sample and test at 1 per 20,000 CY before use. Sample in accordance with Tex-221-F. (B)
	Surface Aggregate Classification (A)	Tex-612-J, Tex-411-A	Stockpile	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer List for BRSQC , meets the project specifications. If not, sample and test at 1 per 20,000 CY before use. Sample in accordance with Tex-221-F. (B)
	Pressure Slake (A)	Tex-431-A	Stockpile	1 per 20,000 CY	Same as above. Required only for lightweight aggregate. Sample in accordance with Tex-221-F.
	Freeze Thaw (A)	Tex-432-A	Stockpile	1 per 20,000 CY	Same as above. Required only for lightweight aggregate. Sample in accordance with Tex-221-F.
	Unit Weight	Tex-404-A	Stockpile	1 per 20,000 CY	Same as above. Required only for lightweight aggregate. Sample in accordance with Tex-221-F.
	24 hr. Water Absorption (A)	Tex-433-A	Stockpile	1 per 20,000 CY	Same as above. Required only for lightweight aggregate. Sample in accordance with Tex-221-F.
	Crushed Face Count	Tex-460-A, Part I	Stockpile	1 per 20,000 CY	Only required for crushed gravel. Sample in accordance with Tex-221-F.
	Deleterious Material (A)	Tex-217-F, Part I	Stockpile	1 per 10,000 CY	Not required for lightweight aggregate. Sample in accordance with Tex-221-F.
	Decantation (A)	Tex-406-A	Stockpile	1 per 10,000 CY	Sample in accordance with Tex-221-F.
Flakiness Index	Tex-224-F	Stockpile	Frequency as directed by the Engineer	Sample in accordance with Tex-221-F.	

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE II – SEAL COAT					
			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (C)	FREQUENCY OF SAMPLING (D)	REMARKS
AGGREGATE (Continued)	Micro Deval	Tex-461-A	Stockpile	1 per project or as necessary for control	Compare result to published value listed on the current Material Producer List for BRSQC. Submit sample to MTD for Soundness and L.A. Abrasion testing when results differ by more than 3% points, unless otherwise directed by the Engineer. Sample in accordance with Tex-221-F.
	White Rock Count	Tex-220-F	Stockpile		Required only for Limestone Rock Asphalt. Not required when MTD provides inspection at the plant. Sample in accordance with Tex-221-F.
	Naturally Impregnated Bitumen Content	Tex-236-F	Stockpile		Required only for Limestone Rock Asphalt. Not required when MTD provides inspection at the plant. Sample in accordance with Tex-221-F.
PRECOATED AGGREGATE	Asphalt Content	Tex-210-F	Stockpile	Frequency as directed by the Engineer when a target value is specified	Sample in accordance with Tex-221-F.
ASPHALT BINDER	Compliance with Item 300		Distributor	1 per project, per grade, per source	Test a minimum of one sample taken from the project. Sample asphalt binder in accordance with Tex-500-C, Part III. Verify that the binder is from a preapproved source when it arrives on the project, and that the lab number on the shipping ticket is within the valid dates shown on the MTD QM test report or in the SM Assistant. The Engineer must associate one QM sample per project in SM.

TABLE II – FOOTNOTES	
A	When this project acceptance test fails, but the product is accepted, document the reasons for acceptance in SiteManager, in the remarks field, and on the end of the Project Materials Certification Letter.
B	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
C	For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows: <ul style="list-style-type: none"> Aggregates: Sample aggregates nearest the point of incorporation into the work. Vary sampling between stockpiling operations, completed stockpile, belt sampling, and if deemed necessary, railroad cars/trucks. Vary the time of day sampling is performed.
D	Each test performed, that is based on a quantity of material, is considered “or fraction thereof” for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE III – HYDRAULIC CEMENT CONCRETE – STRUCTURAL (Classes: C, F, H, S, CO, K, LMC, or SS)						
			PROJECT TESTS			
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (E)	REMARKS	
MINERAL AGGREGATE	COARSE AGGREGATE	Decantation (B)	Tex-406-A	From stockpile at concrete plant	Each 20,000 CY of concrete (each source)	Sample in accordance with Tex-400-A.
		Sieve Analysis (A) (B)	Tex-401-A		Each 1,000 CY of concrete (each source)	Test combined aggregate when used. Sample in accordance with Tex-400-A.
		Deleterious Materials (B)	Tex-413-A		1 per project or as necessary for control	Sample in accordance with Tex-400-A.
		Los Angeles Abrasion (A) (B)	Tex-410-A		One, each source	Verify the value of the source, as listed on the current Material Producer list for CRSQC , meets the project specifications. If not, sample and submit to MTD for testing before use in accordance with Tex- 499-A. Sample in accordance with Tex-400-A. (C)
		Magnesium Soundness (A) (B)	Tex-411-A		One, each source	Verify the value of the source, as listed on the current CRSQC , meets the project specifications. (C)
	FINE AGGREGATE	Sand Equivalent (B)	Tex-203-F	From stockpile at concrete plant	1 per project or as necessary for control	Test combined aggregate when used. Sample in accordance with Tex-400-A.
		Organic Impurities (B)	Tex-408-A		1 per project, per source	Sample in accordance with Tex-400-A.
		Sieve Analysis (A) (B)	Tex-401-A		Each 1,000 CY of concrete (each source)	Sample in accordance with Tex-400-A.
		Fineness Modulus (B)	Tex-402-A		1 per project or as necessary for control	Test combined aggregate when used. Test to confirm material variability when strength values are in question. Sample in accordance with Tex-400-A.
		Deleterious Material (B)	Tex-413-A		1 per project or as necessary for control	Test to confirm material variability when strength values are in question. Sample in accordance with Tex-400-A.

This is a guide for **minimum sampling and testing**.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE III – HYDRAULIC CEMENT CONCRETE – STRUCTURAL (Classes: C, F, H, S, CO, K, LMC, or SS)						
			PROJECT TESTS			
MATERIAL OR PRODUCT		TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (E)	REMARKS
MINERAL AGGREGATE (Continued)	FINE AGGREGATE (Continued)	Acid Insoluble Residue (A) (B)	Tex-612-J		Two, each source	Only for concrete subject to direct traffic. Verify the value of the source, as listed on the current CRSQC , meets the project specifications. If not, sample and submit to MTD for testing before use in accordance with Tex-499-A. Sample in accordance with Tex-400-A. (C)
SILICA FUME		Compliance with DMS-4630 (A)		Railroad car, truck, bags or silos	1 per project, per class of concrete (For each type and brand)	Provide MTD with one 4 x 8 concrete sample for silica fume dispersion verification. Verify the source is listed on the Material Producer List for Silica Fume. Sample in accordance with Tex-300-D.
METAKAOLIN		Compliance with DMS-4635 (A)		Railroad car, truck or silos	1 per project, per class of concrete (For each type and brand)	Sample in accordance with Tex-300-D.
MIX DESIGN		Compliance with Standard Specification Item 421.4.A		At source (if not approved)	Min. 1 design per class, per source	Verify if cement, fly ash, slag cement, and chemical admixture sources are listed on the Material Producer Lists. If not, sample and submit to MTD for testing. Water testing is contracted by the concrete supplier (commercial lab report to be reviewed by TxDOT). Sample in accordance with Tex-300-D for cement and in accordance with Tex-733-I for fly ash.
JOINT MATERIAL		Compliance with DMS-6300				Verify the source is listed on the Material Producer List for Joint Sealers . If not, sample and test before use in accordance with DMS-6310. (C) Sample in accordance with Tex-500-C.
CURING COMPOUND		Compliance with DMS-4650		Sampled at jobsite; tested by MTD . See remarks.	When requested by MTD	Only products listed on the Material Producer List for Concrete Curing Compounds will be allowed. When sample is requested by MTD , sample in accordance with Tex-718-I. Ensure container has been agitated and mixed before sampling. (C)
EVAPORATION RETARDANTS		Compliance with DMS-4650				Only products listed on the Material Producer list for Evaporation Retardants will be allowed. (C)
REINFORCING STEEL		Compliance with the Std. Specifications & Spec. Provisions	As Specified			Only materials from MTD approved sources listed on the Material Producer Lists for Reinforcing Steel Mills and Seven Wire Steel Strand will be allowed. (C)

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE III – HYDRAULIC CEMENT CONCRETE – STRUCTURAL (Classes: C, F, H, S, CO, K, LMC, or SS)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (E)	REMARKS
MECHANICAL COUPLERS	Compliance with DMS-4510	Tex-743-I	Sampled at jobsite; Tested by MTD	3 couplers per lot (500 couplers) for each type, model, bar size, and grade	Only materials from MTD approved sources listed on the Material Producer List for Mechanical Couplers will be allowed. (C)
LATEX	Compliance with DMS-4640 for concrete chemical admixtures				Verify the Latex is listed on the Material Producer List for Chemical Admixtures.
EPOXY	Compliance with DMS-6100, unless otherwise specified		Sampled at jobsite if not pre-approved by MTD .	1 per batch or shipment	Verify the source is listed on the Material Producer List for Epoxies and Adhesives . If not, sample and test before use in accordance with DMS-6100. Sample in accordance with Tex-734-I. (C)
CONCRETE	Compressive Strength (A)	Tex-418-A	At point of concrete placement	4 cylinders for each 60 CY per class, per day (For bridge railing and traffic railing, testing may be reduced to 4 cylinders per 180 CY per class regardless of days)	Sampling must be in accordance with Tex-407-A. Making additional cylinders for 56 day testing should be considered when slow strength gain mixtures are being used, or when the approved mix design has a history of failing to meet design strength at 28 days. Test two cylinders at 7 days, and if the average value is below the design strength, as defined in Item 421, Table 8, test the remaining 2 cylinders at 28 days, or 56 days if additional cylinder were not made. If the average value of the 2 cylinders tested at 7 days meets the minimum design strength, listed in Item 421, Table 8, the remaining cylinders are not required to be tested. If the average value of the 7 and 28 day cylinders are below the design strengths, and 56 day cylinders were made, test the remaining set at 56 days.
	Slump	Tex-415-A		1 test, per 4 strength specimens	Sample in accordance with Tex-407-A. Perform slump and temperature tests on the same load from which strength test specimens are made. Perform entrained air test only when entrained air concrete is specified on the plans. Check temperature of every load for bridge slabs and mass concrete placements.
	Entrained Air (A)	Tex-416-A or Tex-414-A			Contractor's required testing will be in accordance with specification requirements for the appropriate specification Item #.
	Temperature of Concrete (A)	Tex-422-A			

This is a guide for minimum sampling and testing.
 Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE III – HYDRAULIC CEMENT CONCRETE – STRUCTURAL (Classes: C, F, H, S, CO, K, LMC, or SS)					
			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (D)	FREQUENCY OF SAMPLING (E)	REMARKS
CONCRETE (Continued)	Bridge Deck or Culvert Top Slab Thickness and Depth of Reinforcement	Tex-423-A, Part II	During dry run and during concrete placement (Bridge decks and direct traffic culverts)	1 per span	Min 6–Max 18 locations per span.

TABLE III – FOOTNOTES	
A	When this project acceptance test fails, but the product is accepted, document the reasons for acceptance in SiteManager, in the remarks field, and on the end of the Project Materials Certification Letter.
B	These Project Tests may be used for one or more projects being furnished concrete from the same plant during the same period.
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
D	For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows: <ul style="list-style-type: none"> • Aggregates: Sample aggregates nearest the point of incorporation into the work. Vary sampling between stockpiling operations, completed stockpile, and if deemed necessary, railroad cars/trucks. Vary the time of day sampling is performed. • Concrete (structural): Always sample as near as practicable to the point of placement. For strength testing, vary the time of day or the number of truck from which the concrete is sampled. Test often for slump, air, and temperature to ensure the consistent control of the concrete production.
E	Each test performed, that is based on a quantity of material, is considered “or fraction thereof” for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IV – HYDRAULIC CEMENT CONCRETE – NON-STRUCTURAL CONCRETE (Classes: A, B, or E)					
			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING (B)	FREQUENCY OF SAMPLING (C)	REMARKS
CONCRETE	Compressive Strength (A)	Tex-418-A	At point of concrete placement	2 cylinders per 180 CY, per class	Sampling must be in accordance with Tex-407-A. Strength will be determined by 7-day specimens.
MIX DESIGN	Compliance with the Standard Specification		At source if not approved	Min. 1 design per class, per source	Verify if cement, fly ash, slag cement, and chemical admixture sources are listed on the Material Producer Lists. If not, sample and submit to MTD for testing. Sample in accordance with Tex-300-D for cement and in accordance with Tex-733-I for fly ash. Water testing is contracted by the concrete supplier (commercial lab report to be reviewed by TxDOT).
SILICA FUME	Compliance with DMS-4630		Railroad car, truck, bags, or silos	1 test per project, per class (for each type and brand)	Sample in accordance with Tex-300-D. Provide MTD with one 4 x 8 concrete sample for silica fume dispersion verification. Verify the source is listed on the Material Producer List for Silica Fume.
METAKAOLIN	Compliance with DMS-4635		Railroad car, truck, or silos	1 test per project, per class (for each type and brand)	Sample in accordance with Tex-300-D.

TABLE IV – FOOTNOTES	
A	When this project acceptance test fails, but the product is accepted, document the reasons for acceptance in SiteManager, in the remarks field, and on the end of the Project Materials Certification Letter.
B	For acceptance testing, especially that which directly determines payment for the Contractor, sampling personnel should provide randomness in sampling by avoiding patterned sampling routines. Examples of such sampling practices are as follows: <ul style="list-style-type: none"> • Concrete (miscellaneous): Always sample as near as practicable to the point of placement. For strength testing, vary the time of day or the number of truck from which the concrete is sampled.
C	Each test performed, that is based on a quantity of material, is considered “or fraction thereof” for calculating number of tests.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE V – HYDRAULIC CEMENT CONCRETE PAVEMENT (Classes: P or HES)

			PROJECT TESTS			
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING	FREQUENCY OF SAMPLING (D)	REMARKS	
MINERAL AGGREGATE	COARSE AGGREGATE	Decantation	Tex-406-A	From stockpile at concrete plant	Each 20,000 CY of concrete (each source)	Sample in accordance with Tex-400-A.
		Sieve Analysis (A)	Tex-401-A		As necessary for control	Sample in accordance with Tex-400-A. Test combined aggregate when used.
		Deleterious Materials	Tex-413-A		Each 20,000 CY of concrete (each source)	Sample in accordance with Tex-400-A.
		L.A. Abrasion (A)	Tex-410-A		One, each source	Verify the value of the source, as listed on the current CRSQC, meets the project specifications. If not, sample and submit to MTD for testing before use in accordance with Tex-499-A. Sample in accordance with Tex-400-A. (C)
		Magnesium Soundness (A)	Tex-411-A			
	FINE AGGREGATE	Sand Equivalent	Tex-203-F	From stockpile at concrete plant	Each 3,000 CY of concrete (Each source or combination of sources)	Sample in accordance with Tex-400-A. Test combined aggregate when used. At least one per week's production.
		Organic Impurities	Tex-408-A		1 per project, per source	Sample in accordance with Tex-400-A.
		Sieve Analysis (A)	Tex-401-A		As necessary for control	Sample in accordance with Tex-400-A. Test combined aggregate when used.
		Fineness Modulus (B)	Tex-402-A			
		Deleterious Material (B)	Tex-413-A		Each 20,000 CY of concrete (each source)	Sample in accordance with Tex-400-A.
		Acid Insoluble (A)	Tex-612-J		1 per project, per source	Verify the value of the source, as listed on the current CRSQC, meets the project specifications. If not, sample and submit to MTD for testing before use in accordance with Tex-499-A. Sample in accordance with Tex-400-A. (C)
MIX DESIGN	Compliance with the Standard Specifications Item 421.4.A		At source, if not approved	Min. 1 design, per class, per source	Verify if cement, fly ash, ground granulated blast furnace slag, and admixture sources are listed on the Material Producer List. If not, sample and submit to MTD for testing. Sample in accordance with Tex-300-D for cement and in accordance with Tex-733-I for fly ash. Water testing is contracted by the concrete supplier (commercial lab report to be reviewed by TxDOT).	
SILICA FUME	Compliance with DMS-4630		Railroad car, truck, bags, or silos	1 per project, per class of concrete (For each type and brand)	Sample in accordance with Tex-300-D. Provide MTD with one 4 x 8 concrete sample for silica fume dispersion verification. Verify the source is listed on the Material Producer List for Silica Fume.	

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE V – HYDRAULIC CEMENT CONCRETE PAVEMENT (Classes: P or HES)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING	FREQUENCY OF SAMPLING (D)	REMARKS
METAKAOLIN	Compliance with DMS-4635		Railroad car, truck, or silos	1 per project, per class of concrete (For each type and brand)	Sample in accordance with Tex-300-D.
JOINT MATERIAL	Compliance with DMS-6310		Sampled at jobsite if not sampled at source by MTD ; tested by MTD . See remarks.	1 per batch or shipment	Sample in accordance with Tex-500-C. Sampling may be waived when the source is listed on the Material Producer List for Joint Sealers . (C)
CURING COMPOUND	Compliance with DMS-4650		Sampled at jobsite; tested by MTD . See remarks.	When requested by MTD	Only products listed on the Material Producer List for Concrete Curing Compounds will be allowed. When sample is requested by MTD , sample in accordance with Tex-718-I. Ensure container has been agitated and mixed before sampling. (C)
EVAPORATION RETARDANTS	Compliance with DMS-4650				Only products listed on the Material Producer List for Evaporation Retardants will be allowed. (C)
REINFORCING STEEL	Compliance with the Std. Specifications & Spec. Provisions	As Specified			Only materials from MTD approved sources listed on the Material Producer List for Reinforcing Steel Mills and Seven Wire Steel Strand will be accepted. (C)
MULTIPLE PIECE TIE BARS	Compliance with DMS-4515	Tex-712-I	Sampled at jobsite if not sampled at source by MTD ; tested by MTD . See remarks.	Refer to Tex-711-I for sampling rates	Only materials from MTD approved sources listed on the Material Producer List for Multiple Piece Tie-bars for Concrete Pavements will be allowed. Sample in accordance with Tex-711-I.
EPOXY	Compliance with DMS-6100		Sampled at jobsite if not pre-approved by MTD . See remarks.	1 batch per shipment	Verify the source is listed on the Material Producer List for Epoxyes and Adhesives . If not, sample and test before use in accordance with DMS-6100. Sample in accordance with Tex-734-I. (C)
CONCRETE	Strength (A) (B)	Tex-448-A or Tex-418-A	At point of concrete placement	2 cylinders for every 10 contractor job control tests	Sample in accordance with Tex-407-A. When the contract requires the project testing to be by the Engineer, the frequency and job control testing will be in accordance with the item of work. Split sample verification testing used when contractor performs job control testing. When job control testing by the contractor is waived by the plans, the frequency of sampling will be one test (2 specimens) for each 3,000 SY of concrete or fraction thereof or per day and split sample verification testing will be waived. Contractor's required testing will be in accordance with specification requirements for the appropriate specification Item #.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE V – HYDRAULIC CEMENT CONCRETE PAVEMENT (Classes: P or HES)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OR TIME OF SAMPLING	FREQUENCY OF SAMPLING (D)	REMARKS
CONCRETE (Continued)	Slump	Tex-415-A	At time and location strength specimens are made	1 test for every 10 contractor job control tests.	Sample in accordance with Tex-407-A. Slump is not required for slip-formed pavement. Perform slump and temperature tests on the same load from which the strength specimens are made. Perform entrained air test only when entrained air concrete is specified on the plans. Contractor's required testing will be in accordance with specification requirements for the appropriate specification Item #.
	Entrained Air (A)	Tex-416-A or Tex-414-A			
	Temperature	Tex-422-A			
	Pavement Texture	Tex-436-A	Final Riding Surface of travel lanes	1 per day, per driving lane	Perform when carpet drag is the only surface texture required on the plans.
	Thickness	Tex-423-A, Part I	Center of paving machine	Every 500 feet	Methods other than Tex-423-A may be shown on the plans.
	Ride Quality (A)	Tex-1001-S Surface Test, Type B	Final riding surface of travel lanes		Engineer may verify contractor's results for surface test Type B. For traditional design-bid-build TxDOT projects, MTD has contracted with TTI to perform random ride verification at 10% frequency. Results from surface test Type A are not required to be reported.

TABLE V – FOOTNOTES

A	When this project acceptance test fails, but the product is accepted, document the reasons for acceptance in SiteManager, in the remarks field, and on the end of the Project Materials Certification Letter.
B	When a project test does not meet the specified strength requirements and a reduced pay factor is assigned, document the analysis on the Letter of Certification of Materials Used.
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
D	Each test performed, that is based on a quantity of material, is considered "or fraction thereof" for calculating number of tests.

This is a guide for minimum sampling and testing.
 Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VI – HOT-MIX ASPHALT PAVEMENT (Items 341, 342, 344, 346, 347 and 348)
 (All testing as noted in Table VI may be waived for exempt production as defined by specification.)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION (Per Design)	FREQUENCY OF SAMPLING (E)	REMARKS
COARSE AGGREGATE	L. A. Abrasion (A)	Tex-410-A	Stockpile (B)	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer list for BRSQC , meets the project specifications. If not, sample in accordance with Tex-221-F and submit to MTD for testing before use in accordance with Tex-499-A. (C)
	Magnesium Soundness (A)	Tex-411-A			
	Surface Aggregate Classification (A)	Tex-499-A		1 per project, per source	
	Micro Deval	Tex-461-A		1 per project, per aggregate source	
COMBINED AGGREGATE	Sand Equivalent	Tex-203-F	Stockpiles, hot bins, or feeder belts	1 per project, per source, per design	Does not apply to Item 342. Sample in accordance with Tex-221-F. The timing of when the test is performed is at the discretion of the Engineer.
ASPHALT BINDER	Compliance with Item 300 (A)		Sampling port nearest the storage tank	1 per project, per grade, per source	Test a minimum of one sample taken from the project. Sample binder at hot- mix plant in accordance with Tex-500-C, Part II. Verify that the binder is from a preapproved source when it arrives on the project, and that the lab number on the shipping ticket is within the valid dates shown on the MTD QM test report or in the SM Assistant. The Engineer must associate one QM sample, per project in SM.
TACK COAT	Compliance with Item 300 (A)		Distributor	1 per project, per grade, per source	Test a minimum of one sample taken from the project. Sample tack coat in accordance with Tex-500-C, Part III. Verify that the binder is from a preapproved source when it arrives on the project, and that the lab number on the shipping ticket is within the valid dates shown on the MTD QM test report or in the SM Assistant. The Engineer must associate one QM sample, per project in SM.

This is a guide for **minimum sampling and testing**.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VI – HOT-MIX ASPHALT PAVEMENT (Items 341, 342, 344, 346, 347 and 348)
(All testing as noted in Table VI may be waived for exempt production as defined by specification.)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION (Per Design)	FREQUENCY OF SAMPLING (E)	REMARKS
MIX DESIGN	Compliance with applicable specification	Tex-204-F	At source (if not approved)	Min 1 design, per Mix Type and Asphalt Grade	Verify that aggregates, recycled asphalt pavement, recycled asphalt shingles, mineral filler, asphalt binder, anti-stripping additives, and warm mix systems are on the Material Producer List where applicable and that they meet project specification requirements. Project sampling and testing may be conducted on individual materials, as necessary, for control.
COMPLETE MIXTURE	Asphalt Content (A)	Tex-236-F	Engineer Truck Sample (D)	Minimum 1 per Lot	Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project. When Tex-236-F does not yield reliable results, use alternative methods for determining asphalt content, such as, Tex-210-F (ASTM D2172/AASHTO T164) and Tex-228-F (ASTM D4125/AASHTO T287).
	Voids in Mineral Aggregates (VMA)	Tex-204-F	Truck Sample Plant Produced (D)	1 per Sublot	Sample in accordance with Tex-222-F. Contractor's required testing will be in accordance with specification requirements for the appropriate specification Item #. Does not apply to Items 342 and 348.
	Gradation (A)	Tex-200-F	Engineer Truck Sample (D)	Minimum 1, per 12 Sublots (E)	Sample in accordance with Tex-222-F. Determine correction factors for ignition oven using Tex-236-F at a minimum of one per project.
	Moisture Susceptibility	Tex-530-C	Truck Sample	1 per project	Sample in accordance with Tex-222-F, unless waived by the Engineer.
	Indirect Tensile Strength – Dry	Tex-226-F			Sample in accordance with Tex-222-F, unless waived by the Engineer. Does not apply to Items 342, 346, 347, and 348.
	Moisture Content	Tex-212-F, Part II	Engineer Truck Sample		Sample in accordance with Tex-222-F.
	Lab Molded Density (A)	Tex-207-F, Part I, VI, VIII	Truck Sample (D)	1 per Sublot 1 per Lot for Item 347	Sample in accordance with Tex-222-F. Contractor's required testing will be in accordance with specification requirements for the appropriate specification Item #.
	Drain Down Test (A)	Tex-235-F	Engineer Truck Sample	1 per 12 Sublots	Sample in accordance with Tex-222-F. Not required for Items 341, 344, and 347.
	Hamburg Wheel Test (A)	Tex-242-F	Engineer Truck Sample	1 per project	Sample in accordance with Tex-222-F. Sample during production. Does not apply to Item 348 PFC-C, PFCR-C, and Thin Bonded Wearing Course –All Types.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VI – HOT-MIX ASPHALT PAVEMENT (Items 341, 342, 344, 346, 347 and 348)
(All testing as noted in Table VI may be waived for exempt production as defined by specification.)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION (Per Design)	FREQUENCY OF SAMPLING (E)	REMARKS
COMPLETE MIXTURE (Continued)	Cantabro Loss (A)	Tex-245-F	Engineer Truck Sample	1 per project	Sample in accordance with Tex-222-F. Sample during production. Does not apply to items 341, 344, 346, and 347.
	Overlay Test (A)	Tex-248-F	Engineer Truck Sample	1 per project	Sample in accordance with Tex-222-F. Does not apply to Items 341, 344, and 348 PFC-C, PFCR-C, and Thin Bonded Wearing Course –All Types.
ROADWAY	In-Place Air Voids (A)	Tex-207-F, Part I, VI, VIII	Roadway (D)	2 cores per Sublot	Two cores taken per Sublot and averaged. Sample in accordance with Tex-222-F. Does not apply to Items 342, 347, and 348.
	Segregation Profile (A)	Tex-207-F, Part V	Roadway	1 per project	Not required when Contractor uses thermal imaging system. Does not apply to Items 342, 347, and 348.
	Joint Density (A)	Tex-207-F, Part VII	Roadway	1 per project	
	Thermal Profile	Tex-244-F	Immediately behind paver	1 per project	Not required when Contractor uses thermal imaging system.
	Ride Quality Test Type B (A)	Tex-1001-S	Final riding surface of travel lanes	1 per project	Engineer may verify Contractor's results for surface test Type B. For traditional design-bid-build TxDOT projects, MTD has contracted with TTI to perform random ride verification at 10% frequency. Results for surface test Type A are not required to be reported.
	Permeability	Tex-246-F	Roadway	1 per project	Permeability is encouraged to use with items 342 and 348. Only applies to Item 347.
FABRIC UNDERSEAL	Compliance with DMS-6220		Sampled, tested, and approved by MTD		Sampling must be in accordance with Tex-735-I. Verify the source is listed on the current Material Producer List for Silt Fence, Filter Fabric, and Fabric Underseals. If not, sample and test before use in accordance with DMS-6220.

TABLE VI – FOOTNOTES

A	When this project acceptance test fails, but the product is accepted, document the reasons for acceptance in SiteManager, in the remarks field, and on the end of the Project Materials Certification Letter.
B	Sampling may be performed at the plant, quarry, or both. Aggregate properties may be re-tested at any time during the project. These project tests may be used for one or more projects furnishing hot mix with the same aggregate source.
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
D	Perform random sampling as specified in Tex-225-F, "Random Selection of Bituminous Mixture Samples."
E	Each test performed, that is based on a quantity of material, is considered "or fraction thereof" for calculating number of tests.

This is a guide for minimum sampling and testing.
 Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VII – HOT-MIX ASPHALT PAVEMENT (Items 334) (Refer to DMS-9210, “Limestone Rock Asphalt (LRA),” for testing requirements for Item 330.)					
			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION	FREQUENCY (Per Design) (F)	REMARKS
COARSE AGGREGATE	L. A. Abrasion (A)	Tex-410-A	Stockpile (B)	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer List for BRSQC , meets the project specifications. If not, sample in accordance with Tex-221-F and submit to MTD for testing before use in accordance with Tex-499-A. (D) Sample in accordance with Tex-221-F. Testing frequency may be reduced or eliminated based on a satisfactory test history.
	Magnesium Soundness (A)	Tex-411-A			
	Micro Deval	Tex-461-A			
	Surface Aggregate Classification (A)	Tex-499-A	Stockpile (B)	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer List for BRSQC , meets the project specifications. If not, sample in accordance with Tex-221-F and submit to MTD for testing before use in accordance with Tex-499-A. SiteManager Quality Monitoring test documentation is accomplished by attaching an approved mix design.
COMBINED AGGREGATE	Sand Equivalent	Tex-203-F	Stockpiles, hot bins, or feeder belts	1 per project, per source	Sample in accordance with Tex-221-F. The timing of when the test is performed is at the discretion of the Engineer.
ASPHALT BINDER	Compliance with Item 300 (A)		Sampling port nearest the storage tank	1 per project, per grade, per source	Test a minimum of one sample taken from the project. Sample binder in accordance with Tex-500-C, Part II. Verify that the binder is from a preapproved source when it arrives on the project, and that the lab number on the shipping ticket is within the valid dates shown on the MTD QM test report or in the SM Assistant. The Engineer must associate one QM sample, per project in SM.
TACK COAT	Compliance with Item 300 (A) (C)		Distributor	1 per project, per grade, per source	Test a minimum of one sample taken from the project. Sample tack coat in accordance with Tex-500-C, Part III. Verify that the binder is from a preapproved source when it arrives on the project, and that the lab number on the shipping ticket is within the valid dates shown on the MTD QM test report or in the SM Assistant. The Engineer must associate one QM sample, per project in SM.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VII – HOT-MIX ASPHALT PAVEMENT (Items 334)

(Refer to DMS-9210, “Limestone Rock Asphalt (LRA),” for testing requirements for Item 330.)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION	FREQUENCY (Per Design) (F)	REMARKS
MIX DESIGN	Compliance with applicable specification	Tex-204-F	At source (if not approved)	Min 1 design per Mix Type and Asphalt Grade	Verify that aggregates, recycled asphalt pavement, recycled asphalt shingles, mineral filler, asphalt binder, anti-stripping additives, and warm mix systems are on the Material Producer List where applicable and that they meet project specification requirements. Project sampling and testing may be conducted in individual materials as necessary for control.
COMPLETE MIXTURE	Asphalt Content (A)	Tex-236-F	Engineer Truck Sample (E)	Minimum of 1 per 5,000 tons	Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Voids in Mineral Aggregates (VMA)	Tex-204-F	Truck Sample Plant Produced (E)	1 per 5,000 tons	Sample in accordance with Tex-222-F.
	Gradation (A)	Tex-236-F	Truck Sample	Minimum 1 per 5,000 tons	Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Boil Test	Tex-530-C		1 per project	Sample in accordance with Tex-222-F. The timing of when the test is performed is at the discretion of the Engineer.
	Moisture Content	Tex-212-F, Part II	Truck Sample	1 per 5,000 tons	Sample in accordance with Tex-222-F. Performed by MTD at the point of production for payment calculations.
	Hydrocarbon- Volatile Content	Tex-213-F		1 per 5,000 tons	Sample in accordance with Tex-222-F. The timing of when the test is performed is at the discretion of the Engineer.
	Lab Molded Density (A)	Tex-207-F		1 per 5,000 tons	Sample in accordance with Tex-222-F.
	Hveem Stability (A)	Tex-208-F		1 per 5,000 tons	Sample in accordance with Tex-222-F. The timing of when the test is performed is at the discretion of the Engineer.
ROADWAY	Ride Quality Test Type B (A)	Tex-1001-S	Final riding surface of travel lanes		Engineer may verify Contractor’s results for surface test Type B. For traditional design-bid-build TxDOT projects, MTD has contracted with TTI to perform random ride verification at 10% frequency. Results from surface test Type A are not required to be reported.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VII – FOOTNOTES

A	When this project acceptance test fails, but the product is accepted, document the reasons for acceptance in SiteManager, in the remarks field, and on the end of the Project Materials Certification Letter.
B	Sampling may be performed at the plant, quarry, or both. Aggregate properties may be re-tested at any time during the project.
C	Or as called for in the Specifications.
D	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
E	Perform random sampling as specified in Tex-225-F, “Random Selection of Bituminous Mixture Samples.”
F	Each test performed, that is based on a quantity of material, is considered “or fraction thereof” for calculating number of tests.

This is a guide for minimum sampling and testing.
 Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VIII – HOT-MIX ASPHALT PAVEMENT (Item 340)

			PROJECT TESTS			
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION	FREQUENCY	REMARKS	
COARSE AGGREGATE	L. A. Abrasion (A)	Tex-410-A	Stockpile (B)	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer List for BRSQC , meets the project specifications. If not, sample in accordance with Tex-221-F and submit to MTD for testing before use in accordance with Tex-499-A. (C)	
	Magnesium Soundness (A)	Tex-411-A				
	Micro Deval	Tex-461-A	Stockpile (B)	1 per project, per source		Sample in accordance with Tex-221-F. Testing frequency may be reduced or eliminated based on a satisfactory test history.
	Surface Aggregate Classification (A)	Tex-499-A	Stockpile (B)	1 per project, per source		Verify the published value of the source, as listed on the current Material Producer list for BRSQC , meets the project specifications. If not, sample in accordance with Tex-221-F and submit to MTD for testing before use in accordance with Tex-499-A. (C)
COMBINED AGGREGATE	Sand Equivalent	Tex-203-F	Stockpiles, hot bins, or feeder belts	1 per project, per design	Sample in accordance with Tex-221-F.	
ASPHALT BINDER	Compliance with Item 300 (A)		Sampling port nearest the storage tank	1 per project, per grade, per source	<p>Test a minimum of one sample taken from the project. Sample binder in accordance with Tex-500-C, Part II.</p> <p>Verify that the binder is from a preapproved source when it arrives on the project, and that the lab number on the shipping ticket is within the valid dates shown on the MTD QM test report or in the SM Assistant.</p> <p>The Engineer must associate one QM sample, per project in SM.</p>	
TACK COAT	Compliance with Item 300 (A)		Distributor	1 per project, per grade, per source	<p>Test a minimum of one sample taken from the project. Sample tack coat in accordance with Tex-500-C, Part III.</p> <p>Verify that the binder is from a preapproved source when it arrives on the project, and that the lab number on the shipping ticket is within the valid dates shown on the MTD QM test report or in the SM Assistant.</p> <p>The Engineer must associate one QM sample, per project in SM.</p>	
MIX DESIGN	Compliance with applicable specification	Tex-204-F	At source (if not approved)	Min. 1 design per Mix Type and Asphalt Grade	Verify that aggregates, recycled asphalt pavement, recycled asphalt shingles, mineral filler, asphalt binder, anti-stripping additives, and warm mix systems are on the Material Producer List where applicable and that they meet project specification requirements. Project sampling and testing may be conducted in individual materials as necessary for control.	

This is a guide for minimum sampling and testing.
 Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VIII – HOT-MIX ASPHALT PAVEMENT (Item 340)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION	FREQUENCY	REMARKS
COMPLETE MIXTURE	Asphalt Content	Tex-236-F	Truck Sample (D)	Minimum of 1 per day	Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Voids in Mineral Aggregates (VMA)	Tex-204-F	Truck Sample Plant Produced (D)	1 per day	Sample in accordance with Tex-222-F.
	Gradation (A)	Tex-236-F	Truck Sample	Minimum 1 per day	Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Boil Test	Tex-530-C		1 per project	Sample in accordance with Tex-222-F, unless waived by the Engineer.
	Indirect Tensile Strength – Dry	Tex-226-F		1 per project, per design	Sample in accordance with Tex-222-F, unless waived by the Engineer.
	Lab Molded Density (A)	Tex-207-F	Truck Sample	1 per day	Sample in accordance with Tex-222-F.
	Hamburg Wheel Tracker (A)	Tex-242-F		1 per project	Sample in accordance with Tex-222-F. Sample during production.
ROADWAY	Air Voids (A)	Tex-207-F	Selected by the Engineer (D)	1 per day (2 Cores)	Sample in accordance with Tex-222-F.
	Ride Quality Test Type B (A)	Tex-1001-S	Final riding surface of travel lanes		Engineer may verify Contractor's results for surface test Type B. For traditional design-bid-build TxDOT projects, MTD has contracted with TTI to perform random ride verification at 10% frequency. Results from surface test Type A are not required to be reported.
FABRIC UNDERSEAL	Compliance with DMS-6220		Sampled, tested, and approved by MTD		Sample in accordance with Tex-735-I. Verify the source is listed on the current Material Producer List for Silt Fence, Filter Fabric, and Fabric Underseals. If not, sample and submit to MTD for testing before use in accordance with DMS-6220.

This is a guide for minimum sampling and testing.
Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE VIII – FOOTNOTES

A	When this project acceptance test fails, but the product is accepted, document the reasons for acceptance in SiteManager, in the remarks field, and on the end of the Project Materials Certification Letter.
B	Sampling may be performed at the plant, quarry, or both. Aggregate properties may be re-tested at any time during the project. These project tests may be used for one or more projects furnishing hot mix with the same aggregate source.
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
D	Perform random sampling as specified in Tex-225-F, “Random Selection of Bituminous Mixture Samples.”

This is a guide for minimum sampling and testing.
 Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IX – MICROSURFACING (Item 350)

			PROJECT TESTS		
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OF SAMPLING	FREQUENCY (Per Design)	REMARKS
AGGREGATE	Magnesium Soundness (A)	Tex-411-A	Stockpile (B)	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer list for BRSQC meets the project specifications. If not, sample in accordance with Tex-221-F and submit to MTD for testing at 1 per project, per source. (C)
	Gradation	Tex-200-F, Part II		1 per project, per source	Sample in accordance with Tex-221-F.
	Crushed Face Count	Tex-460-A		1 per project, per source	Sample in accordance with Tex-221-F.
	Acid Insoluble (A)	Tex-612-J		1 per project, per source	Verify the value of the source, as listed on the current BRSQC, meets the project specifications. If not, sample and submit to MTD for testing before use in accordance with Tex-499-A. Sample in accordance with Tex-221-F. (C)
	Surface Aggregate Classification	Tex-499-A	Stockpile, or BRSQC (B)	1 per project, per source	Verify the published value of the source, as listed on the current Material Producer list for BRSQC meets the project specifications. If not, sample in accordance with Tex-221-F and submit to MTD for testing at 1 per project, per source. (C)
COMBINED BLEND	Sand Equivalent	Tex-203-F	Stockpile (B)	1 per project, per source	Sample in accordance with Tex-221-F.
ASPHALT BINDER	Compliance with Item 300 (A)		Sampling port nearest the storage tank	1 per project, per grade, per source	<p>Test a minimum of one sample taken from the project. Sample binder in accordance with Tex-500-C, Part II.</p> <p>Verify that the binder is from a preapproved source when it arrives on the project, and that the lab number on the shipping ticket is within the valid dates shown on the MTD QM test report or in the SM Assistant.</p> <p>The Engineer must associate one QM sample, per project in SM.</p>
TACK COAT	Compliance with Item 300 (A)		Distributor	1 per project, per grade, per source	<p>Test a minimum of one sample taken from the project. Sample tack coat in accordance with Tex-500-C, Part III.</p> <p>Verify that the binder is from a preapproved source when it arrives on the project, and that the lab number on the shipping ticket is within the valid dates shown on the MTD QM test report or in the SM Assistant.</p> <p>The Engineer must associate one QM sample, per project in SM.</p>

This is a guide for minimum sampling and testing.
 Testing frequency may need to be increased for high material variability or when test results approach specification limits.

TABLE IX – MICROSURFACING (Item 350)

PROJECT TESTS					
MATERIAL OR PRODUCT	TEST FOR	TEST NUMBER	LOCATION OF SAMPLING	FREQUENCY (Per Design)	REMARKS
MIX DESIGN	Compliance with applicable specification	Tex-204-F	At source (if not approved)	Min. 1 design per project	Submit to MTD for approval.
CEMENT	Compliance with DMS-4600				Verify the source is listed on the current Material Producer List for Cement . If not, sample and submit to MTD for testing before use in accordance with DMS-4600.
COMPLETE MIX	Asphalt Content	Tex-236-F	During production	1 per day	Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven using Tex-236-F at a minimum of one per project.
	Gradation	Tex-200-F, Part II Tex-236-F			Sample in accordance with Tex-222-F. Determine correlation factors for ignition oven use at a minimum of one per project.

TABLE IX – FOOTNOTES

A	When this project acceptance test fails, but the product is accepted, document the reasons for acceptance in SiteManager, in the remarks field, and on the end of the Project Materials Certification Letter.
B	Sampling may be performed at the plant, quarry, or both. Aggregate properties may be re-tested at any time during the project. These project tests may be used for one or more projects furnishing hot mix with the same aggregate source.
C	Attach the corresponding QM test report for SiteManager projects to satisfy project sampling and testing requirements.
D	Each test performed, that is based on a quantity of material, is considered “or fraction thereof” for calculating number of tests.

PART D


GEO TECHNICAL REPORT OF EXISTING CONDITIONS

Geotechnical Engineering Report


ECR 120 (East)

Midland, Texas

December 4, 2019

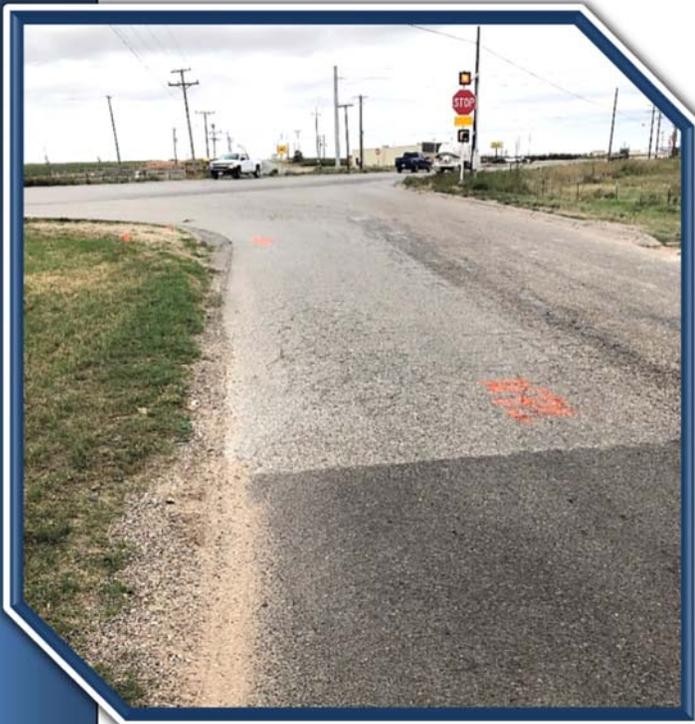

December 4, 2019



Jason Kelliher, P.E.
Discipline Lead
Dunaway Associates
4000 N. Big Spring, Suite 101
Midland, Texas 79705

**GEOTECHNICAL INVESTIGATION
D&S ENGINEERING #G19-2108-09
MIDLAND COUNTY ROADWAY IMPROVEMENTS
ECR 120 (EAST)
MIDLAND, TEXAS**

Mr. Kelliher,

As requested, D&S Engineering Labs, LLC (D&S) has completed the subsurface exploration and professional geotechnical engineering services for the referenced project. This investigation was conducted in accordance with Proposal No GP19-2108-9 dated August 4, 2019. Authorization to proceed was received on September 30, 2019.

We appreciate the opportunity to provide professional geotechnical engineering services to you. We are available to discuss any questions which may arise regarding this report. Please do not hesitate to call when we can provide any additional services.

Sincerely,

D&S Engineering Labs, LLC

A handwritten signature in blue ink, appearing to read 'Ibrahim'.

Ibrahim A. Baayeh, P.E.
Geotechnical Engineer

A circular professional engineer seal for the State of Texas, featuring a star in the center. The seal contains the text 'STATE OF TEXAS', 'MICHAEL T. TAYLOR', '87344', and 'LICENSED PROFESSIONAL ENGINEER'. A handwritten signature in blue ink is written over the seal, and the date '12-4-2019' is written to the right of the seal.

Michael T. Taylor, P.E.
Senior Geotechnical Engineer

TABLE OF CONTENTS

1.0 PROJECT DESCRIPTION 1

2.0 PURPOSE AND SCOPE 1

3.0 FIELD AND LABORATORY INVESTIGATION 2

 3.1 General 2

 3.2 Laboratory Testing 2

4.0 SITE CONDITIONS 3

 4.1 Stratigraphy 3

 4.2 Groundwater 4

5.0 ENGINEERING ANALYSIS 4

 5.1 Existing Flexible Base Assessment 4

6.0 PAVEMENT RECOMMENDATIONS 4

 6.1 General 4

 6.2 Behavior of Soils beneath Pavement 5

 6.3 Pavement Subgrade Preparation Recommendations 5

 6.3.1 Soil Preparation 6

 6.3.2 Cement Treatment Recommendations 7

 6.3.3 Aggregate Base 8

 6.4 Subgrade Strength Characteristics 8

 6.5 Pavement Design Assumptions 9

 6.6 Flexible Pavement Design and Recommendations 10

 6.7 Full Depth HMA 10

 6.8 HMA Installation and Testing 10

7.0 OTHER CONSTRUCTION 11

 7.1 Utility Lines and Culverts 11

 7.2 Surface Drainage 11

 7.3 Excavations and Excavation Difficulties 12

8.0 LIMITATIONS 13

APPENDIX A – BORING LOGS AND SUPPORTING DATA
APPENDIX B – GENERAL DESCRIPTION OF PROCEDURES

**GEOTECHNICAL INVESTIGATION
MIDLAND COUNTY ROADWAY IMPROVEMENTS
ECR 120 (EAST)
MIDLAND, TEXAS**

1.0 PROJECT DESCRIPTION

This report presents the results of the geotechnical investigation for planned pavement improvements along ECR 120 in Midland, Texas. The improvements will begin at State Highway 158 and will extend east approximately 7 miles (37,000 feet) to FM 1379. The existing road consists of an asphalt paved surface and is about 25 feet in width. We expect that new pavement grades will be within 12 inches of existing grades. Photographs of the recent site condition are presented below.



2.0 PURPOSE AND SCOPE

The purpose of this investigation was to:

- Identify the subsurface stratigraphy and groundwater conditions present at the site.
- Evaluate the physical and engineering properties of the subsurface soil strata for use in the geotechnical analyses.
- Provide geotechnical recommendations for use in design of the proposed pavement improvements.

The scope of this investigation included:

- Drilling and sampling a total of thirty-eight (38) borings along the alignments of ECR 120, at about 1,000-foot intervals.
- Obtaining samples of the underlying base materials and subgrade soils to depths of about 1.8 to 10 feet below existing grades.

- Laboratory testing of selected soil samples obtained during the field investigation.
- Preparation of a Geotechnical Report that includes:
 - Evaluation of existing aggregate base materials.
 - Recommendations for the design of pavements.
 - Recommendations for earthwork and subgrade modifications.

3.0 FIELD AND LABORATORY INVESTIGATION

3.1 General

Pavement cores were obtained at each boring utilizing portable electric coring equipment. Below the pavements, the borings were advanced using truck-mounted drilling equipment outfitted with solid continuous flight augers.

Soils were sampled in general accordance with the Standard Penetration Test (ASTM D1586). During this test, disturbed samples of subsurface material is recovered using a nominal 2-inch O.D. split-barrel sampler. The sampler is driven into the soil strata with an automatic hammer utilizing the energy equivalent of a 140-pound hammer falling freely from a height of 30 inches and striking an anvil located at the top of the drill string. The number of blows required to advance the sampler in three consecutive 6-inch increments is recorded, and the number of blows required for the final 12 inches is noted as the "N"-value. The test is terminated at the first occurrence of either of the following: 1) when the sampler has advanced a total of 18 inches; 2) When the sampler has advanced less than one complete 6-inch increment after 50 blows of the hammer; 3) when the total number of blows reaches 100; or 4) if there is no advancement of the sampler in any 10-blow interval.

All samples obtained were extruded in the field, placed in plastic bags to minimize changes in the natural moisture condition, labeled to indicate the appropriate boring number and depth, then placed in protective, cardboard boxes for transportation to the laboratory. The approximate locations of borings advanced at the site are shown on the boring location map included in Appendix A. The specific depths, thicknesses, and descriptions of the strata encountered are presented on the individual Boring Log illustrations, which are also provided in Appendix A. Strata boundaries shown on the boring logs are approximate.

3.2 Laboratory Testing

Laboratory tests were performed to identify the relevant engineering characteristics of the subsurface materials encountered and to provide data for developing engineering design parameters. The subsurface materials recovered during the field exploration were initially logged by the drill crew and were later described by a Staff Engineer in the laboratory. These descriptions were later refined by a Geotechnical Engineer based on results of the laboratory tests performed. All recovered soil

samples were classified and described in part using the Unified Soil Classification System (USCS) and other accepted procedures.

In order to determine soil characteristics and to aid in classifying the soils, index property and classification testing was performed on selected samples, as requested by the Geotechnical Engineer. These Index property and classification tests were performed in general accordance with the following ASTM testing standards:

- Moisture Content ASTM D2216
- Atterberg Limits ASTM D4318
- Percent of Particles Finer Than the No. 200 Sieve ASTM D1140

The results of the ASTM tests are presented at the corresponding sample depths on the appropriate Boring Log illustrations. The index property and classification testing procedures are also described in more detail in Appendix B (General Description of Procedures).

4.0 SITE CONDITIONS

4.1 Stratigraphy

Based upon a review of the samples recovered, along with the Geologic Atlas of Texas, Hobbs Sheet, this site is in an area underlain by soil strata associated with Quaternary Windblown cover sand that generally consists of silty quartz sand and caliche in dunes and dune ridges.

At the surface within all borings, asphalt pavements of thickness ranging from 0.5 to 2 inches are present. The asphalt section is underlain with base course material ranging in thickness from 0.5 to 14 inches within the borings.

Below the pavement sections within all borings, except Borings B8 and B16, native sand soils are present. The sand soils present are generally very loose to very dense in condition and are various shades of brown and red in color and contain varying amounts of clays, silts, gravel, calcareous nodules and deposits. The native sand soils extend to depths of about 4.5 to 9 feet within Borings B9, B15, B18, B24, B27, B30 and B33 and to maximum depths explored of about 4.5 to 10 feet within Borings B1 through B7, B10 through B14, B17, B19, B20, B22, B23, B26, B28, B29, B31, B32 and B34 through B38.

Below the pavement sections within Borings B8, B16, B17 and B21 and below the native sand soils within Borings B9, B15, B18, B24, B27, B30 and B33, materials locally referred to as "caliche" are present. The "caliche" materials are generally comprised of sand soils. The caliche sands are generally loose to dense in condition, are various shades of brown, red, white and pink in color. Varying amounts of clays, silts and gravels are present within the sand strata. The caliche sand soils extend to

the maximum depths explored of about 9.5 to 10 feet. Borings B8, B16, B21, B25 and B27 were terminated early due to the presence of a very hard layer that may be a caliche caprock at depths ranging from 1.8 to 7.5 feet below present grade.

Subsurface conditions at each boring location are described in detail on the individual boring log illustrations presented in Appendix A.

4.2 Groundwater

Groundwater seepage was not observed during drilling or upon completion of drilling within the borings performed at the site. Although not encountered, groundwater levels may be anticipated to fluctuate with seasonal and annual variations in rainfall and may also change as a result of local development.

5.0 ENGINEERING ANALYSIS

5.1 Existing Flexible Base Assessment

Wetball mill tests in general accordance with TxDOT TEX-116-E were not performed due to the base material being generally comprised of fine grained sands.

Considering the developed data and only if the roadway grades will be raised sufficiently to accommodate the required pavement section, we believe that the base materials present can serve as suitable contributory material for the new reconstructed roadway if the existing asphalt roadway surface is milled into the base materials and then treated with cement to form a stable platform that contributes to the structural capacity of the roadway and onto which the remainder of the roadway section can be constructed.

If grading constraints preclude the use of the existing roadway materials, the existing asphalt and base materials should be removed and replaced with appropriate materials as noted below to support the anticipated traffic loads.

6.0 PAVEMENT RECOMMENDATIONS

6.1 General

The pavement design recommendations provided here are derived from the subgrade information obtained during our geotechnical investigation, our experience with similar projects in this area, and from the guidelines and recommendations of the American Concrete Pavement Association (ACPA). WinPAS 12 software based on AASHTO 1993 from ACPA were used to develop the alternative suitable pavement sections, HMA.

The pavement section recommendations provided herein are based on the assumptions outlined. Should actual requirements or projections deviate from those

assumptions, a re-analysis may be necessary. Increased intensity and frequency of traffic loading will require more stringent design parameters than those provided herein. Prevailing local codes or ordinances may also be more stringent and should take precedence over the recommendations contained herein. It is the responsibility of the Civil Engineer of Record and/or other design professionals who are responsible for pavement design to seal the final pavement design plans and associated specifications for this project.

Proper drainage should be provided both during and after construction. Emphasis should be given to areas where the pavement is placed directly adjacent to intersecting roadways and drives. Pavements should include a regular maintenance schedule to identify and seal cracks that may develop in the pavement surface to prevent water passing through the asphalt to the base or subgrade materials.

6.2 Behavior of Soils beneath Pavement

Near-surface soils at this site are considered to have a low potential for volume change with changes in soil moisture content. However, increased moisture content can result in reduced soil stiffness. The moisture content can be “stabilized” to some degree in these soils by covering them with an impermeable surface, such as pavement. However, if moisture is introduced as a result of surface water percolation through pavement joints and cracks or poor drainage, the soil strength can reduce, causing distress to pavements as traffic passes over.

The edges of pavement are particularly prone to moisture variations, and so these areas therefore often experience the most distress. When cracks appear on the surface of the pavement, these openings can allow moisture to enter the pavement subgrade, which can lead to further weakening of the pavement section as well as accelerated failure of the pavement surface.

In order to minimize the potential impacts of moisture-induced weakened soil on paved areas and to improve the long-term performance of the pavement, we have the following recommendations:

- Provide a crowned pavement, which provides maximum drainage away from the roadway, with a minimum slope of five percent within the first 5 feet. Drainage ditches should be of sufficient size and capacity to prevent water from ponding at the edges of the road.
- Subgrade treatments intended to increase the subgrade stability should extend to at least 18-inches beyond the back of curbs or edges of pavements.

6.3 Pavement Subgrade Preparation Recommendations

The anticipated subgrade soils in the proposed paving areas will consist of clayey sand, silty clayey sand and silty sand. These soils can become weak with appreciable increases in moisture content. A commonly used method to improve the strength

properties of the subgrade soils, provide a working platform, and provide a uniform subgrade is to treat them with cement. Cement treatment is often used in conjunction with compacted aggregate base when appreciable or heavy traffic loading is anticipated, and/or to reduce the asphalt thickness.

The following recommendations discuss subgrade preparation and two subgrade preparation alternatives if the existing roadway and base materials will not be reclaimed and utilized in-place.

6.3.1 Soil Preparation

- Strip the sites of all asphalt and base under the planned paved areas.
- Cut as needed to required pavements subgrade elevation to accommodate the new roadway section.
- After stripping and performing any necessary cuts, the exposed subgrade should be proof rolled. Proof rolling should consist of rolling the entire pavement subgrade with a heavily-loaded, tandem-axle dump truck or fully loaded water truck weighing at least 25 tons or other approved equipment capable of applying similar loading conditions. Any soft, wet or weak soils that are observed to rut more than about 1/2-inch or pump excessively (exhibiting “waving” action) during proof rolling should be removed and replaced with well-compacted, on-site clayey material as outlined below. The proof rolling operation should be performed under the observation of a qualified geotechnical engineer.
- After proof rolling, scarify, rework, and recompact the exposed stripped subgrade to a minimum compacted depth of 6 inches. The scarified and reworked soils should be compacted to at least 95 percent of the maximum dry density, as determined by ASTM D698 (standard Proctor), and placed at a moisture content that is within two percentage points of the optimum moisture content, as determined by the same test ($\pm 2\%$). In areas that require fill, the fill should be placed in maximum 6 inch compacted lifts, compacted to at least 95 percent of the maximum dry density, as determined by ASTM D698 (standard Proctor), and placed at a moisture content within two percentage points of the optimum moisture content, as determined by the same test ($\pm 2\%$). Fill materials may be derived from on-site, or may be imported as long as the materials are essentially free of organic materials and particles in excess of 4 inches their maximum dimension. Imported fill materials should have no less than 35 percent material passing a No. 200 mesh sieve and a Plasticity Index of no more than 30.
- Water should not be allowed to pond on the prepared surface once the subgrade soil has been brought to required grade. To that end, the

subgrade surface should be shaped in a way that will allow water to shed to one or both edges of the prepared subgrade.

- Field density and moisture content testing should be performed at the rate of one test per lift per 300 linear feet of roadway.
- Surface grading adjacent to the edges of pavements should be sloped away from the edges to the maximum degree possible. Where minimum recommended slopes of adjacent surface grades cannot be achieved, the edges of the pavement section should be thickened a minimum of 2-feet wide along each edge.

6.3.2 Cement Treatment Recommendations

Once the subgrade is brought to required subgrade elevation, cement treatment may begin to achieve a treated compacted depth of 6-inches. We have the following recommendations for subgrade cement treatment:

- Cement treated subgrade should be prepared in accordance with TxDOT Item 275 to the elevations shown on the plans using an estimated three (3) percent cement by dry weight measure of the subgrade soil. The actual percentage to be used should be determined once the subgrade is at rough grade elevation. The amount of cement used should be the minimum amount required to achieve a 7-day cured unconfined compressive strength of 100 pounds per square inch.
- Cement should be applied such that mixing operations for a given area can be completed during the same working day.
- The cement may be placed dry or by the slurry method (meaning that the cement should be mixed with water in trucks or in tanks and applied as a thin slurry).
- After mixing, the soil-cement mixture should be tested for sufficient pulverization and mixing in accordance with TxDOT Item 275. The mixed material should meet the following requirements when tested dry by laboratory sieves:
 - Minimum passing 1 $\frac{3}{4}$ " sieve: 100%
 - Minimum passing $\frac{3}{4}$ " sieve: 85%
 - Minimum passing No. 4 sieve: 60%
- After sufficient re-mixing, the soil/cement mixture (or milled asphalt and base, if reclaiming those materials) should be compacted to a minimum of 95% of Standard Proctor (ASTM D698) and to a moisture content that is at or above the optimum moisture, as determined by that same test.

Compaction should be completed within 2 hours after the application of water to the mixture of soil and cement.

- Cure for at least 3 days by “sprinkling” as described in TxDOT Item 204.
- To reduce the potential for subgrade soil moisture changes at the edges of pavements, the cement stabilized subgrade should extend a minimum of 18-inches past the back of the roadway curbs or edges of pavements.
- In order to reduce the potential for reflective cracking up through the pavement, particularly with asphalt pavement, the cement treated subgrade should be rolled with a vibratory roller 1 to 2 days after final compaction to create a network of hairline cracks (microcracking). Cure for at least 2 days by “sprinkling” as described in TxDOT Item 204 after completion of microcracking.
- Field density and moisture content testing should be performed at the rate of one test per lift per 100 linear feet of roadway. These tests are necessary to determine if the recommended moisture and compaction requirements have been attained.

6.3.3 Aggregate Base

As an alternative to, or in conjunction with, cement treatment, aggregate base may be placed over the prepared subgrades in accordance with the following recommendations prior to placing the pavements.

- After completing the subgrade preparation, place aggregate base as required in maximum 4 to 6-inch thick compacted lifts. The area of the aggregate base should extend a minimum of 18-inches beyond the edges of the pavement.
- Aggregate base, should be TxDOT Type A or D and meet the gradation, durability and plasticity requirements of TxDOT Item 247 Grade 1-2 or better (2014). The aggregate base material should be uniformly compacted to a minimum of 98% of the maximum standard Proctor dry density (ASTM D698) and placed at a moisture content that is sufficient to achieve density, but with a minimum of 4% moisture.
- Field density and moisture content testing should be performed at the rate of one test per 300 linear feet of roadway (approximately one test every 10,000 to 12,000 square feet).

6.4 Subgrade Strength Characteristics

Based on the present information, we recommend that a California Bearing Ratio (CBR) value of 8 be used in the design with a corresponding resilient modulus of

8,000 psi. These values were selected considering that clayey sands and silty clayey sands are projected to be present at final subgrade elevation within a significant length of the roadway alignment, and that these materials have a lower stiffness than the silty sands that are expected to be present on the remaining length of the proposed roadway improvements.

6.5 Pavement Design Assumptions

Specific axle loading and traffic volume characteristics have not been provided at this time. After reviewing available traffic counts for ECR 120 roadway using TXDOT District Traffic Web Viewer 2017 GIS data, the average daily traffic (ADT) along the roadway is 1,555, 1,771, 1,870 and 2,360 vehicles per day. As there is close agreement within the traffic counts we have concentrated our pavement recommendations based on an ADT of 2,500. If the actual number of ADT differs significantly from our assumptions, we recommend a separate analysis and pavement sections recommendations be performed.

- Design Life: 15 years
- Average Daily Traffic (ADT): 2,500
- Equivalent Single Axle Loads (ESAL's): 670,660
- Directional Distribution Factor: 50%
- Design Lane Distribution Factor: 100%
- Growth Rate: 2.0%
- Percent Trucks: 5.0%
- Truck Factor (ESALs/Truck): 1.7
- Initial Serviceability: 4.2
- Terminal Serviceability: 2.25

Considering that ECR 120 is somewhat a rural collector roadway, we have assumed a reliability factor of 75%. If a higher value of reliability is required, the overall section will increase. Please contact this office if significant deviations from the assumptions above are anticipated.

In determination of roadway section alternatives, we used WinPAS 12 software and the following assumptions were made.

- Reliability: 75%
- Overall Standard Deviation: 0.45
- Subgrade Resilient Modulus: 8,000 psi
- Drainage Coefficient: 1.0

- Layer coefficient, Asphalt Cement Concrete: 0.44
- Layer coefficient, Soil Cement or Cement treated reclaimed pavement: 0.20
- Layer coefficient, Aggregate Base : 0.14

Minimizing subgrade saturation is an important factor in maintaining subgrade strength. Water should not be allowed to pond on or adjacent to the pavement that could saturate the pavement and lead to premature pavement deterioration. We recommend that all pavement surfaces be sloped to provide rapid surface drainage. Positive surface drainage away from the edge of the paved areas should be maintained.

6.6 Flexible Pavement Design and Recommendations

Flexible pavement surface course should conform to TxDOT Item 341 – “Dense-graded Hot Mix Asphalt” (HMA), or TxDOT Item 340 “Dense-graded Hot Mix Asphalt” (Small Quantity). The following subparagraphs provide recommendations for HMA based on the design assumptions noted previously. Actual loading conditions may require modifications.

6.7 Full Depth HMA

Full-depth HMA may consist of at least 1.5 inches of Type C or D surface course over 2 inches of Type B base course as specified by TxDOT Item 341 (or Item 340 as appropriate), or be entirely comprised of the surface course. Alternative options for flexible pavement sections are included in Table 1, and are based on the subgrade CBR (8) and modulus (8,000) values noted above.

Table 1. Alternative Flexible Pavement Sections for ADT = 2,500

Material Types	Based on Above Assumed Design Criteria			
	Alternative 1 (Utilize Existing Roadway Materials RAP)	Alternative 2 (Remove and Replace Existing Roadway Materials)		
HMAC (in.)	3	3	3	4.5
Aggregate base (in.)	4	4	11	6
Cement-treated soil or milled pavement materials (in.)	5	5	--	--

6.8 HMA Installation and Testing

The following is recommended for HMA:

- HMAC should be placed and compacted to contain between 5 and 9 percent of air voids.

- The target density for asphalt lifts should be 91 to 95 percent of the Maximum Theoretical Specific Gravity as determined by laboratory testing.

The following tests should be performed:

- In place field density tests to establish a rolling pattern.
- One extraction and gradation test per day's HMAC placement.
- Two cores to verify thickness and density per 5,000 feet of roadway placed.

7.0 OTHER CONSTRUCTION

7.1 Utility Lines and Culverts

Backfill placed within utility/culvert trenches that cross pavements should be properly compacted. If these areas are not properly compacted, settlement will occur and distress to the pavement is likely. All backfill should be placed in lifts, properly compacted and tested in accordance to the appropriate earthwork recommendations provided.

Trenches should be opened a sufficient width to safely allow compaction equipment access to the backfill and for confirmation testing to occur. The backfill should be placed in horizontal lifts. Excavations greater than 5 feet in height/depth should be in accordance with OSHA 29CFR 1926, Subpart P. The site soils should be assumed to be Type "C" soil.

Backfill for utility lines should consist of on-site material and should be placed in accordance with the following recommendations. The on-site fill soil should be placed in maximum 6-inch compacted lifts, compacted to a minimum of 95 percent of the maximum dry density, as determined by ASTM D698 (standard Proctor), and placed at a moisture content that is at least the optimum moisture content, as determined by that same test. We also recommend that the utility trenches be visually inspected during the excavation process to ensure that undesirable fill that was not detected by the test borings does not exist at the site. This office should be notified immediately if any such fill is detected.

Utility excavations should be sloped so that water within excavations will flow to a low point away from the active construction where it can be removed from before backfilling. Compaction of bedding material should not be water-jetted. Compacted backfill above the utilities should be on-site clayey soils to limit the percolation of surface water.

7.2 Surface Drainage

Proper drainage is critical to the performance of the paved areas. Positive surface drainage should be provided that directs water away from pavements edges. Where

possible, we recommend that a slope of at least 5 percent be provided for the first 5 feet away from pavement edges. The slopes should direct water away from the pavement and should be maintained throughout construction and the life of the pavement.

7.3 Excavations and Excavation Difficulties

Excavations greater than 5 feet in height/depth should be in accordance with OSHA 29CFR 1926, Subpart P. Temporary construction slopes should incorporate excavation protection systems or should be sloped back.

Excavations performed during utility construction operations in soil should not be difficult and should not require the use of special construction equipment. However, Borings B8, B16, B21, B25 and B27 were terminated early due to the presence of a very hard layer that may be a caliche caprock at depths ranging from 1.8 to 7.5 feet below present grade. In order to determine the nature of the hard layer a test pit may need to be excavated.

If very hard material is encountered such as a caliche caprock layer, appropriate hard rock excavation equipment will be required. Such heavy equipment should be of a sufficient size and weight to excavate through the hard layers to reach the desired bearing stratum. These bedrock materials can typically be excavated with backhoes/track-hoes equipped with rock teeth, single tooth rippers and hydraulic impact hammers. Where it is desired to maintain close excavations tolerances in the bedrock, trenching machines, rock wheel excavators should also be considered. Another method commonly used for excavations into bedrock is closely spaced, small-diameter holes drilled typically by air-rotary methods along an excavation line (commonly referred to as "line-drilling"). This line drilling creates a preferred plane of weakness for subsequent excavation. The excavated rock surface is expected to be irregular. Over breaks in the rock should also be expected. Loose rock fragments should be removed from the exposed face of rock cuts. Any rock faces, which could be subject to spalling identified by the competent person, should be covered with metal chain link, welded wire mesh, or other suitable covering to avoid rock spalls. Rock bolts/anchors may also be used at approximately 4 to 5 foot centers. Surface water should be diverted away from excavations.

Overburden soils above the bedrock will need to be sloped at 1.5H:1V or flatter. A minimum 2-foot wide bench should be required at the base of the overburden soils, at the top of the bedrock. The bedrock can very likely be cut in the range 0.75H:1V to 0.5H:1V. As excavation proceeds through the bedrock, the surface of the exposed bedrock should be carefully examined by the competent person for weakening due to weather exposure, joints and fractures, seepage, or other planes of weakness and the slope should be flattened or shored as required

Analyses of slope or trench wall stability in excavations are beyond the scope of this study and have not been performed. In all cases, the requirements of the

Occupational Safety and Health Administration (OSHA) must be followed by the contractor. It is important for the contractor to monitor the slope and pit wall stability by observation and measurements, and to prevent excessive loads (especially heavy vibratory loads) from being applied to the slope. The contractor should be responsible for maintaining the slopes and pit walls in a safe condition during construction. A qualified geotechnical engineer or geotechnical representative should be present to monitor all foundation excavations and fill placement. D&S would be pleased to provide these services in support of this project.

8.0 LIMITATIONS

The professional geotechnical engineering services performed for this project, the findings obtained, and the recommendations prepared were accomplished in accordance with currently accepted geotechnical engineering principles and practices.

Variations in the subsurface conditions are noted at the specific boring locations for this study. As such, all users of this report should be aware that differences in depths and thicknesses of strata encountered can vary between the boring locations. Statements in the report as to subsurface conditions across the site are extrapolated from the data obtained at the specific boring locations. The number and spacing of the exploration borings were chosen to obtain geotechnical information for the design and construction of pavements. If there are any conditions differing significantly from those described herein, D&S should be notified to re-evaluate the recommendations contained in this report.


Recommendations contained herein are not considered applicable for an indefinite period of time. Our office must be contacted to re-evaluate the contents of this report if construction does not begin within a one-year period after completion of this report.

The scope of services provided herein does not include an environmental assessment of the site or preliminary investigation for the presence or absence of hazardous materials in the soil, surface water, or groundwater.

All contractors referring to this geotechnical report should draw their own conclusions regarding excavations, construction, etc. for bidding purposes. D&S is not responsible for conclusions, opinions or recommendations made by others based on these data. The report is intended to guide preparation of project specifications and should not be used as a substitute for the project specifications.

Recommendations provided in this report are based on our understanding of information provided by the Client to us regarding the scope of work for this project. If the Client notes any differences, our office should be contacted immediately since this may materially alter the recommendations.

APPENDIX A - BORING LOGS AND SUPPORTING DATA

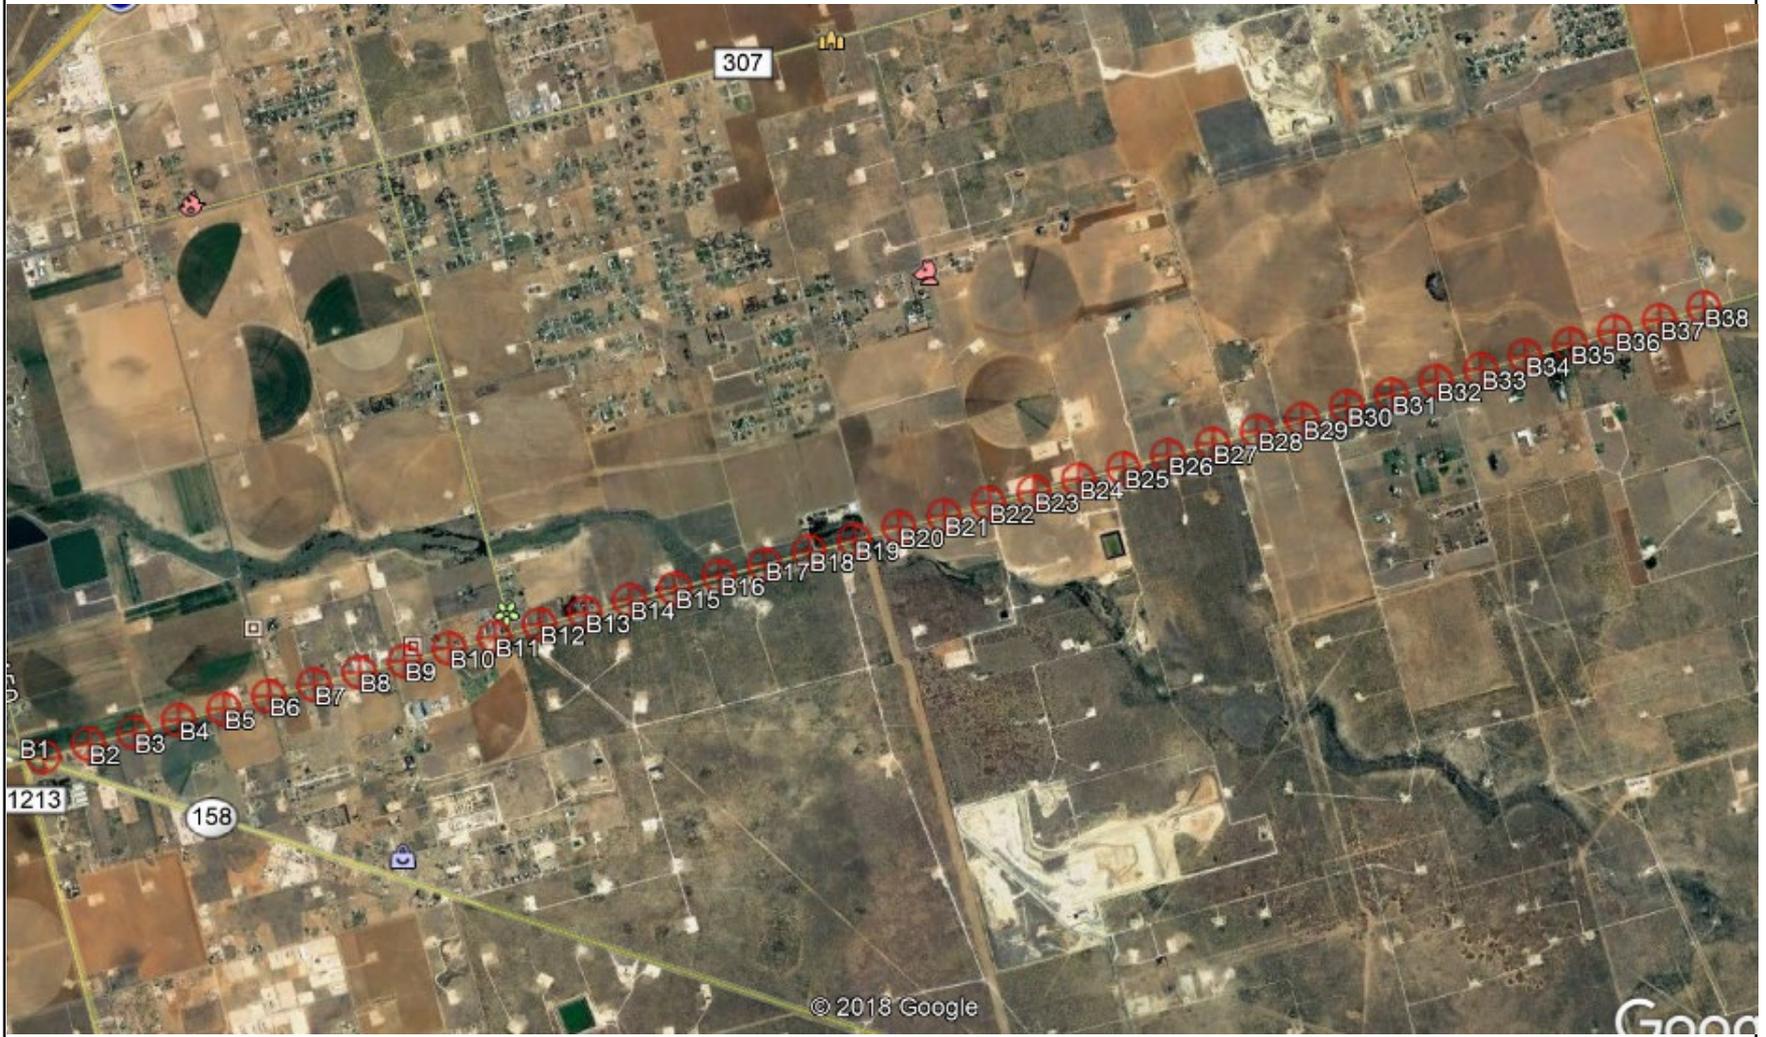

****BORING LOCATIONS ARE INTENDED FOR GRAPHICAL REFERENCE ONLY****



MIDLAND

PLAN OF BORINGS
EAST COUNTY ROAD 120

TEXAS

SHEET NO.

G1

DATE DRILLED
 October 16-26, 2019



BORING LOCATIONS ARE INTENDED FOR GRAPHICAL REFERENCE ONLY



MIDLAND

PLAN OF BORINGS
EAST COUNTY ROAD 120

TEXAS

SHEET NO.
G2

DATE DRILLED
October 16-26, 2019



****BORING LOCATIONS ARE INTENDED FOR GRAPHICAL REFERENCE ONLY****




MIDLAND

PLAN OF BORINGS
EAST COUNTY ROAD 120

TEXAS

SHEET NO.
G3

DATE DRILLED
October 16-26, 2019

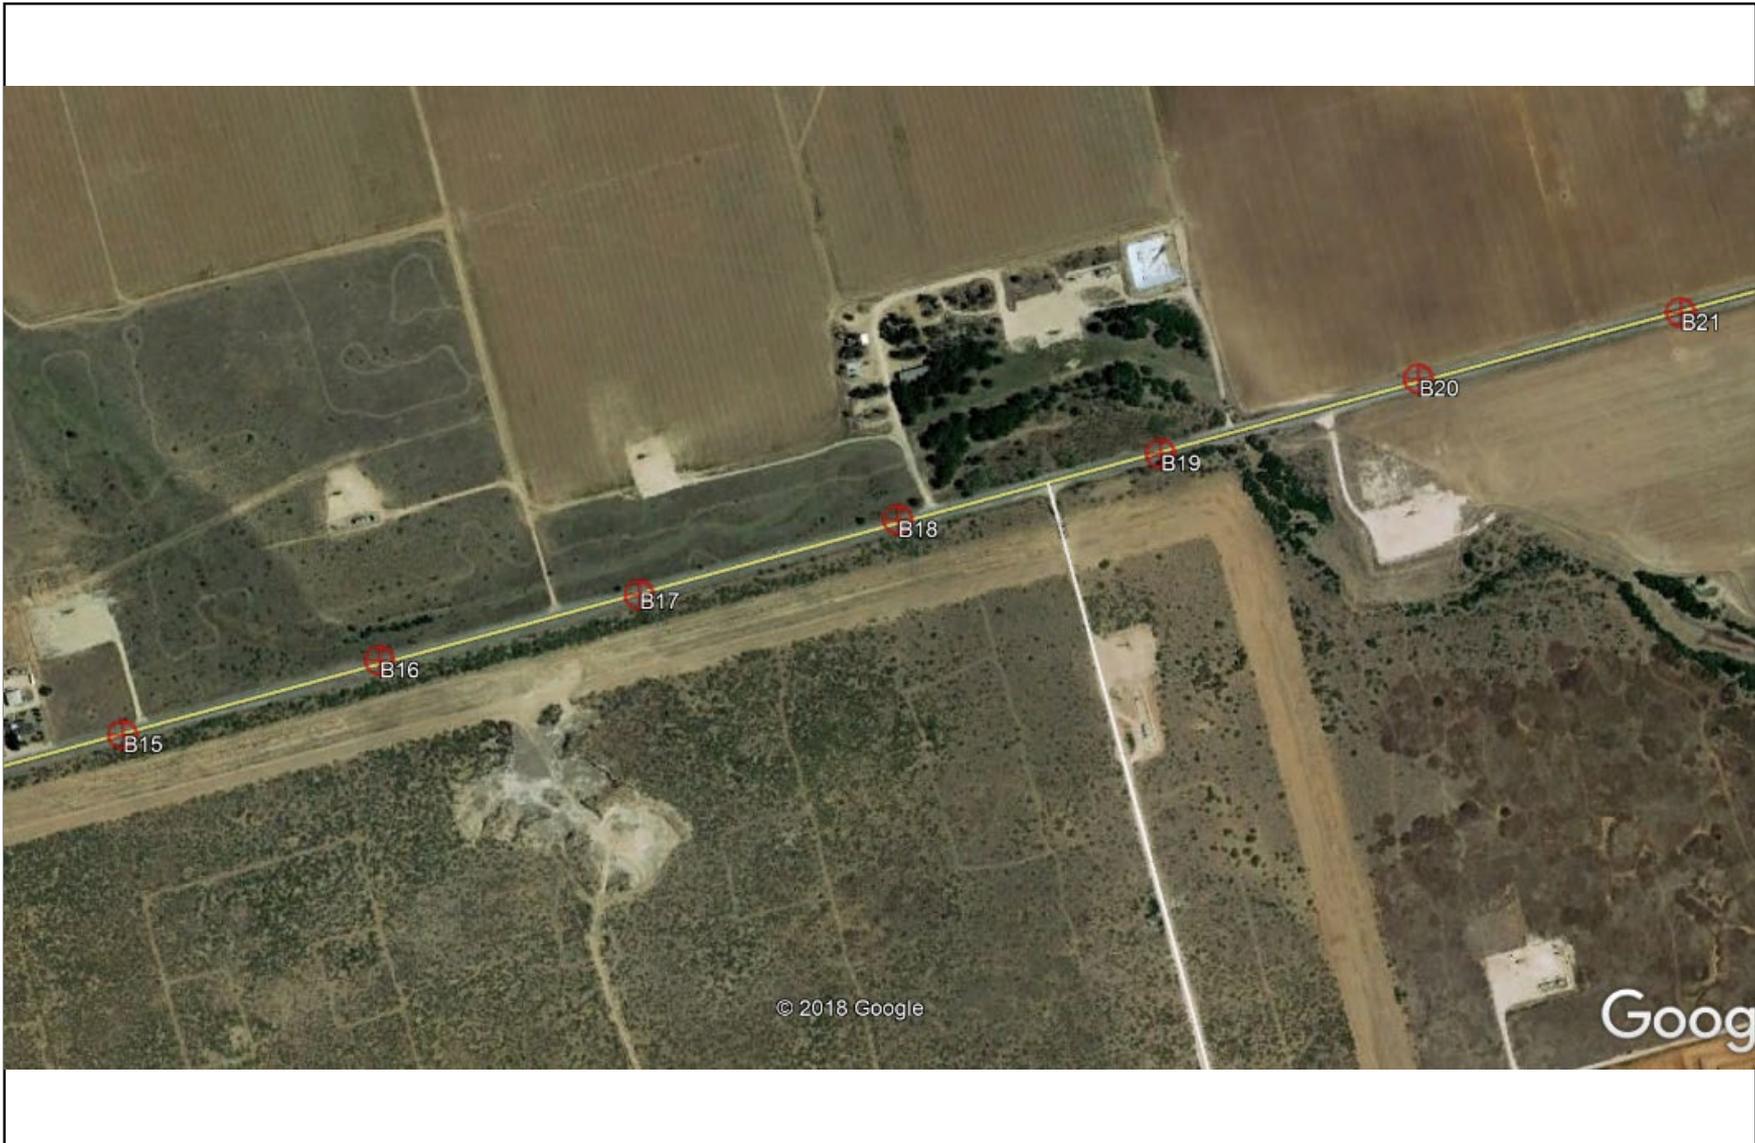

****BORING LOCATIONS ARE INTENDED FOR GRAPHICAL REFERENCE ONLY****



MIDLAND

PLAN OF BORINGS
EAST COUNTY ROAD 120

TEXAS

SHEET NO.
G4

DATE DRILLED
October 16-26, 2019



****BORING LOCATIONS ARE INTENDED FOR GRAPHICAL REFERENCE ONLY****




MIDLAND

PLAN OF BORINGS
EAST COUNTY ROAD 120

TEXAS

SHEET NO.
G5

DATE DRILLED
October 16-26, 2019

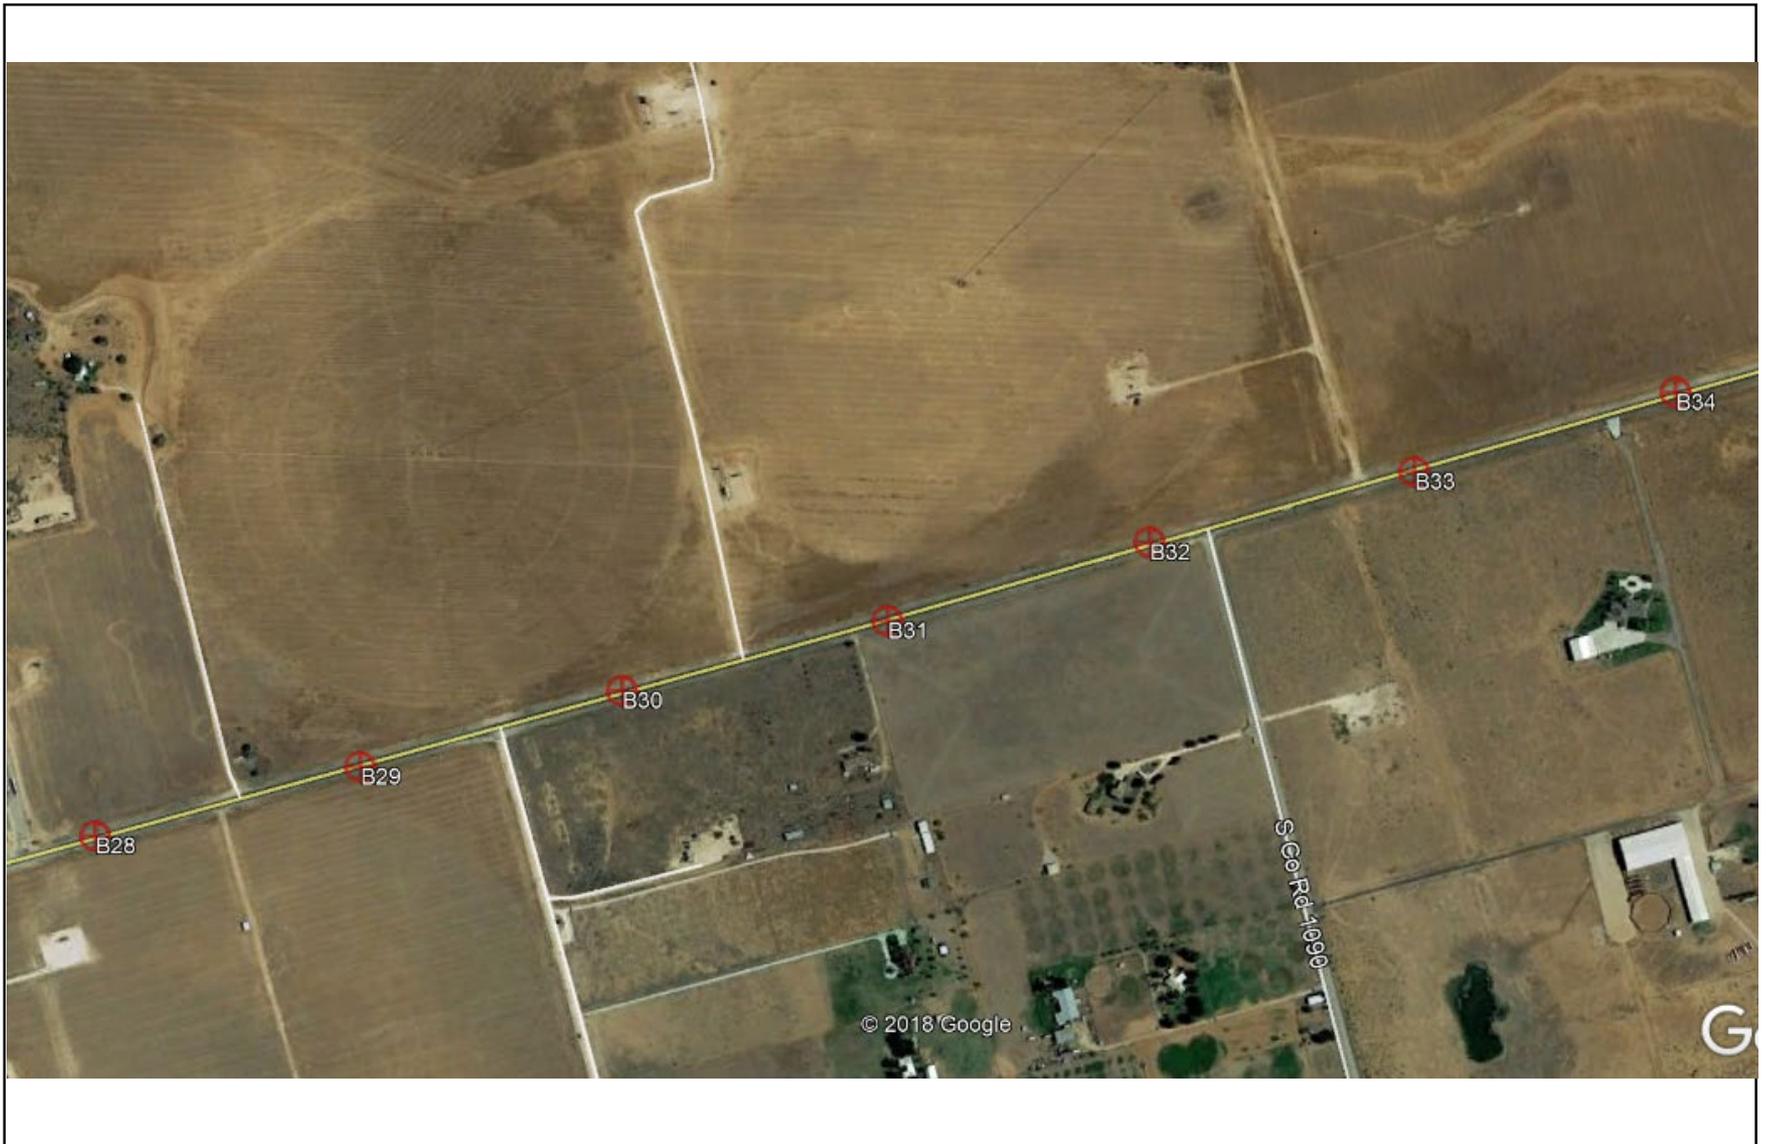

BORING LOCATIONS ARE INTENDED FOR GRAPHICAL REFERENCE ONLY



MIDLAND

PLAN OF BORINGS
EAST COUNTY ROAD 120

TEXAS

SHEET NO.
G6

DATE DRILLED
October 16-26, 2019



BORING LOCATIONS ARE INTENDED FOR GRAPHICAL REFERENCE ONLY



MIDLAND

PLAN OF BORINGS
EAST COUNTY ROAD 120

TEXAS

SHEET NO.

G7

DATE DRILLED
October 16-26, 2019

LITHOLOGIC SYMBOLS

ARTIFICIAL		Asphalt
		Aggregate Base
		Concrete
		Fill

SOIL		CH: High Plasticity Clay
		CL: Low Plasticity Clay
		GP: Poorly-graded Gravel
		GW: Well-graded Gravel
		SC: Clayey Sand
		SP: Poorly-graded Sand
	SW: Well-graded Sand	

ROCK		Limestone
		Mudstone
		Shale
		Sandstone
		Weathered Limestone
		Weathered Shale
		Weathered Sandstone

CONSISTENCY OF SOILS

CONSISTENCY: FINE GRAINED SOILS		
Consistency	SPT (# blows/ft)	UCS (tsf)
Very Soft	0 - 2	< 0.25
Soft	3 - 4	0.25 - 0.5
Medium Stiff	5 - 8	0.5 - 1.0
Stiff	9 - 15	1.0 - 2.0
Very Stiff	16 - 30	2.0 - 4.0
Hard	> 30	> 4.0

CONDITION OF SOILS

CONDITION: COARSE GRAINED SOILS			
Condition	SPT (# blows/ft)	TCP (#blows/ft)	Relative Density (%)
Very Loose	0 - 4	< 8	0 - 15
Loose	5 - 10	8 - 20	15 - 35
Medium Dense	11 - 30	20 - 60	35 - 65
Dense	31 - 50	60 - 100	65 - 85
Very Dense	> 50	> 100	85 - 100

SECONDARY COMPONENTS

QUANTITY DESCRIPTORS	
Trace	< 5% of sample
Few	5% to 10%
Little	10% to 25%
Some	25% to 35%
With	> 35%

RELATIVE HARDNESS OF ROCK MASS

Designation	Description
Very Soft	Can be carved with a knife. Can be excavated readily with point of pick. Pieces 1" or more in thickness can be broken by finger pressure. Readily scratched with fingernail.
Soft	Can be gouged or grooved readily with knife or pick point. Can be excavated in chips to pieces several inches in size by moderate blows with the pick point. Small, thin pieces can be broken by finger pressure.
Medium Hard	Can be grooved or gouged 1/4" deep by firm pressure on knife or pick point. Can be excavated in small chips to pieces about 1" maximum size by hard blows with the point of a pick.
Moderately Hard	Can be scratched with knife or pick. Gouges or grooves 1/4" deep can be excavated by hard blow of the point of a pick. Hand specimens can be detached by a moderate blow.
Hard	Can be scratched with knife or pick only with difficulty. Hard blow of hammer required to detach a hand specimen.
Very Hard	Cannot be scratched with knife or sharp pick. Breaking of hand specimens requires several hard blows from a hammer or pick.

WEATHERING OF ROCK MASS

Designation	Description
Fresh	No visible sign of weathering
Slightly weathered	Penetrative weathering on open discontinuity surfaces, but only slight weathering of rock material
Moderately weathered	Weathering extends throughout rock mass, but the rock material is not friable
Highly weathered	Weathering extends throughout rock mass, and the rock material is partly friable
Completely weathered	Rock is wholly decomposed and in a friable condition but the rock texture and structure are preserved
Residual Soil	A soil material with the original texture, structure, and mineralogy of the rock completely destroyed




UNIFIED SOIL CLASSIFICATION SYSTEM

ADAPTED FROM ASTM D 2487

SOIL CLASSIFICATION CHART

MAJOR DIVISIONS				GROUP SYMBOL	GROUP NAME
COARSE GRAINED SOILS	GRAVELS MORE THAN 50% OF COARSE FRACTION RETAINED ON NO. 4 SIEVE	CLEAN GRAVELS (LESS THAN 5% FINES)	$Cu \geq 4$ and $1 \leq Cc \leq 3$	GW	WELL-GRADED GRAVEL
			$Cu < 4$ and/or $[Cc < 1$ or $Cc > 3]$	GP	POORLY-GRADED GRAVEL
		GRAVELS WITH FINES (MORE THAN 12% FINES)	Fines classify as ML or MH	GM	SILTY GRAVEL
			Fines classify as CL or CH	GC	CLAYEY GRAVEL
	SANDS MORE THAN 50% OF COARSE FRACTION PASSING THE NO. 4 SIEVE	CLEAN SANDS (LESS THAN 5% FINES)	$Cu \geq 6$ and $1 \leq Cc \leq 3$	SW	WELL-GRADED SAND
			$Cu < 6$ and/or $[Cc < 1$ or $Cc > 3]$	SP	POORLY-GRADED SAND
FINE GRAINED SOILS	SILTS AND CLAYS LIQUID LIMIT LESS THAN 50	INORGANIC	PI > 7 and plots on or above "A" line	CL	LEAN CLAY
			PI < 4 or plots below "A" line	ML	SILT
		ORGANIC	$\frac{\text{Liquid limit} - \text{oven dried}}{\text{Liquid limit} - \text{not dried}} < 0.75$	OL	ORGANIC CLAY ORGANIC SILT
	SILTS AND CLAYS LIQUID LIMIT GREATER THAN 50	INORGANIC	PI plots on or above "A" line	CH	FAT CLAY
			PI plots below "A" line	MH	ELASTIC SILT
		ORGANIC	$\frac{\text{Liquid limit} - \text{oven dried}}{\text{Liquid limit} - \text{not dried}} < 0.75$	OH	ORGANIC CLAY ORGANIC SILT
HIGHLY ORGANIC SOILS	PRIMARILY ORGANIC MATTER, DARK IN COLOR, AND ORGANIC ODOR			PT	PEAT

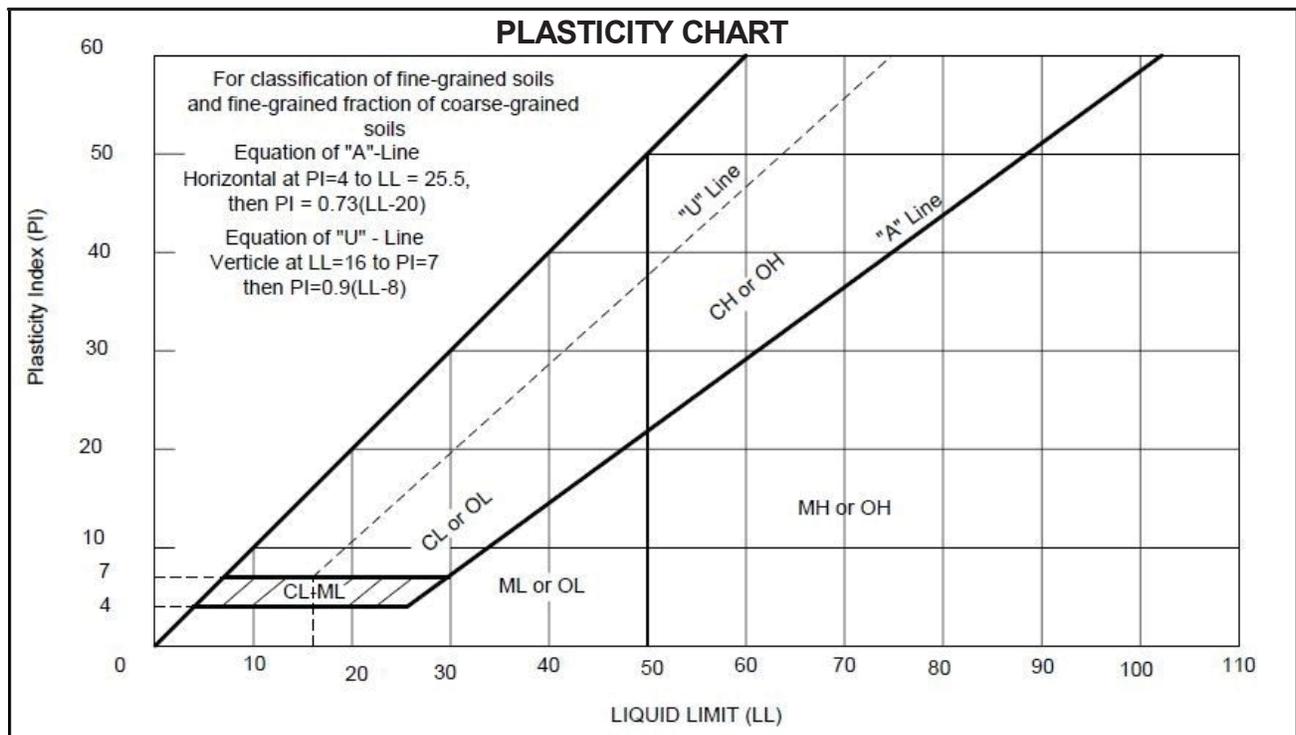



BORING LOG

B22

PAGE 1 OF 1

PROJECT: ECR 120 (East)	LOCATION: Midland, Texas
CLIENT: Dunaway Associates	GPS COORDINATES: N31.987823, W101.936697
PROJECT NUMBER: G19-2108-9	GROUND ELEVATION:
START DATE: 10/23/2019 FINISH DATE: 10/23/2019	DRILL METHOD: Cont. Flight Auger
LOGGED BY: Dalton Hubbard (D&S)	DRILLED BY: Jeffery Shaver (D&S)

Depth (ft)	Sample Type	Hand Pen. (tsf) or SPT or TCP	Graphic Log	Legend: <input type="checkbox"/> S-Shelby Tube <input type="checkbox"/> N-Standard Penetration <input type="checkbox"/> T-Texas Cone Penetration <input type="checkbox"/> C-Core <input type="checkbox"/> B-Bag Sample <input type="checkbox"/> - Water Encountered	REC (%) RQD (%)	MC (%)	Atterberg Limits			Passing #200 Sieve (%)	Total Suction (pF)	Clay (%)	Swell (%)	DUW (pcf)	Unconf. Compr. Str (ksf)
							LL (%)	PL (%)	PI						
0															
				ASPHALT ; 0.5 inches											
				BASE ; 14 inches											
	N	10,8,7		SILTY SAND (SM) ; medium dense; brown, reddish brown		5.8	16	13	3	24					
	N	7,7,8				7.7									
5				End of boring at 4.5'											
10															
15															
20															
25															
30															
35															

Notes:
 -dry during drilling
 -dry upon completion



**ECR 120 (East) – Midland, TX
Project No. G19-2108-9
Pavement Summary Table**

Boring	Latitude	Longitude	Asphalt thickness (inches)	Base thickness (inches)
B1	N31.972729	W102.001958	2	8
B2	N31.973494	W101.998864	0.5	3
B3	N31.974165	W101.995733	2	2
B4	N31.974912	W101.992658	1	3
B5	N31.975579	W101.989535	0.5	6
B6	N31.976334	W101.986441	0.5	2
B7	N31.977007	W101.983317	0.5	9
B8	N31.977766	W101.980209	0.5	3
B9	N31.978421	W101.977089	1	1.5
B10	N31.979176	W101.973994	1	3
B11	N31.979841	W101.970861	2	2
B12	N31.980599	W101.967763	1	3
B13	N31.981287	W101.964635	1	3
B14	N31.982044	W101.961547	1	2.5
B15	N31.982734	W101.958419	2	4
B16	N31.983498	W101.955342	1	4
B17	N31.984177	W101.952217	2	6
B18	N31.984944	W101.949132	1	9
B19	N31.985622	W101.945997	1	11
B20	N31.986389	W101.942917	0.5	5
B21	N31.987069	W101.939785	1	4
B22	N31.987823	W101.936697	0.5	14
B23	N31.988490	W101.933562	0.5	3
B24	N31.989234	W101.930473	0.5	7
B25	N31.989900	W101.927354	0.5	7



ECR 120 (East) – Midland, TX
Project No. G19-2108-9
Pavement Summary Table

Boring	Latitude	Longitude	Asphalt thickness (inches)	Base thickness (inches)
B26	N31.990656	W101.924271	0.5	5
B27	N31.991352	W101.921161	0.5	10
B28	N31.992111	W101.918066	0.5	7
B29	N31.992811	W101.914945	0.5	0.5
B30	N31.993582	W101.911865	0.5	4
B31	N31.994287	W101.908743	0.5	10
B32	N31.995079	W101.905661	0.5	4
B33	N31.995793	W101.902547	0.5	10
B34	N31.996596	W101.899475	1	8
B35	N31.997296	W101.896346	0.5	8
B36	N31.998067	W101.893248	1	4
B37	N31.998737	W101.890120	1	5
B38	N31.999505	W101.887020	0.5	4

APPENDIX B - GENERAL DESCRIPTION OF PROCEDURES

ANALYTICAL METHODS TO PREDICT MOVEMENT

INDEX PROPERTY AND CLASSIFICATION TESTING

Classification testing is perhaps the most basic, yet fundamental tool available for predicting potential movements of clay soils. Classification testing typically consists of moisture content, Atterberg Limits, and Grain-size distribution determinations. From these results a general assessment of a soil's propensity for volume change with changes in soil moisture content can be made.

Moisture Content

By studying the moisture content of the soils at varying depths and comparing them with the results of Atterberg Limits, one can estimate a rough order of magnitude of potential soil movement at various moisture contents, as well as movements with moisture changes. These tests are typically performed in accordance with ASTM D2216.

Atterberg Limits

Atterberg limits determine the liquid limit (LL), plastic limit (PL), and plasticity index (PI) of a soil. The liquid limit is the moisture content at which a soil begins to behave as a viscous fluid. The plastic limit is the moisture content at which a soil becomes workable like putty, and at which a clay soil begins to crumble when rolled into a thin thread (1/8" diameter). The PI is the numerical difference between the moisture constants at the liquid limit and the plastic limit. This test is typically performed in accordance with ASTM D4318.

Clay mineralogy and the particle size influence the Atterberg Limits values, with certain minerals (e.g., montmorillonite) and smaller particle sizes having higher PI values, and therefore higher movement potential.

A soil with a PI below about 15 to 18 is considered to be generally stable and should not experience significant movement with changes in moisture content. Soils with a PI above about 30 to 35 are considered to be highly active and may exhibit considerable movement with changes in moisture content.

Fat clays with very high liquid limits, weakly cemented sandy clays, or silty clays are examples of soils in which it can be difficult to predict movement from classification testing alone.

Grain-size Distribution

The simplest grain-size distribution test involves washing a soil specimen over the No. 200 mesh sieve with an opening size of 0.075 mm (ASTM D1140). This particle size has been defined by the engineering community as the demarcation between coarse-grained and fine-grained soils. Particles smaller than this size can be further distinguished between silt-size and clay-size particles by use of a Hydrometer test (ASTM D422). A more complete grain-size distribution test that uses sieves to relative amount of particles according is the Sieve Gradation Analysis of Soils (ASTM D6913). Once the characteristics of the soil are determined through classification testing, a number of movement prediction techniques are available to predict the potential movement of the soils. Some of these are discussed in general below.

TEXAS DEPARTMENT OF TRANSPORTATION METHOD 124-E

The Texas Department of Transportation (TxDOT) has developed a generally simplistic method to predict movements for highways based on the plasticity index of the soil. The TxDOT method is empirical and is based on the Atterberg limits and moisture content of the subsurface soil. This method generally assumes three different initial moisture conditions: dry, "as-is", and wet. Computation of each over an assumed depth of seasonal moisture variation (usually about 15 feet or less) provides an estimate of potential movement at each initial condition. This method requires a number of additional assumptions to develop a potential movement estimate. As such, the predicted movements generally possess large uncertainties when applied to the analysis of conditions under pavements.

POTENTIAL VERTICAL MOVEMENT

A general index for movement is known as the Potential Vertical Rise (PVR). The actual term PVR refers to the TxDOT Method 124-E mentioned above. For the purpose of this report the term Potential Vertical Movement (PVM) will be used since PVM estimates are derived using multiple analytical techniques, and not just TxDOT methods.

Vertical movement of clay soils under pavements resulting to soil moisture changes can result from a variety causes, including poor site grading and drainage, improperly prepared subgrade, trees and large shrubbery located too close to structures, utility leaks or breaks, poor subgrade maintenance such as inadequate or excessive irrigation, or other causes.

PVM is generally considered to be a measurement of the change in height of a foundation from the elevation it was originally placed. Experience and generally accepted practice suggests that if the PVM of a site is less than one inch, the associated differential movement will be minor and acceptable to most people.

TEXAS DEPARTMENT OF TRANSPORTATION METHOD 101-E

This method describes three procedures for preparation of soil and flexible base samples for soil constants and particle size analysis, compaction and triaxial, and sieve analysis of road-mixed material.

TEXAS DEPARTMENT OF TRANSPORTATION METHOD 401-A

This method involves sieve analysis and is used to determine the particle size distribution of mineral fillers and coarse and fine aggregates for Portland cement concrete.

TEXAS DEPARTMENT OF TRANSPORTATION METHOD 116-E

This method determines the resistance of aggregate in flexible base material to disintegration in the presence of water. The test provides a measure of the ability of the material to withstand degradation in the road base and detects soft aggregate that is subject to weathering. The result of this test is the Wet Ball Mill (WBM) value.

SPECIAL COMMENTARY ON CONCRETE AND EARTHWORK

UTILITY TRENCH EXCAVATION

Trench excavation for utilities should be sloped or braced in the interest of safety. Attention is drawn to OSHA Safety and Health Standards (29 CFR 1926/1910), Subpart P, regarding trench excavations greater than 5 feet in depth.

FIELD SUPERVISION AND DENSITY TESTING

Construction observation and testing by a field technician under the direction of a licensed geotechnical engineer should be provided. Some adjustments in the test frequencies may be required based upon the general fill types and soil conditions at the time of fill placement.

It is recommended that all site and subgrade preparation, proofrolling, and pavement construction be monitored by a qualified engineering firm. Density tests should be performed to verify proper compaction and moisture content of any earthwork. Inspection should be performed prior to and during concrete placement operations.

PART E

BID QUANTITIES

Reconstruction of East County Road 120 Phase 2

Roadway Improvements to Serve Midland County					
		Quantity	Unit	Unit Price	Total
Base Bid					
Item	Description				
1	Preparation of R.O.W. (Complete and In-Place)	372	Sta.		
2	Sawcut Existing Asphalt (full depth) (Complete and In-Place)	448	L.F.		
3	Removal of Existing Roadway Materials and Haul Off (Complete and In-Place)	136,816	S.Y.		
4	Earthwork (Complete and In-Place)*	27,955	C.Y.		
5	Haul Off (Complete and In-Place)*	26,983	C.Y.		
6	Subgrade Preparation (Complete and In-Place)	153,461	S.Y.		
7	Prime Coat (Complete and In-Place)**	38,853	Gal.		
8	Flexible Base (Roadway) (Complete and In-Place)	40,685	C.Y.		
9	HMA Pavement - 3" thickness - Type D (Complete and In-Place)**	22,718	Ton		
10	Concrete Pavement at Intersections (Complete and In-Place)	1,841	S.Y.		
11	32'x50' Pitched Concrete Pavement Section (Complete and In-Place)	1	Ea.		
12	32'x175' Pitched Concrete Pavement Section (Complete and In-Place)	2	Ea.		
13	32'x210' Pitched Concrete Pavement Section (Complete and In-Place)	1	Ea.		
14	32'x300' Pitched Concrete Pavement Section (Complete and In-Place)	1	Ea.		
15	3" HMA on 8" Base Commercial Driveway (Complete and In-Place)	2	Ea.		
16	8" Compacted Base Commercial Driveway (Complete and In-Place)	46	Ea.		
17	8" Compacted Base Residential Driveway (Complete and In-Place)	37	Ea.		
18	6" Concrete Residential Driveways (Complete and In-Place)	5	Ea.		
19	3" HMA on 8" Base Residential Driveway (Complete and In-Place)	3	Ea.		
20	Pipeline Concrete Cap (Complete and In-Place)	802	L.F.		
21	Flowable Backfill (Utility Protection) (2' WIDTH X 6" DEPTH) (Complete and In-Place)	154	L.F.		
22	Curb and Gutter (Complete and In-Place)	214	L.F.		
23	5 Strand Barb Wire Fence with H Braces (Complete and In-Place)	251	L.F.		
24	Cast-In-Place (CIP) Reinforced Concrete Box - 3' x 2' (Complete and In-Place)	120	L.F.		
25	Cast-In-Place (CIP) Reinforced Concrete Box - 5' x 2' (Complete and In-Place)	240	L.F.		
26	Cast-In-Place (CIP) Reinforced Concrete Box - 10' x 7' (Complete and In-Place)	720	L.F.		
27	Safety End Treatments with 30° Flared Wings (Type I) (1 - RCB 3'x2')(HW=3)(3:1) (Complete and In-Place)	3	Ea.		
28	Safety End Treatments with 30° Flared Wings (Type I) (1 - RCB 3'x2')(HW=3)(4:1) (Complete and In-Place)	3	Ea.		
29	Safety End Treatments with 30° Flared Wings (Type I) (2 - RCB 5'x2')(HW=3)(5:1) (Complete and In-Place)	1	Ea.		
30	Safety End Treatments with 30° Flared Wings (Type I) (2 - RCB 5'x2')(HW=3)(6:1) (Complete and In-Place)	1	Ea.		

Reconstruction of East County Road 120 Phase 2

Roadway Improvements to Serve Midland County					
		Quantity	Unit	Unit Price	Total
Base Bid					
Item	Description				
31	Safety End Treatments with 30° Flared Wings (Type I) (4 - RCB 5'x2')(HW=3)(3:1) (Complete and In-Place)	2	Ea.		
32	Headwall (PW) (15 - RCB 10'x7')(HW=8) (Complete and In-Place)	2	Ea.		
33	Wingwall (PW-1) (HW = 8') (Complete and In-Place)	98	L.F.		
34	RIPRAP (Complete and In-Place)	302	C.Y.		
35	Concrete Traffic Rail (T223) (Complete and In-Place)	210	L.F.		
36	MTL W-BEAM GD FEN (STEEL POST) (Complete and In-Place)	1,100	L.F.		
37	50' Guardrail Terminal MSKT-MASH-TL-3 (Complete and In-Place)	2	Ea.		
38	10' Downstream Anchor Terminal (DAT) (Complete and In-Place)	2	Ea.		
39	Reflective Marking (Type 1) 4" Double Yellow Striped (Complete and In-Place)	60	Sta.		
40	Reflective Marking (Type 1) 4" Broken Yellow Striped (Complete and In-Place)	308	Sta.		
41	Reflective Marking (Type 1) 4" White Striped (Complete and In-Place)	371	Sta.		
42	18" Stop Bar Pavement Marking (Complete and In-Place)	188	L.F.		
43	Surface Preparation for Pavement Marking (Complete and In-Place)	372	Sta.		
44	Solar Powered LED Stop Sign (Complete and In-Place)	6	Ea.		
45	IN SM RD SN SUP&AM TY10BWG(1) SA (P) (Complete and In-Place)	88	Ea.		
46	Aluminum Signs (Complete and In-Place)	540	S.F.		
47	Mailbox Relocations (Complete and In-Place)	26	Ea.		
48	Erosion Control (Complete and In-Place)	1	L.S.		
49	Traffic Control (Complete and In-Place)	1	L.S.		
50	Mobilization	1	L.S.		
TOTAL BASE BID					
CONSTRUCTION START DATE					
TOTAL CALENDAR DAYS					

Contractor shall notify the Engineer of Record of any discrepancies in quantities prior to the commencement of construction.

*Quantities do not include factors for compaction and expansion.

**Rates used for calculation purposes only:

Prime Coat: 0.3 Gal/SY

HMA Pavement - 3" thickness - Type D: 115 lb/SY*in

Reconstruction of East County Road 120 Phase 2

Roadway Improvements to Serve Midland County		Quantity	Unit	Unit Price	Total
Alternate Bid					
Item	Description				
A5	Haul Off (Complete and In-Place)	762	C.Y.		
A24	Cast-In-Place (CIP) Reinforced Concrete Box - 3' x 2' (Complete and In-Place)	-120	L.F.		
A24	Precast (PC) Reinforced Concrete Box - 3' x 2' (Complete and In-Place)	120	L.F.		
A25	Cast-In-Place (CIP) Reinforced Concrete Box - 5' x 2' (Complete and In-Place)	-240	L.F.		
A25	Precast (PC) Reinforced Concrete Box - 5' x 2' (Complete and In-Place)	240	L.F.		
A26	Cast-In-Place (CIP) Reinforced Concrete Box - 10' x 7' (Complete and In-Place)	-720	L.F.		
A26	Precast (PC) Reinforced Concrete Box - 10' x 7' (Complete and In-Place)	120	L.F.		
A32	Headwall (PW) (15 - RCB 10'x7')(HW=8) (Complete and In-Place)	2	Ea.		
A33	Wingwall (PW-1) (HW = 8') (Complete and In-Place)	-32	L.F.		
TOTAL ALTERNATE BID					
TOTAL ADDITIONAL CALENDAR DAYS					

Contractor shall notify the Engineer of Record of any discrepancies in quantities prior to the commencement of construction.

*Quantities do not include factors for compaction and expansion.

***Rates used for calculation purposes only:

Prime Coat: 0.3 Gal/SY

HMA Pavement - 3" thickness - Type D: 115 lb/SY*in

If this Alternate Bid is utilized, the overall headwall length will increase and the overall wingwall length will decrease. The cumulative effect will be equivalent to the Base Bid.