



SPECIFICATIONS AND BID ITEMS

WCR130 EXTENSION FROM
SCR1232 TO SCR1210
MIDLAND COUNTY, TEXAS

CLIENT:
Midland County

PROJECT NUMBER:
23-170

REPORT DATE:
October 4, 2023



October 4, 2023

Andrew Avis
Director of Public Works
Midland County
500 N Loraine St.
Suite 1100
Midland, TX 79701

Re: Specifications and Bid Items
WCR130 Extension from SCR1232 to SCR1210
Midland County, Texas

Dear Mr. Avis:

Magrym Consulting Inc. is pleased to present this Specifications and Bid Items for WCR130 Extension project in Midland County, Texas. This report includes bidding documents.

Should you have any questions, please do not hesitate to contact us at claudius.sanchez@magrym.com or 432-999-2737.

Sincerely,

Magrym Consulting, Inc.

Claudius Sanchez Czyzewska, P.E., CFM
Principal



TABLE OF CONTENTS

| | | |
|-----|--|---|
| 1.0 | STANDARD SPECIFICATIONS | 3 |
| 2.0 | SPECIAL SPECIFICATIONS | 4 |
| 3.0 | GUIDE SCHEDULE OF SAMPLING AND TESTING - Juan 2019 | 5 |
| 4.0 | GEOTECHNICAL REPORT | 6 |
| 5.0 | BID QUANTITIES | 7 |



1.0 STANDARD SPECIFICATIONS

- TXDOT ITEM 100 Preparing Right of Way
- TXDOT ITEM 110 Excavation
- TXDOT ITEM 132 Embankment
- TXDOT ITEM 164 Seeding for Erosion Control
- TXDOT ITEM 160 Topsoil
- TXDOT ITEM 210 Rolling
- TXDOT ITEM 216 Proof Rolling
- TXDOT ITEM 247 Flexible Base
- TXDOT ITEM 300 Asphalt, Oils, and Emulsions
- TXDOT ITEM 310 Prime Coat
- TXDOT ITEM 340 Dense-Graded Hot-Mix Asphalt (Small Quantity)
- TXDOT ITEM 360 Concrete Pavement
- TXDOT ITEM 421 Hydraulic Cement Concrete
- TXDOT ITEM 432 Riprap
- TXDOT ITEM 440 Reinforcement for Concrete
- TXDOT ITEM 466 Headwalls and Wingwalls
- TXDOT ITEM 500 Mobilization
- TXDOT ITEM 502 Barricades, Signs, and Traffic Handling
- TXDOT ITEM 506 Temporary Erosion, Sedimentation, and Environmental Controls
- TXDOT ITEM 552 Wire Fence
- TXDOT ITEM 636 Aluminum Signs (Type A)
- TXDOT ITEM 644 Small Roadside Sign Assemblies
- TXDOT ITEM 649 Removing or Relocating Roadside Sign Assemblies
- TXDOT ITEM 658 Delineator and Object Marker Assemblies
- TXDOT ITEM 666 Retroreflectorized Pavement Markings
- TXDOT ITEM 735 Debris Removal



2.0 SPECIAL SPECIFICATIONS

- Subgrade Preparation
- ADS Inc. Drainage Handbook HP Storm 12” - 60” Pipe Specification
- ADS Inc. Drainage Handbook Flared End Section Specification
- TXDOT ITEM 6176 Solar Powered LED Stop Sign



SECTION 207: SUBGRADE PREPARATION

207.1 DESCRIPTION

This Work consists of compacting and finishing the Subgrade.

207.2 MATERIALS—Reserved

207.3 CONSTRUCTION REQUIREMENTS

Maximum dry density of all soil types encountered or used will be determined in accordance with AASHTO T 180 (Modified Proctor), Method A or D (TTCP Modified).

The Contractor shall ensure the top two (2) feet of borrow Materials in the finished Subgrade is comprised of Material with the design R-value.

The Contractor shall compact the top six (6) inches of the Roadbed to 95% of maximum density.

The Contractor shall ensure the soil moisture content (at the time of compaction) is from optimum to optimum minus five percent (5%). For soils with a PI of 15 or greater, the Contractor shall ensure the moisture content of the soil at the time of compaction is from optimum moisture to optimum moisture plus four percent (4%).

Field density tests shall be performed in accordance with AASHTO T310 or by other Department approved methods and Section 906, "Minimum Testing Requirements."

207.3.1 Tolerances

The Contractor shall ensure the top surface of the finished Subgrade along centerline shall not vary by more than 0.1 foot above or below established grade and 0.05 foot above or below the typical cross-section measured on the finished surface at right angles to the centerline. The Contractor shall correct all deviations from these tolerances.

207.4 METHOD OF MEASUREMENT

The Department will measure Subgrade preparation using the dimensions shown in the Contract and/or approved modifications.

207.5 BASIS OF PAYMENT

| Pay Item | Pay Unit |
|-----------------------------|-----------------|
| <i>Subgrade Preparation</i> | Square Yard |

207.5.1 Work Included in Payment

The Department will consider the item(s) listed in this section as included in the pay items(s) listed in Section 207.5, "Basis of Payment" and will not measure or pay for them separately:

1. No payment will be made for rehandling or reworking Material to meet moisture and density requirements; and
2. Proof rolling for Unstable Subgrade Stabilization shall be considered Incidental to the Contract and will not be measured or paid for separately.

HP STORM 12”- 60” PIPE SPECIFICATION

Scope

This specification describes 12- through 60-inch (300 to 1500 mm) HP Storm pipe for use in gravity-flow storm drainage applications.

Pipe Requirements

HP Storm pipe shall have a smooth interior and annular exterior corrugations.

- 12- through 60-inch (300 to 1500 mm) pipe shall meet ASTM F2881 or AASHTO M330
- Manning’s “n” value for use in design shall be 0.012

Joint Performance

Pipe shall be joined using a bell & spigot joint meeting the requirements of ASTM F2881 or AASHTO M330. The joint shall be watertight according to the requirements of ASTM D3212. Gaskets shall meet the requirements of ASTM F477. Gasket shall be installed by the pipe manufacturer and covered with a removable, protective wrap to ensure the gasket is free from debris. A joint lubricant available from the manufacturer shall be used on the gasket and bell during assembly. 12- through 60-inch (300 to 1500 mm) diameters shall have an exterior bell wrap installed by the manufacturer.

Fittings

Fittings shall conform to ASTM F2881 or AASHTO M330. Bell and spigot connections shall utilize a welded or integral bell and valley or inline gaskets meeting the watertight joint performance requirements of ASTM D3212.

Field Pipe and Joint Performance

To assure watertightness, field performance verification may be accomplished by testing in accordance with ASTM F1417 or ASTM F2487. Appropriate safety precautions must be used when field-testing any pipe material. Contact the manufacturer for recommended leakage rates.

Material Properties

Polypropylene compound for pipe and fitting production shall be impact modified copolymer meeting the material requirements of ASTM F2881, Section 5 and AASHTO M330, Section 6.1.

Installation

Installation shall be in accordance with ASTM D2321 and ADS recommended installation guidelines, with the exception that minimum cover in traffic areas for 12- through 48-inch (300 to 1200 mm) diameters shall be one foot (0.3 m) and for 60-inch (1500 mm) diameter the minimum cover shall be 2 ft. (0.6 m) in single run applications. Backfill for minimum cover situations shall consist of Class 1 (compacted), Class 2 (minimum 90% SPD), or Class 3 (minimum 95%) material. Maximum fill heights depend on embedment material and compaction level; please refer to Technical Note 2.04. Contact your local ADS representative or visit our website at www.adspipe.com for a copy of the latest installation guidelines.

Build America, Buy America (BABA)

HP Storm pipe (per AASHTO), manufactured in accordance with ASTM F2881 or AASHTO M330, complies with the requirements in the Build America, Buy America (BABA) Act.

Pipe Dimensions

| Nominal Pipe I.D. in (mm) | 12 (300) | 15 (375) | 18 (450) | 24 (600) | 30 (750) | 36 (900) | 42 (1050) | 48 (1200) | 60 (1500) |
|--|---------------|---------------|---------------|---------------|---------------|----------------|----------------|----------------|----------------|
| Average Pipe I.D. in (mm) | 12.2 (310) | 15.1 (384) | 18.2 (462) | 24.1 (612) | 30.2 (767) | 36.0 (914) | 42.0 (1067) | 47.9 (1217) | 59.9 (1521) |
| Average Pipe O.D. in (mm) | 14.5 (368) | 17.7 (450) | 21.4 (544) | 28.0 (711) | 35.5 (902) | 41.5 (1054) | 47.4 (1204) | 54.1 (1374) | 67.1 (1704) |
| Minimum Pipe Stiffness * @ 5% Deflection #/in./in. (kN/m ²) | 75 (517) | 60 (414) | 56 (386) | 50 (345) | 46 (317) | 40 (276) | 35 (241) | 35 (241) | 30 (207) |

*Minimum pipe stiffness values listed; contact a representative for average values.

FLARED END SECTION SPECIFICATION

Scope

This specification describes 12- through 36-inch (300 to 900mm) Flared End Sections for use in culvert and drainage outlet applications.

Requirements


The Flared End Section shall be high density polyethylene meeting ASTM D3350 minimum cell classification 213320C; contact manufacturer for additional cell classification information. When provided, the metal threaded fastening rod shall be stainless steel.

Installation

Installation shall be in accordance with ADS installation instructions and with those issued by state or local authorities. Contact your local ADS representative or visit www.adspipe.com for the latest installation instructions.

| | PIPE DIAMETER, in (mm) | | | |
|---------------------|------------------------|---------------|---------------|----------------|
| Diameter in (mm) | 12 (300) | 15 (375) | 18 (450) | 24 (600) |
| A in (mm) | 6.5 (165) | 6.5 (165) | 7.5 (191) | 7.5 (191) |
| B (max) in (mm) | 10.0 (254) | 10.0 (254) | 15.0 (381) | 18.0 (475) |
| H in (mm) | 6.5 (165) | 6.5 (165) | 6.5 (165) | 6.5 (165) |
| L in (mm) | 25.0 (635) | 25.0 (635) | 32.0 (813) | 36.0 (914) |
| W in (mm) | 29.0 (737) | 29.0 (737) | 35.0 (889) | 45.0 (1143) |

*Product detail may differ slightly from actual product appearance

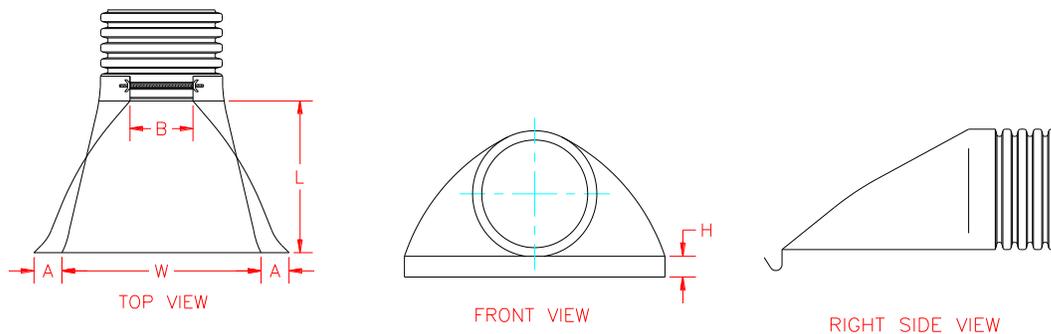

3.0 GUIDE SCHEDULE OF SAMPLING AND TESTING - Jun 2019

Laboratory and Field Testing are to be provided by the County and is not considered a part of this bid.



4.0 GEOTECHNICAL REPORT





GEOTECH REPORT

WCR130 EXTENSION - FROM
SCR1232 TO SCR1210
MIDLAND COUNTY, TEXAS

CLIENT:
Midland County

PROJECT NUMBER:
23-170

REPORT DATE:
August 11, 2023

August 11, 2023

Mr. Andrew Avis
Midland County
500 N. Loraine Street
Midland, TX 79701

Re: **Geotechnical Report**
County Road 130
Midland, TX

Dear Mr. Avis:

Magrym Consulting Inc. is pleased to present this geotechnical report for County Road 130 project in Midland, Texas. This report includes the results of our investigation as well as recommendations for construction.

We appreciate the opportunity to work together. Should you have any questions, please do not hesitate to give us a call.

Sincerely,

Magrym Consulting, Inc.



Claudius Sanchez Czyzewska, P.E.
Principal Engineer



TABLE OF CONTENTS

| | | |
|-----|--|----|
| 1.0 | INTRODUCTION | 4 |
| 2.0 | GEOLOGY | 4 |
| 3.0 | EXISTING GEOTECHNICAL INFORMATION | 4 |
| 4.0 | SUBSURFACE EXPLORATION PROGRAM | 5 |
| 5.0 | SITE CONDITIONS..... | 6 |
| 6.0 | FOUNDATION RECOMMENDATIONS | 8 |
| 7.0 | PAVEMENT RECOMMENDATIONS | 11 |
| 8.0 | CONSTRUCTION RECOMMENDATIONS | 12 |
| 9.0 | CLOSURE | 12 |
| | | |
| | APPENDIX A: BOREHOLE MAP | 14 |
| | APPENDIX B: BOREHOLE LOGS | 15 |
| | APPENDIX C: LABORATORY TESTING RESULTS | 16 |
| | APPENDIX D: REFERENCES AND TERMINOLOGY | 17 |
| | APPENDIX E: USDA WEBSOIL SURVEY..... | 19 |



1.0 INTRODUCTION

1.1 Project Description

Midland County is planning to extend and pave a section of West County Road 130 between South County Road 1232 and South County Road 1210. This unpaved section of roadway is approximately 2.2 miles long.

1.2 Scope of Work

This geotechnical exploration was authorized by Mr. Andrew Avis, Public Works Director, for Midland County. The purpose of this geotechnical study was to evaluate general soil conditions and to provide engineering and design recommendations. To accomplish this purpose, a boring plan was created, boreholes were drilled, and soil samples were obtained. Select samples were tested by a soils and construction materials laboratory for engineering properties. Field and laboratory data were analyzed, and recommendations were developed. Please note, recommendations are specific to this project site and should not be used for any other project site.

2.0 GEOLOGY

2.1 Regional Geology

USGS Map shows the surface geology of the project site to be Quaternary Windblown Cover Sand (Qcs). Defined as : fine to medium grained quartz, silty, calcareous, caliche nodules common, massive, grayish red; distinct soil profile; thickness up to 10 feet, feathers out locally (mostly Illinoian, may include younger deposits).

2.2 Site Geology

The United States Department of Agriculture (USDA) websoil survey provides soil data for the upper 60 inches of subsurface soils. The websoil survey identifies this section of CR 130 primarily as Amarillo fine sandy loam (AfA/AfB). Such soils consist of 0 to 10 inches of fine sandy loam, underlain by 70 inches of sandy clay loam (Appendix E). The presence of sandy loam soils was confirmed during the geotechnical exploration.

3.0 EXISTING GEOTECHNCIAL INFORMATION

There are no known geotechnical reports that exist for this project site.



4.0 SUBSURFACE EXPLORATION PROGRAM

4.1 Field Exploration

On April 11, 2023, twelve exploratory borings were advanced between 4.5 and 5.5 feet below ground surface utilizing a track-mounted Geoprobe drill rig equipped with a 140-lb. automatic hammer. As outlined in ASTM D 1586: Standard Test Method for Standard Penetration Test (SPT) and Split-Barrel Sampling of Soils, disturbed samples were obtained by driving a split spoon 18 inches with a free-falling hammer that was dropped 30 inches. Soil samples were obtained at the intervals shown on the Boring Logs (Appendix B). Each sample was carefully sealed in plastic containers, labeled and secured for delivery to the laboratory. A field log was prepared for each boring. Each log depicts the visual classification of materials encountered during drilling. Boreholes were backfilled after the completion of drilling and sample collection. These borehole locations are shown on the Borehole Map (Appendix A) and summarized in Table 1.

Table 1 - Borehole Identification and Depth (*NAVD88)

| Borehole Number | Latitude | Longitude | Elevation (ft)* | Borehole Depth (ft) | Groundwater Depth |
|-----------------|------------|--------------|-----------------|---------------------|-------------------|
| BH-1 | 31.927183° | -102.133575° | 2814.1 | 5.5 | N/A |
| BH-2 | 31.927811° | -102.130172° | 2833.6 | 5.5 | N/A |
| BH-3 | 31.928575° | -102.127141° | -- | 5.5 | N/A |
| BH-4 | 31.929290° | -102.124043° | 2825.2 | 5.5 | N/A |
| BH-5 | 31.930047° | -102.120830° | 2827.4 | 5.5 | N/A |
| BH-6 | 31.930734° | -102.117886° | 2831.3 | 5.5 | N/A |
| BH-7 | 31.931549° | -102.114503° | -- | 4.5 | N/A |
| BH-8 | 31.932221° | -102.111426° | -- | 5.5 | N/A |
| BH-9 | 31.932221° | -102.111426° | 2812.3 | 5.5 | N/A |
| BH-10 | 31.933664° | -102.105065° | 2805.2 | 5.5 | N/A |
| BH-11 | 31.934423° | -102.101877° | 2806.8 | 5.5 | N/A |
| BH-12 | 31.935351° | -102.098040° | 2801.1 | 5.5 | N/A |

4.2 Laboratory Testing

Upon completion of field exploration, samples were evaluated for physical properties and combined as necessary. Soil samples were delivered to Beyond Testing & Engineering construction materials testing lab in Midland, Texas for testing. Each test was performed in accordance with the most recent ASTM Standards. The following tests were performed.

- ASTM D6913-17 *Standard Test Methods for Particle-Size Distribution (Gradation) of Soils Using Sieve Analysis*
- ASTM D4318-17 *Standard Test Methods for Liquid Limit, Plastic Limit, and Plasticity Index of Soils*



- ASTM D2487-17 Standard Practice for Classification of Soils for Engineering Purposes (Unified Soil Classification System)

Soils within the borings were identified as sands and clays. These materials presented fine-grained particles ranging from 14 to 45 percent passing the No. 200 sieve. Plastic Indexes ranged from non-plastic to 13. Laboratory test results are summarized in Table 2 and presented in Appendix C.

Table 2 - Summary of Laboratory Tests

| Borehole Number | Sample ID | Sample Interval (ft) | Atterberg Limits | % Passing #200 Sieve | USCS Soil Classification |
|-----------------|-----------|----------------------|------------------|----------------------|--------------------------|
| BH-1 | S01 | 0.0-1.5 | LL=20; PI=7 | 32 | SC-SM |
| BH-2 | S02 | 2.0-4.0 | LL=15; PI=1 | 20 | SM |
| BH-3 | S03 | 2.0-4.5 | LL=23; PI=13 | 47 | SC |
| BH-4 | S04 | 0.0-1.5 | LL=22; PI=5 | 14 | SC-SM |
| BH-4 | S05 | 0.2-2.3 | LL=15; PI=3 | 31 | SM |
| BH-5 | S06 | 4.0-5.5 | LL=21; PI=9 | 34 | SC |
| BH-6 | S07 | 5.0-5.6 | LL=18; PI=5 | 24 | SC-SM |
| BH-7 | S08 | 0.6-4.3 | LL=16; PI=3 | 24 | SM |
| BH-9 | S09 | 0.0-4.0 | LL=15; PI=2 | 21 | SM |
| BH-10 | S10 | 3.0-3.6 | LL=22; PI=10 | 42 | SC |
| BH-10 | S11 | 4.0-5.5 | LL=21; PI=9 | 45 | SC |
| BH-11 | S12 | 4.0-5.5 | LL=17; PI=4 | 29 | SC-SM |
| BH-12 | S13 | 0.0-3.0 | LL=NP; PI=NP | 19 | SM |

5.0 SITE CONDITIONS

5.1 Surface Conditions

5.1.1 Vegetation

The west half of the project site (Borings 2-7) is developed with a caliche road. Borings 8-12 were sampled north of an existing caliche lease road that will parallel the new roadway. This eastern portion of the roadway is exhibited by hummocky sand, wild grasses, and mesquite brush.

5.1.2 Topography

The topography of the proposed roadway (between Borings 2 through 12) generally slopes eastward toward South County Road 1210 with an elevation change of approximately 32 feet. Boring 1 is significantly lower than the existing caliche roadway with an elevation change of approximately 19 feet.



5.1.3 General

Significant garbage and debris were observed between Borings 1 and 2. Between Borings 2 and 7, furniture was observed along the south side of the caliche roadway. West of Boring 7, Endeavor was constructing a pond that appeared to be within the County right-of-way.

5.2 Subsurface Conditions

5.2.1 Stratigraphy

For analysis, the site was divided into three sections (Figure 1) based on similarity in colors, soil properties and n-values (blow counts). Utilizing laboratory test results and field logs, a typical subsurface profile was developed and illustrated in Tables 3 through 5.

Figure 1- Site delineation (Sections A-C)



Table 3 - Subsurface Profile - Section A

| Strata | Depth Interval (feet) | Description |
|------------|-----------------------|---------------------------|
| Stratum 1a | 0-2 | Silty Clayey Sand (SC-SM) |
| Stratum 2b | 2-5.5 | Clayey Sand (SC) |

Table 4 - Subsurface Profile - Section B

| Strata | Depth Interval (feet) | Description |
|------------|-----------------------|---|
| Stratum 1b | 0-0.33 (varies 2-6") | Silty Clayey Sand (SC-SM) |
| Stratum 2a | 0.33-5.5 | Silty Sand (SM)/ Silty Clayey Sand (SC-SM) |
| Stratum 2b | 0.33-5.5 | Clayey Sand (SC) |

Table 5 - Subsurface Profile - Section C

| Strata | Depth Interval (feet) | Description |
|------------|-----------------------|---|
| Stratum 1b | 0-2 | Silty Sand (SM) |
| Stratum 2a | 2-5.5 | Silty Sand (SM)/ Silty Clayey Sand (SC-SM) |
| Stratum 2b | 2-5.5 | Clayey Sand (SC) |



5.2.2 Soil Properties

As illustrated in Tables 3 through 5, Sections A, B and C exhibited similar soil strata. Borings were terminated at 5.5 feet below ground surface.

Section A is not paved and serves as a connection between the paved CR 1232 and the caliche capped portion of CR 130. This section includes Boring 1 and it is situated approximately 19 feet lower than the existing caliche roadway. This section was sandy consisted of 3 accesses to the caliche roadway.

Section B consisted of an upper surface profile of silty clayey sand (caliche roadway) underlain by reddish brown silty sand and clayey sand.

Section C was similar in composition to Section B, however, this section of roadway is proposed and the caliche cap is missing.

Table 6 - Soil Properties Summary

| Soil Property | SC-SM | SC | SM |
|--|-------|-------|-------|
| Cohesion (psf) ¹ | 1050 | 1550 | 1050 |
| Unit Weight (pcf) ² | 113 | 113 | 115 |
| Angle of Friction (°) ³ | 33 | 31 | 34 |
| Active Pressure (K _a) ⁴ | 0.295 | 0.320 | 0.283 |

5.2.3 Groundwater Conditions

Groundwater was not encountered at the time of this investigation. Water well reports within the vicinity of the project site indicate the water depth is 36 to 60 feet below ground level (Texas Water Development Board).

5.2.4 Swell Potential derived from Atterberg Limits

Atterberg limit tests were performed for each stratum encountered. The SC-SM soils near the surface exhibited a plasticity index (PI) of 5 to 7. The PI's of the SM soils ranged from non-plastic to 3, while SC soils ranged from 9 to 13. These soils have a moderate potential for shrinking and swelling with changes in moisture content, however, positive drainage should be established to avoid ponding and pooling in the roadway.

6.0 FOUNDATION RECOMMENDATIONS

6.1 Site Preparation

¹ <http://www.geotechnicalinfo.com/cohesion.html>

² TM 5-624/NAVFAC DM MO-102/AFJMAN 32-1040

³ (Earth Manual Part 1 (Third Edition), 1998)

⁴ Calculated Rankin coefficient



- 6.1.1 Remove surface debris, trees, stumps, roots, organic matter, and other obstructions in accordance with TXDOT Items 100 and 735. (Texas Department of Transportation, 2014)
- 6.1.2 Where trees are removed, root-balls shall also be removed. Such excavations will be deeper than typical clearing and grubbing and shall be filled with select fill that is moisture conditioned and compacted as defined herein.
- 6.1.3 Topsoil with organic materials shall not be used or mixed with other materials for use beneath any structures, paving or fill. Organic matter decays overtime creating voids which may lead to settlement. These soils should be removed from the site or set aside for landscaping areas.
- 6.1.4 After topsoil and roots are removed, soils should be compacted and proof-rolled with a fully loaded water truck, a dump truck loaded with 4 cubic yards of soil or a 15-ton pneumatic tired roller Section 3.14.1 (United Facilities Guide Specifications, 2008). A qualified representative should observe for rutting and pumping. Any soft areas should be compacted or removed and replaced with fill. When testing by nuclear density gauge, subgrade density shall be greater than 95% compaction per ASTM 1557 near optimum moisture content.

6.2 Fills

- 6.2.1 All fills should be derived from the same source. Fill soils should be free of deleterious materials and not contain lumps or stones larger than 2 inches.

- 6.2.2 Select Fill

Onsite soils are suitable for select fills. Such soils are classified as SM, SC, and SC-SM in accordance with the Unified Soil Classification System.

- 6.2.3 Flexible Base Course (TXDOT Standard Specification Item No. 247)

Proposed flexible base course should be composed of stone, crushed stone, crushed or screened gravel and be in accordance with material requirements shown in the table below. Grades 4-5 are not recommended and thus shaded in the table below:



**Table 1
Material Requirements**

| Property | Test Method | Grade 1-2 | Grade 3 | Grade 4 ² | Grade 5 |
|--|---------------------------|--------------------------|--------------------------|----------------------|---------|
| Sampling | Tex-400-A | | | | |
| Master gradation sieve size (cumulative % retained) | Tex-110-E | | | | |
| 2-1/2" | | 0 | 0 | | |
| 1-3/4" | | 0-10 | 0-10 | | |
| 7/8" | | 10-35 | - | | |
| 3/8" | | 30-65 | - | | |
| #4 | | 45-75 | 45-75 | | |
| #40 | | 65-90 | 50-85 | | |
| Liquid Limit, % Max | Tex-104-E | 40 | 40 | | |
| Plasticity Index, Max ¹ | Tex-106-E | 10 | 12 | | |
| Plasticity index, Min ¹ | | As shown on the plans | As shown on the plans | | |
| Wet ball mill, % Max | Tex-116-E | 40 | - | | |
| Wet ball mill, % Max increase passing the #40 sieve | | 20 | - | | |
| Min compressive strength, psi | Tex-117-E | | | | |
| lateral pressure 0 psi | | 35 | - | | |
| lateral pressure 3 psi | | - | - | | |
| lateral pressure 15 psi | | 175 | - | | |

- Determine plastic index in accordance with [Tex-107-E](#) (linear shrinkage) when liquid limit is unattainable as defined in [Tex-104-E](#).
- Grade 4 may be further designated as Grade 4A, Grade 4B, etc.

6.3 Compaction

- 6.3.1 Soils should be placed in loose lifts not exceeding 8 inches and compacted to 95 percent maximum dry density of ASTM D 1557. Moisture content shall be between optimum and plus or minus 2 percent.
- 6.3.2 Any subgrade to receive fill shall be scarified a minimum of 6 inches and compacted to 95 percent maximum dry density per ASTM D 1557 with a moisture content of plus or minus 2 percent.

6.4 Excavations

Area soils are classified as Type C, in accordance with the Occupational Safety and Health Administration (OSHA). Such soils exhibit the following properties:

Type C soil is the least stable type of soil. Type C includes granular soils in which particles don't stick together and cohesive soils with a low unconfined compressive strength; 0.5 tons per square foot or less. Examples of Type C soil include gravel, and sand. Because it is not stable, soil with water seeping through it is also automatically classified as Type C soil, regardless of its other characteristics.



Excavations Made in Type C Soil

1. All simple slope excavations 20 feet or less in depth shall have a maximum allowable slope of 1½:1.
2. All excavations 20 feet or less in depth which have vertically sided lower portions shall be shielded or supported to a height at least 18 inches above the top of the vertical side. All such excavations shall have a maximum allowable slope of 1½:1.
3. All other sloped excavations shall be in accordance with the other options permitted in § 1926.652(b).

6.5 Utility Trench Backfill

Trenches shall be prepared in accordance with TXDOT Item 402. (Texas Department of Transportation, 2014)

6.6 Footings and Foundations

6.6.1 Frost Depth

Foundation elements exposed to freezing conditions should be placed a minimum of 10 inches below grade in accordance with Severe Frost Penetration Levels (inches). (2015 IBC Performing Structural Plan Reviews, n.d.)

7.0 PAVEMENT RECOMMENDATIONS

We anticipate this roadway will have an AADT of 5,000 per the TXDOT District Traffic Web Viewer. This new section of roadway will connect CR 1232 and CR 1210. As the traffic counts are not broken down to denote the amount of large truck traffic, this design assumes 20% of the traffic will be 18-wheelers. The pavement sections included are based upon experience with similar pavements with a 20-year design life.

7.1 Pavement Subgrade Preparation

Prepare subgrade in accordance with Section 6.1 of this report.

7.2 Recommended Design Sections

Table 7 - Pavement Section Recommendation Summary

| Material Type | Asphalt Concrete | |
|---|---------------------|---------------------|
| | Light Load Vehicles | Heavy Load Vehicles |
| Hot Mix Asphalt (HMAC) | 3 inches | 3 inches |
| Flexible Base Course (TXDOT Item No. 247) | 6 inches | 12 inches |



8.0 CONSTRUCTION RECOMMENDATIONS

Field compaction tests should be performed in accordance with ASTM D 6938, *Standard Test Method for In-Place Density and Water Content of Soil and Soil-Aggregate by Nuclear Methods (Shallow Depth)*, at the testing frequencies provided in Table I of the TXDOT Guide Schedule of Sampling & Testing (March 2015).

9.0 CLOSURE

The geotechnical investigation was performed using the standard of care and skill ordinarily exercised by geotechnical engineers practicing in this area and under similar circumstances. No warranty, expressed or implied, is made as to the conclusions and professional advice included in this report.

The samples taken and used for testing and the observation are believed to be representative of the entire area. However, soil and geologic conditions can vary significantly between test pits. As in many developments, conditions revealed by excavations may differ with preliminary findings. The geotechnical engineer shall evaluate any discrepancies encountered in the field.



APPENDICES

Appendix A: Borehole Map

Appendix B: Borings Logs

Appendix C: Laboratory Test Data

Appendix D: References & Terminology

Appendix E: USDA Websoil Survey




APPENDIX A: BOREHOLE MAP





© 2023 Microsoft Corporation © 2023 Maxar © CNES (2023) Distribution Airbus DS

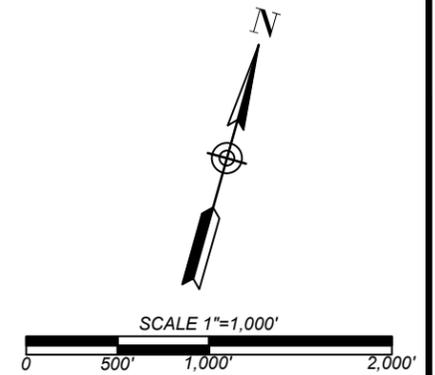


 Magrym Consulting, Inc.
 110 W. Louisiana Ave. Ste 314
 Midland, TX 79701
 (432) 999-2737
 www.magrym.com
 TX #F-19848 | ND #28610PE | OK #8561PE

| R-X | DESCRIPTION | DATE | BY |
|-------------------------------|-------------|------|----|
| REVISIONS (OR CHANGE NOTICES) | | | |



MIDLAND COUNTY
 TEXAS
 MIDLAND COUNTY PUBLIC WORKS DEPARTMENT
 500 N. LORAIN STREET
 MIDLAND, TX 79701

WEST COUNTY ROAD 130 EXTENSION
 FROM SOUTH COUNTY ROAD 1232
 TO SOUTH COUNTY ROAD 1210

| BOREHOLE MAP | |
|----------------------------|---------------------|
| HORIZONTAL SCALE: 1"=1000' | VERTICAL SCALE: NTS |
| PRINT DATE: 5/25/2023 | DESIGNED BY: ZZ |
| PROJECT NO. 23-170 | CHECKED BY: CSC |
| SUBSET: CIVIL | APPROVED BY: CSC |

SHEET:
 G - 100

APPENDIX B: BOREHOLE LOGS



| | | | | |
|---------------------------|--------------|----------------------------|-----------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | Project: County Road 130 |  |
| Boring No.: BH-1 | | Date Drilled: 4/11/2023 | Drilling Contractor: Talon LPE | Drill Rig Type Geoprobe on tracks |
| Lat: | 31.927183° | Groundwater Depth: N/A | Elevation: 2814.1' | Total Depth of boring: 5'6" |
| Long: | -102.133575° | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|---|-------------|----------------------|-------|--------------------------|--|
| 1 |  | SPT | 7 | | SC-SM | Tan Silty Clayey Sand <i>18" recovery</i> |
| 2 |  | SPT | 12 | | SC | Light Brown Clayey Sand |
| 3 |  | SPT | 23 | | | |
| 4 | | | | | | |
| 5 | | | | | | |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 5.5'

Borehole Summary

Client Midland County Project/Project No. CR 130, Midland, TX BH No. 1 Date 4/11/2023

LAT 31.927183°
LONG -102.133575°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture | Qu | Blow Counts | | |
|---------|-------------------------|-------|----------------------------------|-----|-----|-----|------|------------------|----|----------|-----|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | % | psi | 6" | 6" | 6" |
| 0-2 | Tan Silty Clayey Sand | SC-SM | 100 | 100 | 100 | 90 | 32 | 20 | 7 | 1.1 | | 6 | 4 | 3 |
| 2-4 | Light Brown Clayey Sand | SC | 100 | 98 | 97 | 94 | 47 | 23 | 13 | 1.3 | | 4 | 6 | 6 |
| 4-4'9 | Light Brown Clayey Sand | | | | | | | | | | | 6 | -- | -- |
| 4'9-5'6 | Light Brown Clayey Sand | | | | | | | | | | | -- | 9 | 13 |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



| | | | | | | | |
|---------------------------|--------------|----------------------------|--|-----------------------------------|--|--------------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | | Project: County Road 130 | | MAGTYM | |
| Boring No. BH-2 | | Date Drilled: 4/11/2023 | | Drilling Contractor: Talon LPE | | Drill Rig Type Geoprobe on tracks | |
| Lat: | 31.927811° | Groundwater Depth: N/A | | Elevation: 2833.6' | | Total Depth of boring: 5'6" | |
| Long: | -102.130172° | | | | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|---|-------------|----------------------|-------|--------------------------|-----------------------------------|
| 1 |  | SPT | 3 | | SC-SM | Tan Silty Clayey Sand |
| 2 |  | SPT | 13/6" | | | <i>18" recovery</i> |
| 3 |  | SPT | 12 | | SM | Tan Silty Sand |
| 4 |  | SPT | 7 | | | |
| 5 |  | SPT | | | | |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 5.5'

Borehole Summary

Client Midland County Project/Project No. CR 130, Midland, TX BH No. 2 Date 4/11/2023

LAT 31.927811°
LONG -102.130172°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture | Qu | Blow Counts | | |
|-------|-----------------------|-------|----------------------------------|-----|-----|-----|------|------------------|----|----------|-----|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | % | psi | 6" | 6" | 6" |
| 0-1 | Tan Silty Clayey Sand | SC-SM | 100 | 100 | 100 | 90 | 32 | 20 | 13 | 7 | | 1 | 2 | -- |
| 1-2 | Tan Silty Sand | SM | 100 | 99 | 99 | 94 | 20 | 15 | 14 | 1 | | -- | -- | 13 |
| 2-4 | Tan Silty Sand | | | | | | | | | | | 2 | 3 | 9 |
| 4-5'6 | Tan Silty Sand | | | | | | | | | | | 3 | 3 | 4 |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



| | | | | | | | |
|---------------------------|--------------|----------------------------|--|-----------------------------------|--|--------------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | | Project: County Road 130 | | MAGTYM | |
| Boring No.: BH-3 | | Date Drilled: 4/11/2023 | | Drilling Contractor: Talon LPE | | Drill Rig Type Geoprobe on tracks | |
| Lat: | 31.928575° | Groundwater Depth: N/A | | Elevation: -- | | Total Depth of boring: 5'6" | |
| Long: | -102.127141° | | | | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|-------------|-------------|----------------------|-------|--------------------------|---|
| 1 | | SPT | 16/6" | | SC-SM | Light Brown Silty Clayey Sand with Gravel (Roadway) |
| 2 | | | 14 | | SM | Tan Silty Sand |
| 3 | | | 8 | | | |
| 4 | | | 11 | | | |
| 5 | | | | | | |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 5.5'

Borehole Summary

Client Midland County Project/Project No. CR 130, Midland, TX BH No. 3 Date 4/11/2023
 LAT 31.928575°
 LONG -102.127141°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture | Qu | Blow Counts | | |
|--------|---|-------|----------------------------------|----|-----|-----|------|------------------|----|----------|-----|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | % | psi | 6" | 6" | 6" |
| 0-0'3" | Light Brown Silty Clayey Sand with Gravel (Roadway) | SC-SM | 80 | 59 | 51 | 41 | 14 | 22 | 5 | 0.9 | | 16 | -- | -- |
| 0'3"-2 | Tan Silty Sand | SM | 100 | 99 | 99 | 94 | 20 | 15 | 1 | 0.7 | | -- | 7 | 7 |
| 2-4 | Tan Silty Sand | | | | | | | | | | | 3 | 3 | 5 |
| 4-5'6" | Tan Silty Sand | | | | | | | | | | | 4 | 5 | 6 |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



| | | | | | | | |
|---------------------------|--------------|----------------------------|--|-----------------------------------|--|--------------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | | Project: County Road 130 | | MAGTYM | |
| Boring No.: BH-4 | | Date Drilled: 4/11/2023 | | Drilling Contractor: Talon LPE | | Drill Rig Type Geoprobe on tracks | |
| Lat: | 31.929290° | Groundwater Depth: N/A | | Elevation: 2825.2' | | Total Depth of boring: 5'6" | |
| Long: | -102.124043° | | | | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|-------------|-------------|----------------------|-------|--------------------------|---|
| 1 | | SPT | 18/6" | | SC-SM | Light Brown Silty Clayey Sand with Gravel (Roadway) |
| 2 | | SPT | 10 | | SM | Tan Silty Sand |
| 3 | | SPT | 6 | | SC | Tan Clayey Sand |
| 4 | | SPT | 17 | | SC | Light Brown Clayey Sand |
| 5 | | | | | | |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 5.5'

Borehole Summary

Client Midland County Project/Project No. CR 130, Midland, TX BH No. 4 Date 4/11/2023

LAT 31.929290°
LONG -102.124043°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture | Qu | Blow Counts | | |
|----------|---|-------|----------------------------------|-----|-----|-----|------|------------------|----|----------|-----|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | % | psi | 6" | 6" | 6" |
| 0-0'2" | Light Brown Silty Clayey Sand with Gravel (Roadway) | SC-SM | 80 | 59 | 51 | 41 | 14 | 22 | 5 | 0.9 | | 18 | -- | -- |
| 0'2"-2 | Tan Silty Sand | SM | 100 | 100 | 99 | 94 | 31 | 15 | 3 | 1.7 | | -- | 6 | 4 |
| 2-2'3" | Tan Silty Sand | | | | | | | | | | | 2 | -- | -- |
| 2'3"-4 | Tan Clayey Sand | SC | 100 | 100 | 100 | 96 | 34 | 21 | 9 | 1.4 | | -- | 2 | 4 |
| 4-4'6 | Tan Clayey Sand | | | | | | | | | | | 5 | -- | -- |
| 4'6"-5'6 | Light Brown Clayey Sand | SC | 100 | 98 | 97 | 94 | 47 | 23 | 13 | 1.3 | | -- | 9 | 8 |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



| | | | | |
|---------------------------|--------------|----------------------------|-----------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | Project: County Road 130 |  |
| Boring No.: BH-5 | | Date Drilled: 4/11/2023 | Drilling Contractor: Talon LPE | Drill Rig Type Geoprobe on tracks |
| Lat: | 31.930047° | Groundwater Depth: N/A | Elevation: 2827.4' | Total Depth of boring: 5'6" |
| Long: | -102.120830° | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|--|-------------|----------------------|-------|--------------------------|---|
| 1 |  | SPT | 21/6" | | SC-SM | Light Brown Silty Clayey Sand with Gravel (Roadway) |
| 2 | | | 15 | | SM | Tan Silty Sand |
| 3 | | | 18 | | | |
| 4 | | | 25 | | SC | Tan Clayey Sand |
| 5 | | | | | | |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 5.5'

Borehole Summary

Client Midland County Project/Project No. CR 130, Midland, TX BH No. 5 Date 4/11/2023

LAT 31.930047°
LONG -102.120830°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture | Qu | Blow Counts | | |
|--------|---|-------|----------------------------------|-----|-----|-----|------|------------------|----|----------|-----|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | % | psi | 6" | 6" | 6" |
| 0-0'3" | Light Brown Silty Clayey Sand with Gravel (Roadway) | SC-SM | 80 | 59 | 51 | 41 | 14 | 22 | 5 | 0.9 | | 21 | -- | -- |
| 0'3-2 | Tan Silty Sand | SM | 100 | 100 | 99 | 94 | 31 | 15 | 3 | 1.7 | | -- | 9 | 6 |
| 2-4 | Tan Silty Sand | | | | | | | | | | | 6 | 7 | 11 |
| 4-5'6 | Tan Clayey Sand | SC | 100 | 100 | 100 | 96 | 34 | 21 | 9 | 1.4 | | 2 | 12 | 13 |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



| | | | | | | | |
|---------------------------|--------------|----------------------------|--|-----------------------------------|--|--------------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | | Project: County Road 130 | | MAGTYM | |
| Boring No.: BH-6 | | Date Drilled: 4/11/2023 | | Drilling Contractor: Talon LPE | | Drill Rig Type Geoprobe on tracks | |
| Lat: | 31.930734° | Groundwater Depth: N/A | | Elevation: 2831.3' | | Total Depth of boring: 5'6" | |
| Long: | -102.117886° | | | | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|-------------|-------------|----------------------|-------|--------------------------|---|
| 1 | | SPT | 14/6" | | SC-SM | Light Brown Silty Clayey Sand with Gravel (Roadway) |
| 2 | | | 16 | | SM | Tan Silty Sand |
| 3 | | | 18 | | | |
| 4 | | | 18 | | SM | Light Brown Silty Sand |
| 5 | | | 19/6" | | SC-SM | Light Brown Silty Clayey Sand |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 5.5'

Borehole Summary

Client Midland County Project/Project No. CR 130, Midland, TX BH No. 6 Date 4/11/2023

LAT 31.930734°
LONG -102.117886°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture | Qu | Blow Counts | | |
|---------|---|-------|----------------------------------|-----|-----|-----|------|------------------|----|----------|-----|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | % | psi | 6" | 6" | 6" |
| 0-0'5" | Light Brown Silty Clayey Sand with Gravel (Roadway) | SC-SM | 80 | 59 | 51 | 41 | 14 | 22 | 5 | 0.9 | | 14 | -- | -- |
| 0'5"-2' | Tan Silty Sand | SM | 100 | 100 | 99 | 94 | 31 | 15 | 3 | 1.7 | | -- | 10 | 6 |
| 2'-4' | Tan Silty Sand | | | | | | | | | | | 7 | 8 | 10 |
| 4'-5' | Light Brown Silty Sand | SM | 100 | 99 | 99 | 95 | 24 | 16 | 3 | 0.9 | | 6 | 12 | -- |
| 5'-5'6" | Light Brown Silty Clayey Sand | SC-SM | 100 | 98 | 95 | 89 | 24 | 18 | 5 | 0.9 | | -- | -- | 19 |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



| | | | | |
|---------------------------|--------------|----------------------------|-----------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | Project: County Road 130 |  |
| Boring No.: BH-7 | | Date Drilled: 4/11/2023 | Drilling Contractor: Talon LPE | Drill Rig Type Geoprobe on tracks |
| Lat: | 31.931549° | Groundwater Depth: N/A | Elevation: -- | Total Depth of boring: 4'6" |
| Long: | -102.114503° | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|---|-------------|----------------------|-------|--------------------------|---|
| 1 |  | SPT | 16/6" | | SC-SM | Light Brown Silty Clayey Sand with Gravel (Roadway) |
| 2 | | | 21 | | | |
| 3 | | | 15 | | SM | Light Brown Silty Sand |
| 4 | | | 39/6" | | | |
| 5 | | | | | | |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 4.5'

Borehole Summary

Client Midland County Project/Project No. CR 130, Midland, TX BH No. 7 Date 4/11/2023

LAT 31.931549°
LONG -102.114503°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture | Qu | Blow Counts | | |
|-----------|---|-------|----------------------------------|----|-----|-----|------|------------------|----|----------|-----|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | % | psi | 6" | 6" | 6" |
| 0-0'6" | Light Brown Silty Clayey Sand with Gravel (Roadway) | SC-SM | 80 | 59 | 51 | 41 | 14 | 22 | 5 | 0.9 | | 16 | | |
| 0'6"-2' | Light Brown Silty Sand | SM | 100 | 99 | 99 | 95 | 24 | 16 | 3 | 0.9 | | | 12 | 9 |
| 2'-4' | Light Brown Silty Sand | | | | | | | | | | | 4 | 5 | 10 |
| 4'-4'3" | Light Brown Silty Sand | | | | | | | | | | | 39/6" | | |
| 4'3"-4'6" | Rock | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



| | | | | |
|---------------------------|--------------|----------------------------|-----------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | Project: County Road 130 |  |
| Boring No.: BH-8 | | Date Drilled: 4/11/2023 | Drilling Contractor: Talon LPE | |
| Lat: | 31.932221° | Groundwater Depth: N/A | Elevation: -- | Total Depth of boring: 5'6" |
| Long: | -102.111426° | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|---|-------------|----------------------|-------|--------------------------|-----------------------------------|
| 1 |  | SPT | 14 | | SM | Light Brown Silty Sand |
| 2 | | SPT | 15 | | | |
| 3 | | SPT | 17 | | | |
| 4 | | | | | | |
| 5 | | | | | | |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 5.5'

Borehole Summary


Client Midland County Project/Project No. CR 130, Midland, TX BH No. 8 Date 4/11/2023

LAT 31.932221°
LONG -102.111426°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture | Qu | Blow Counts | | |
|-------|------------------------|------|----------------------------------|-----|-----|-----|------|------------------|----|----------|-----|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | % | psi | 6" | 6" | 6" |
| 0-2 | Light Brown Silty Sand | SM | 100 | 100 | 100 | 98 | 21 | 15 | 2 | 0.8 | | 3 | 5 | 9 |
| 2-4 | Light Brown Silty Sand | | | | | | | | | | | 6 | 6 | 9 |
| 4-6 | Light Brown Silty Sand | | | | | | | | | | | 8 | 7 | 10 |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



| | | | | |
|---------------------------|--------------|----------------------------|-----------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | Project: County Road 130 |  |
| Boring No.: BH-9 | | Date Drilled: 4/11/2023 | Drilling Contractor: Talon LPE | |
| Lat: | 31.932221° | Groundwater Depth: N/A | Elevation: 2812.3' | Total Depth of boring: 5'6" |
| Long: | -102.111426° | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|---|-------------|----------------------|-------|--------------------------|-----------------------------------|
| 1 |  | SPT | 16 | | SM | Light Brown Silty Sand |
| 2 | | | 20 | | | |
| 3 | | | 27 | | | |
| 4 | | | | | | |
| 5 | | | | | | |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 5.5'

Borehole Summary

Client Midland County Project/Project No. CR 130, Midland, TX BH No. 9 Date 4/11/2023

LAT 31.932221°
LONG -102.111426°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture | Qu | Blow Counts | | |
|-------|------------------------|------|----------------------------------|-----|-----|-----|------|------------------|----|----------|-----|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | % | psi | 6" | 6" | 6" |
| 0-2 | Light Brown Silty Sand | SM | 100 | 100 | 100 | 98 | 21 | 15 | 2 | 0.8 | | 2 | 7 | 9 |
| 2-4 | Light Brown Silty Sand | | | | | | | | | | | 9 | 8 | 12 |
| 4-6 | Light Brown Silty Sand | | | | | | | | | | | 7 | 12 | 15 |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



| | | | | |
|---------------------------|--------------|----------------------------|-----------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | Project: County Road 130 |  |
| Boring No.: BH-10 | | Date Drilled: 4/11/2023 | Drilling Contractor: Talon LPE | Drill Rig Type Geoprobe on tracks |
| Lat: | 31.933664° | Groundwater Depth: N/A | Elevation: 2805.2' | Total Depth of boring: 5'6" |
| Long: | -102.105065° | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|---|-------------|----------------------|-------|--------------------------|--|
| 1 |  | SPT | 15 | | SM | Brown Silty Clayey Sand with Gravel <i>18" recovery</i> |
| 2 |  | SPT | 17 | | SC | Light Brown Clayey Sand |
| 3 |  | SPT | | | | |
| 4 |  | SPT | 27 | | SC | Tan Clayey Sand |
| 5 | | | | | | |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 5.5'

Borehole Summary

Client Midland County Project/Project No. CR 130, Midland, TX BH No. 10 Date 4/11/2023

LAT 31.933664°
LONG -102.105065°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture % | Qu psi | Blow Counts | | |
|-------|-------------------------|------|----------------------------------|-----|-----|-----|------|------------------|----|------------|--------|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | | | 6" | 6" | 6" |
| 0-2 | Light Brown Silty Sand | SM | 100 | 100 | 100 | 98 | 21 | 15 | 2 | 0.8 | | 3 | 6 | 9 |
| 2-3 | Light Brown Silty Sand | | | | | | | | | | | 4 | 9 | -- |
| 3-3'6 | Light Brown Clayey Sand | SC | 100 | 100 | 100 | 96 | 42 | 22 | 10 | 0.9 | | -- | -- | 8 |
| 4-5 | Light Brown Clayey Sand | | | | | | | | | | | 9 | 12 | -- |
| 5-5'6 | Tan Clayey Sand | SC | 100 | 100 | 100 | 96 | 45 | 21 | 9 | 0.6 | | -- | -- | 15 |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



| | | | | |
|---------------------------|--------------|----------------------------|-----------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | Project: County Road 130 |  |
| Boring No.: BH-11 | | Date Drilled: 4/11/2023 | Drilling Contractor: Talon LPE | Drill Rig Type Geoprobe on tracks |
| Lat: | 31.934423° | Groundwater Depth: N/A | Elevation: 2806.8' | Total Depth of boring: 5'6" |
| Long: | -102.101877° | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|---|-------------|----------------------|-------|--------------------------|-----------------------------------|
| 1 |  | SPT | 16 | | SM | Light Brown Silty Sand |
| 2 |  | SPT | 19 | | | |
| 3 |  | SPT | | | | |
| 4 |  | | | | | |
| 5 |  | SPT | 19 | | SC-SM | Tan Silty Clayey Sand |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 5.5'

Borehole Summary

Client Midland County Project/Project No. CR 130, Midland, TX BH No. 11 Date 4/11/2023

LAT 31.934423°
LONG -102.101877°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture % | Qu psi | Blow Counts | | |
|-------|------------------------|-------|----------------------------------|-----|-----|-----|------|------------------|-----|------------|--------|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | | | 6" | 6" | 6" |
| 0-2 | Light Brown Silty Sand | SM | 100 | 100 | 100 | 96 | 19 | SNP | SNP | 0.6 | | 3 | 6 | 10 |
| 2-3 | Light Brown Silty Sand | | | | | | | | | | | 6 | 8 | -- |
| 3-3'6 | Light Brown Silty Sand | | | | | | | | | | | -- | -- | 11 |
| 4-5 | Tan Silty Clayey Sand | SC-SM | 100 | 100 | 100 | 96 | 29 | 17 | 4 | 0.8 | | 6 | 8 | -- |
| 5-5'6 | Tan Silty Clayey Sand | | | | | | | | | | | -- | -- | 11 |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



| | | | | | | | |
|---------------------------|--------------|----------------------------|--|-----------------------------------|--|--------------------------------------|--|
| Client: Midland County | | Project Number: 23-170 | | Project: County Road 130 | | MAGTYM | |
| Boring No.: BH-12 | | Date Drilled: 4/11/2023 | | Drilling Contractor: Talon LPE | | Drill Rig Type Geoprobe on tracks | |
| Lat: | 31.935351° | Groundwater Depth: N/A | | Elevation: 2801.1' | | Total Depth of boring: 5'6" | |
| Long: | -102.098040° | | | | | | |

| Depth (feet) | Graphic Log | Sample Type | blows/foot (n-value) | Tests | USCS Soil Classification | Material Description and Comments |
|--------------|---|-------------|----------------------|-------|--------------------------|-----------------------------------|
| 1 |  | SPT | 17 | | SM | Light Brown Silty Sand |
| 2 |  | SPT | 11 | | | |
| 3 |  | SPT | 12 | | | |
| 4 | | | | | | |
| 5 | | | | | | |
| 6 | | | | | | |
| 7 | | | | | | |
| 8 | | | | | | |
| 9 | | | | | | |
| 10 | | | | | | |
| 11 | | | | | | |
| 12 | | | | | | |
| 13 | | | | | | |
| 14 | | | | | | |
| 15 | | | | | | |
| 16 | | | | | | |
| 17 | | | | | | |
| 18 | | | | | | |
| 19 | | | | | | |
| 20 | | | | | | |
| 21 | | | | | | |

Total Depth: 5.5'

Borehole Summary

Client Midland County Project/Project No. CR 130, Midland, TX BH No. 12 Date 4/11/2023

LAT 31.935351°
LONG -102.098040°

| Depth | Soil Description | USCS | Sieve Analysis (percent passing) | | | | | Atterberg Limits | | Moisture % | Qu psi | Blow Counts | | |
|-------|------------------------|------|----------------------------------|-----|-----|-----|------|------------------|-----|------------|--------|-------------|----|----|
| | | | 3/4" | #4 | #10 | #40 | #200 | LL | PI | | | 6" | 6" | 6" |
| 0-2 | Light Brown Silty Sand | SM | 100 | 100 | 100 | 96 | 19 | SNP | SNP | | | 3 | 8 | 9 |
| 2-3 | Light Brown Silty Sand | | | | | | | | | | | 3 | 5 | -- |
| 3-3'6 | Light Brown Silty Sand | | | | | | | | | | | -- | -- | 6 |
| 4-5'6 | Light Brown Silty Sand | | | | | | | | | | | 6 | 5 | 7 |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |
| | | | | | | | | | | | | | | |



APPENDIX C: LABORATORY TESTING RESULTS



TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:

REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D1140 & D6913
Sample ID: BH-1
Sample Location 0-1.6'
Material Description Tan Silty, Clayey Sand
Sample By: Client
Sample Date: 4/11/2023
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| No. 4 | 0 | N/A |
| No. 10 | 0 | - |
| No. 40 | 10 | - |
| No. 200 | 68 | - |

In situ moisture = 1.1%
Material Finer than 75 um (No. 200) sieve by washing = 30.3%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC



Quality Review

S01

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-1
Sample Location: 0-1.6'
Material Description: Tan Silty, Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits

Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 20 | N/A |
| Plastic Limit: | 13 | - |
| Plasticity Index: | 7 | - |

Soil Classification

Silty, clayey sand (SC-SM)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

S02

West Texas
3011-B South County Road 1260
Midland, Texas 79706
432.561.5780

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:

REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D1140 & D6913
Sample ID: BH-2
Sample Location: 2-4'
Material Description: Tan Silty Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 3/8" | 0 | N/A |
| No. 4 | 1 | - |
| No. 10 | 1 | - |
| No. 40 | 6 | - |
| No. 200 | 80 | - |

In situ moisture = 0.7%
Material Finer than 75 um (No. 200) sieve by washing = 18.5%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC


Quality Review

S02

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-2
Sample Location: 2-4'
Material Description: Tan Silty Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits

Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 15 | N/A |
| Plastic Limit: | 14 | - |
| Plasticity Index: | 1 | - |

Soil Classification

Silty sand (SM)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

S03

West Texas
3011-B South County Road 1260
Midland, Texas 79706
432.561.5780

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:

REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D1140 & D6913
Sample ID: BH-3
Sample Location: 2-4.6'
Material Description: Light Brown Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 3/8" | 0 | N/A |
| No. 4 | 2 | - |
| No. 10 | 3 | - |
| No. 40 | 6 | - |
| No. 200 | 53 | - |

In situ moisture = 1.3%
Material Finer than 75 um (No. 200) sieve by washing = 45.9%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC



Quality Review

S03

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-3
Sample Location 2-4.6'
Material Description Light Brown Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits


Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 23 | N/A |
| Plastic Limit: | 10 | - |
| Plasticity Index: | 13 | - |

Soil Classification

Clayey sand (SC)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

S04

TO: Magrym Consulting, PC
 Claudius Sanchez
 1510 North Acres Dr
 Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

 -
 -

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:
REVISION:
MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D1140 & D6913
Sample ID: BH-4
Sample Location: 0-2'
Material Description: Light Brown Silty, Clayey Sand w/Gravel
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 1" | 0 | N/A |
| 3/4" | 20 | - |
| 3/8" | 33 | - |
| No. 4 | 41 | - |
| No. 10 | 49 | - |
| No. 40 | 59 | - |
| No. 200 | 86 | - |

In situ moisture = 0.9%
 Material Finer than 75 um (No. 200) sieve by washing = 13.6%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC


 Quality Review

S04

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-4
Sample Location: 0-2'
Material Description: Light Brown Silty Clayey Sand w/Gravel
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits

Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 22 | N/A |
| Plastic Limit: | 17 | - |
| Plasticity Index: | 5 | - |

Soil Classification

Silty clayey sand with garvel (SC-SM)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

S05
TO: Magrym Consulting, PC
 Claudius Sanchez
 1510 North Acres Dr
 Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

 -
 -

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:
REVISION:
MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D1140 & D6913
Sample ID: BH-4
Sample Location: 2-3'
Material Description: Tan Silty Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 3/8" | 0 | N/A |
| No. 4 | 0 | - |
| No. 10 | 1 | - |
| No. 40 | 6 | - |
| No. 200 | 69 | - |

In situ moisture = 1.7%
 Material Finer than 75 um (No. 200) sieve by washing = 29.1%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC

 Quality Review

S05

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-4
Sample Location: 0-2'
Material Description: Tan Silty Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits

Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 15 | N/A |
| Plastic Limit: | 12 | - |
| Plasticity Index: | 3 | - |

Soil Classification

Silty sand (SM)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

S06

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing
-
-

PROJECT NO.: WT1909260
DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D1140 & D6913
Sample ID: BH-5
Sample Location 4-6"
Material Description Tan Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 3/8" | 0 | N/A |
| No. 4 | 0 | - |
| No. 10 | 0 | - |
| No. 40 | 4 | - |
| No. 200 | 66 | - |

In situ moisture = 1.4%
Material Finer than 75 um (No. 200) sieve by washing = 32.8%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC



Quality Review

S06

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-5
Sample Location: 4-6'
Material Description: Tan Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits

Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 21 | N/A |
| Plastic Limit: | 12 | - |
| Plasticity Index: | 9 | - |

Soil Classification

Clayey sand (SC)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

S07

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:

REVISION:

MATERIAL QUALIFICATIONS - Soils


Test Procedure: ASTM D1140 & D6913
Sample ID: BH-6
Sample Location: 5-5.6'
Material Description: Light Brown Silty, Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 3/8" | 0 | N/A |
| No. 4 | 2 | - |
| No. 10 | 5 | - |
| No. 40 | 11 | - |
| No. 200 | 76 | - |

In situ moisture = 0.9%
Material Finer than 75 um (No. 200) sieve by washing = 22.4%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC



Quality Review

S07

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-6
Sample Location: 5-5.6'
Material Description: Light Brown Silty, Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits


Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 18 | N/A |
| Plastic Limit: | 13 | - |
| Plasticity Index: | 5 | - |

Soil Classification

Silty, clayey sand (SC-SM)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

S08

West Texas
3011-B South County Road 1260
Midland, Texas 79706
432.561.5780

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:

REVISION:

MATERIAL QUALIFICATIONS - Soils


Test Procedure: ASTM D1140 & D6913
Sample ID: BH-7
Sample Location 5.3-6
Material Description Light Brown Silty Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 3/8" | 0 | N/A |
| No. 4 | 1 | - |
| No. 10 | 1 | - |
| No. 40 | 5 | - |
| No. 200 | 76 | - |

In situ moisture = 0.9%
Material Finer than 75 um (No. 200) sieve by washing = 23.2%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC



Quality Review

S08

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-7
Sample Location 5.3-6
Material Description Light Brown Silty Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits

Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 16 | N/A |
| Plastic Limit: | 13 | - |
| Plasticity Index: | 3 | - |

Soil Classification

Silty sand (SM)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

TO: Magrym Consulting, PC
 Claudius Sanchez
 1510 North Acres Dr
 Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing
 -
 -

PROJECT NO.: WT1909260
DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils


Test Procedure: ASTM D1140 & D6913
Sample ID: BH-9
Sample Location 0-4'
Material Description Light Brown Silty Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 3/8" | 0 | N/A |
| No. 4 | 0 | - |
| No. 10 | 0 | - |
| No. 40 | 2 | - |
| No. 200 | 79 | - |

In situ moisture = 0.8%
 Material Finer than 75 um (No. 200) sieve by washing = 18.4%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC


 Quality Review

S09

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-9
Sample Location: 0-4'
Material Description: Light Brown Silty Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits


Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 15 | N/A |
| Plastic Limit: | 13 | - |
| Plasticity Index: | 2 | - |

Soil Classification

Silty sand (SM)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

S10

West Texas
3011-B South County Road 1260
Midland, Texas 79706
432.561.5780

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:

REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D1140 & D6913
Sample ID: BH-10
Sample Location: 3-3.6'
Material Description: Light Brown Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 3/8" | 0 | N/A |
| No. 4 | 0 | - |
| No. 10 | 0 | - |
| No. 40 | 4 | - |
| No. 200 | 58 | - |

In situ moisture = 4.1%
Material Finer than 75 um (No. 200) sieve by washing = 40.5%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC



Quality Review

S10

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-10
Sample Location 3-3.6
Material Description Light Brown Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits


Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 22 | N/A |
| Plastic Limit: | 12 | - |
| Plasticity Index: | 10 | - |

Soil Classification

Clayey sand (SC)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing
-
-

PROJECT NO.: WT1909260
DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D1140 & D6913
Sample ID: BH-10
Sample Location: 4.6-5'
Material Description: Tan Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 3/8" | 0 | N/A |
| No. 4 | 0 | - |
| No. 10 | 0 | - |
| No. 40 | 4 | - |
| No. 200 | 55 | - |

In situ moisture = 0.6%
Material Finer than 75 um (No. 200) sieve by washing = 36.3%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC



Quality Review

S11

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-10
Sample Location: 4.6-5'
Material Description: Tan Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits


Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 21 | N/A |
| Plastic Limit: | 12 | - |
| Plasticity Index: | 9 | - |

Soil Classification

Clayey sand (SC)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

TO: Magrym Consulting, PC
 Claudius Sanchez
 1510 North Acres Dr
 Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing
 -
 -

PROJECT NO.: WT1909260
DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils


Test Procedure: ASTM D1140 & D6913
Sample ID: BH-11
Sample Location: 4-5.6'
Material Description: Tan Silty, Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 3/8" | 0 | N/A |
| No. 4 | 0 | - |
| No. 10 | 0 | - |
| No. 40 | 4 | - |
| No. 200 | 71 | - |

In situ moisture = 0.8%
 Material Finer than 75 um (No. 200) sieve by washing = 27.2%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC


 Quality Review

S12

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-11
Sample Location: 4-5.6'
Material Description: Tan Silty, Clayey Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits


Specifications

| | | |
|-------------------|----|-----|
| Liquid Limit: | 17 | N/A |
| Plastic Limit: | 13 | - |
| Plasticity Index: | 4 | - |

Soil Classification

Silty, clayey sand (SC-SM)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing
-
-

PROJECT NO.: WT1909260
DATE: May 17, 2023

Test By: Maui Rodriguez
Test Date: May 16, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils


Test Procedure: ASTM D1140 & D6913
Sample ID: BH-12
Sample Location: 0-3'
Material Description: Light Brown Silty Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

| <u>Sieve Size</u> | <u>Cumulative Percent Retained</u> | <u>Specifications</u> |
|-------------------|------------------------------------|-----------------------|
| 3/8" | 0 | N/A |
| No. 4 | 0 | - |
| No. 10 | 0 | - |
| No. 40 | 4 | - |
| No. 200 | 81 | - |

In situ moisture = 0.6%
Material Finer than 75 um (No. 200) sieve by washing = 17.8%

Remarks: Sample soak a minimum of 10 min

Beyond Engineering and Testing, LLC



Quality Review

S13

TO: Magrym Consulting, PC
Claudius Sanchez
1510 North Acres Dr
Lovington, New Mexico, 88260

PROJECT: Magrym Misc. Testing

-
-

PROJECT NO.: WT1909260

DATE: May 17, 2023

Test By: Poonam Kumari
Test Date: May 11, 2023

REPORT NO.:
REVISION:

MATERIAL QUALIFICATIONS - Soils

Test Procedure: ASTM D4318, D2487
Sample ID: BH-12
Sample Location: 0-3
Material Description: Light Brown Silty Sand
Sample By: Client
Sample Date: N/A
Sample Received: 5/10/2023

Test Method: Method B (Single Point)
Equipment: Plastic Limit (Hand rolled)
Liquid Limit (Mechanical)

Atterberg Limits

Specifications

| | | |
|-------------------|-------------|-----|
| Liquid Limit: | - | N/A |
| Plastic Limit: | Non Plastic | - |
| Plasticity Index: | - | - |

Soil Classification

Silty sand (SM)

Beyond Engineering and Testing, LLC



Quality Review

Copyright 2023 Beyond Engineering and Testing, LLC
All Rights Reserved

These reported results are for the exclusive use of the client for whom they were obtained and apply only to the samples tested and/or inspected. They are not intended to be representative of apparently identical products. Redistributed use of our name and/or reports must receive prior written approval. Reports must be reproduced in their entirety. Unauthorized use or copying of this document is strictly prohibited by any entity other than the client for the specific project.

APPENDIX D: REFERENCES AND TERMINOLOGY


Soil Properties

Soil classification table



Unified Soil Classification System and Symbol Chart:

| COARSE-GRAINED SOILS (more than 50% of material is larger than No. 200 sieve size.) | | | FINE-GRAINED SOILS (50% or more of material is smaller than No. 200 sieve size.) | | | |
|--|---|---|---|---|--|---|
| GRAVELS More than 50% of coarse fraction larger than No. 4 sieve size | Clean Gravels (Less than 5% fines) | | SILTS AND CLAYS Liquid limit less than 50% | ML | Inorganic silts and very fine sands, rock flour, silty or clayey fine sands or clayey silts with slight plasticity | |
| | GW | Well-graded gravels, gravel-sand mixtures, little or no fines | | CL | Inorganic clays of low to medium plasticity, gravelly clays, sandy clays, silty clays, lean clays | |
| | GP | Poorly-graded gravels, gravel-sand mixtures, little or no fines | | OL | Organic silts and organic silty clays of low plasticity | |
| | Gravels with fines (More than 12% fines) | | | SILTS AND CLAYS Liquid limit 50% or greater | MH | Inorganic silts, micaceous or diatomaceous fine sandy or silty soils, elastic silts |
| | GM | Silty gravels, gravel-sand-silt mixtures | | | CH | Inorganic clays of high plasticity, fat clays |
| | GC | Clayey gravels, gravel-sand-clay mixtures | | | OH | Organic clays of medium to high plasticity, organic silts |
| Clean Sands (Less than 5% fines) | | HIGHLY ORGANIC SOILS | PT | | Peat and other highly organic soils | |
| SW | Well-graded sands, gravelly sands, little or no fines | | | | | |
| SP | Poorly graded sands, gravelly sands, little or no fines | | | | | |
| SANDS 50% or more of coarse fraction smaller than No. 4 sieve size | Sands with fines (More than 12% fines) | | | | | |
| | SM | Silty sands, sand-silt mixtures | | | | |
| | SC | Clayey sands, sand-clay mixtures | | | | |
| | | | | | | |

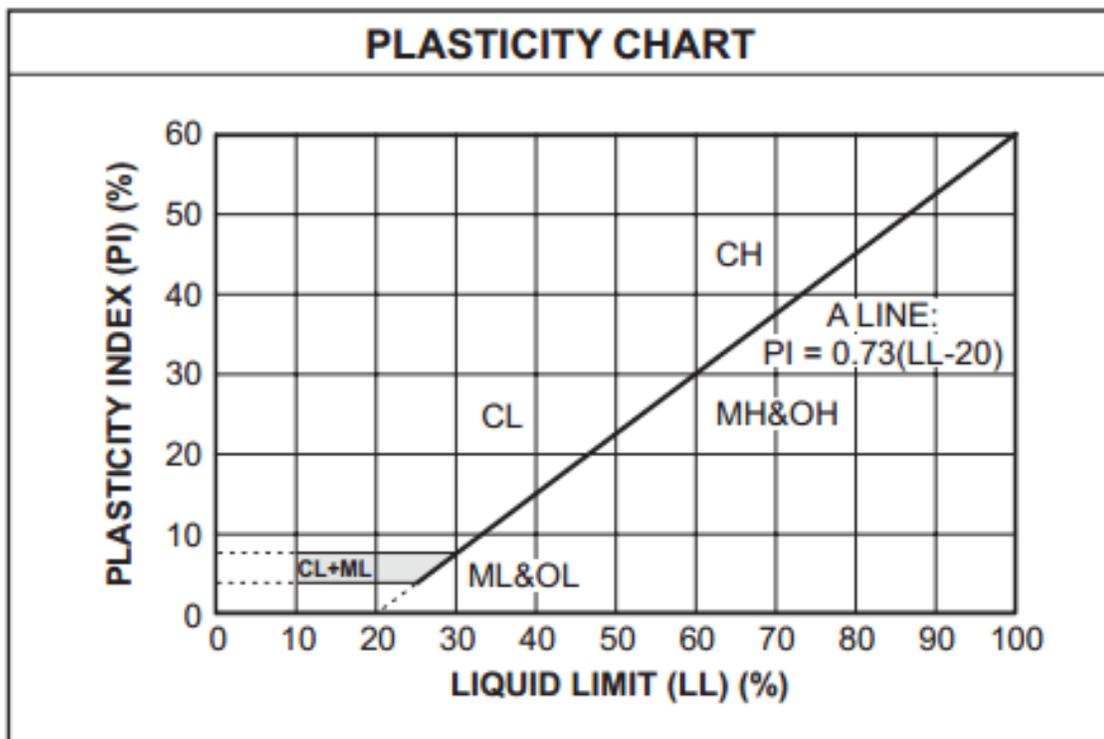

Works Sited:

(n.d.). Retrieved from 2015 IBC Performing Structural Plan Reviews:

[https://www.nmcoa.org/wp-](https://www.nmcoa.org/wp-content/uploads/2018/05/2015_IBC_Performing_Structural_Plan_Review_4up1.pdf)

[content/uploads/2018/05/2015_IBC_Performing_Structural_Plan_Review_4up1.pdf](https://www.nmcoa.org/wp-content/uploads/2018/05/2015_IBC_Performing_Structural_Plan_Review_4up1.pdf)

2018 IBC Code and Commentary -Volume 2. (2018). International Code Council, Inc.

ACI Committee. (2011). *Building Code Requirements for Structural Concrete (ACI 318-11)*.

Committee, A. (2006). *ACI Manual of Concrete Practice (ACI 360r-92)*.

(1998). *Earth Manual Part 1 (Third Edition)*. Denver, Colorado: U.S. Department of the Interior Bureau of Reclamation - Earth Sciences and Research Laboratory Geotechnical Research Technical Service Center.

Texas Department of Transportation. (2014, March 1). *Standard Specifications for Construction and Maintenance of Highways, Streets and Bridges*. Texas.

United Facilities Guide Specifications. (2008).



APPENDIX E: USDA WEBSOIL SURVEY





United States
Department of
Agriculture


NRCS

Natural
Resources
Conservation
Service

A product of the National
Cooperative Soil Survey,
a joint effort of the United
States Department of
Agriculture and other
Federal agencies, State
agencies including the
Agricultural Experiment
Stations, and local
participants

Custom Soil Resource Report for Midland County, Texas

MC_CR130

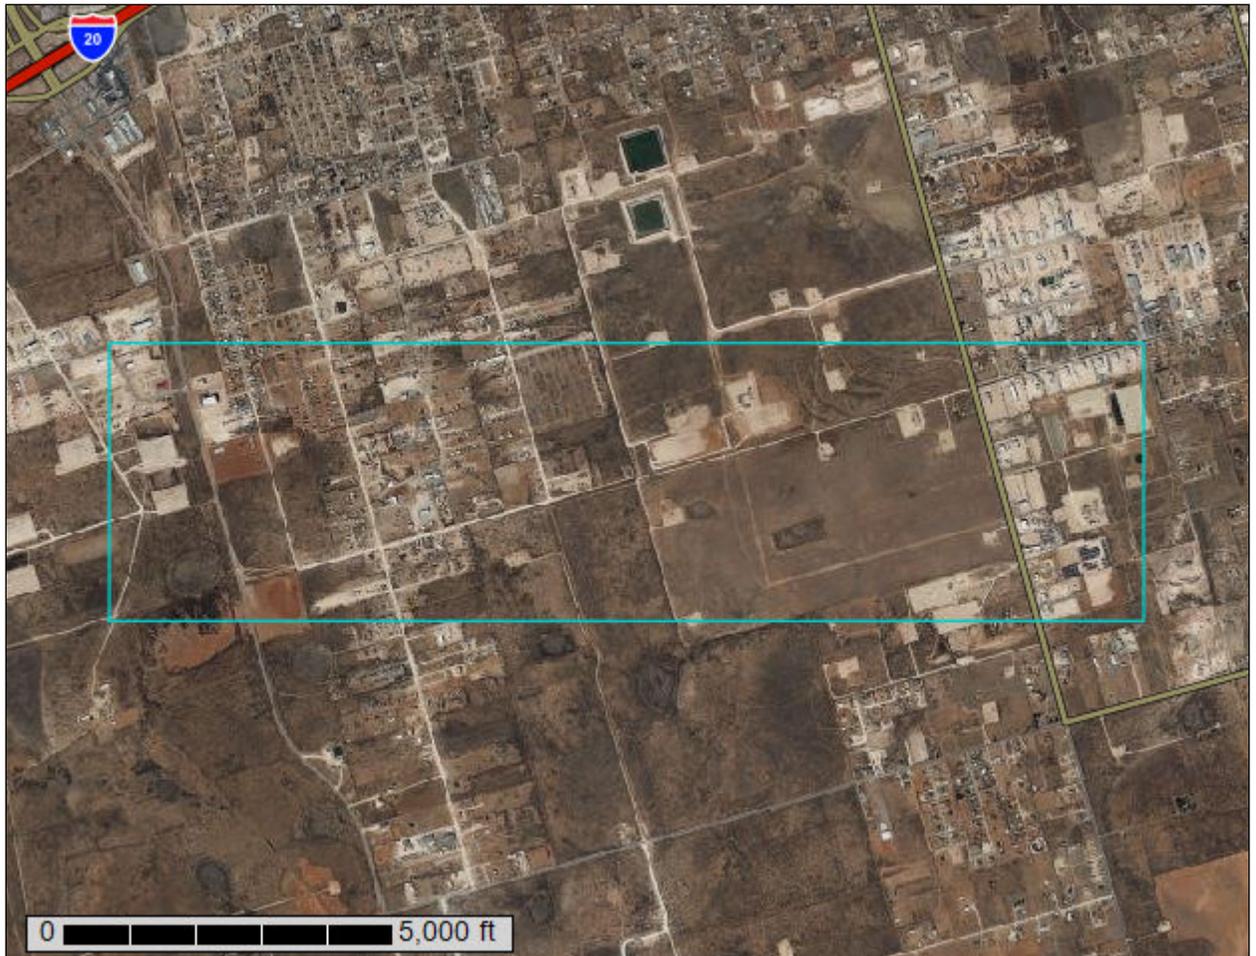

Preface

Soil surveys contain information that affects land use planning in survey areas. They highlight soil limitations that affect various land uses and provide information about the properties of the soils in the survey areas. Soil surveys are designed for many different users, including farmers, ranchers, foresters, agronomists, urban planners, community officials, engineers, developers, builders, and home buyers. Also, conservationists, teachers, students, and specialists in recreation, waste disposal, and pollution control can use the surveys to help them understand, protect, or enhance the environment.

Various land use regulations of Federal, State, and local governments may impose special restrictions on land use or land treatment. Soil surveys identify soil properties that are used in making various land use or land treatment decisions. The information is intended to help the land users identify and reduce the effects of soil limitations on various land uses. The landowner or user is responsible for identifying and complying with existing laws and regulations.

Although soil survey information can be used for general farm, local, and wider area planning, onsite investigation is needed to supplement this information in some cases. Examples include soil quality assessments (<http://www.nrcs.usda.gov/wps/portal/nrcs/main/soils/health/>) and certain conservation and engineering applications. For more detailed information, contact your local USDA Service Center (<https://offices.sc.egov.usda.gov/locator/app?agency=nrcs>) or your NRCS State Soil Scientist (http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/contactus/?cid=nrcs142p2_053951).

Great differences in soil properties can occur within short distances. Some soils are seasonally wet or subject to flooding. Some are too unstable to be used as a foundation for buildings or roads. Clayey or wet soils are poorly suited to use as septic tank absorption fields. A high water table makes a soil poorly suited to basements or underground installations.

The National Cooperative Soil Survey is a joint effort of the United States Department of Agriculture and other Federal agencies, State agencies including the Agricultural Experiment Stations, and local agencies. The Natural Resources Conservation Service (NRCS) has leadership for the Federal part of the National Cooperative Soil Survey.

Information about soils is updated periodically. Updated information is available through the NRCS Web Soil Survey, the site for official soil survey information.

The U.S. Department of Agriculture (USDA) prohibits discrimination in all its programs and activities on the basis of race, color, national origin, age, disability, and where applicable, sex, marital status, familial status, parental status, religion, sexual orientation, genetic information, political beliefs, reprisal, or because all or a part of an individual's income is derived from any public assistance program. (Not all prohibited bases apply to all programs.) Persons with disabilities who require

alternative means for communication of program information (Braille, large print, audiotape, etc.) should contact USDA's TARGET Center at (202) 720-2600 (voice and TDD). To file a complaint of discrimination, write to USDA, Director, Office of Civil Rights, 1400 Independence Avenue, S.W., Washington, D.C. 20250-9410 or call (800) 795-3272 (voice) or (202) 720-6382 (TDD). USDA is an equal opportunity provider and employer.

Contents

| | |
|--|----|
| Preface | 2 |
| How Soil Surveys Are Made | 5 |
| Soil Map | 8 |
| Soil Map..... | 9 |
| Legend..... | 10 |
| Map Unit Legend..... | 11 |
| Map Unit Descriptions..... | 11 |
| Midland County, Texas..... | 13 |
| AfA—Amarillo fine sandy loam, 0 to 1 percent slopes..... | 13 |
| AfB—Amarillo fine sandy loam, 1 to 3 percent slopes..... | 14 |
| ArB—Arvana fine sandy loam, 1 to 3 percent slopes..... | 16 |
| Kb—Kimbrough loam, 0 to 3 percent slopes..... | 17 |
| Lp—Lipan clay, 0 to 1 percent slopes, frequently ponded..... | 19 |
| MmB—Amarose loamy fine sand, 0 to 3 percent slopes..... | 20 |
| References | 23 |

How Soil Surveys Are Made

Soil surveys are made to provide information about the soils and miscellaneous areas in a specific area. They include a description of the soils and miscellaneous areas and their location on the landscape and tables that show soil properties and limitations affecting various uses. Soil scientists observed the steepness, length, and shape of the slopes; the general pattern of drainage; the kinds of crops and native plants; and the kinds of bedrock. They observed and described many soil profiles. A soil profile is the sequence of natural layers, or horizons, in a soil. The profile extends from the surface down into the unconsolidated material in which the soil formed or from the surface down to bedrock. The unconsolidated material is devoid of roots and other living organisms and has not been changed by other biological activity.

Currently, soils are mapped according to the boundaries of major land resource areas (MLRAs). MLRAs are geographically associated land resource units that share common characteristics related to physiography, geology, climate, water resources, soils, biological resources, and land uses (USDA, 2006). Soil survey areas typically consist of parts of one or more MLRA.

The soils and miscellaneous areas in a survey area occur in an orderly pattern that is related to the geology, landforms, relief, climate, and natural vegetation of the area. Each kind of soil and miscellaneous area is associated with a particular kind of landform or with a segment of the landform. By observing the soils and miscellaneous areas in the survey area and relating their position to specific segments of the landform, a soil scientist develops a concept, or model, of how they were formed. Thus, during mapping, this model enables the soil scientist to predict with a considerable degree of accuracy the kind of soil or miscellaneous area at a specific location on the landscape.

Commonly, individual soils on the landscape merge into one another as their characteristics gradually change. To construct an accurate soil map, however, soil scientists must determine the boundaries between the soils. They can observe only a limited number of soil profiles. Nevertheless, these observations, supplemented by an understanding of the soil-vegetation-landscape relationship, are sufficient to verify predictions of the kinds of soil in an area and to determine the boundaries.

Soil scientists recorded the characteristics of the soil profiles that they studied. They noted soil color, texture, size and shape of soil aggregates, kind and amount of rock fragments, distribution of plant roots, reaction, and other features that enable them to identify soils. After describing the soils in the survey area and determining their properties, the soil scientists assigned the soils to taxonomic classes (units). Taxonomic classes are concepts. Each taxonomic class has a set of soil characteristics with precisely defined limits. The classes are used as a basis for comparison to classify soils systematically. Soil taxonomy, the system of taxonomic classification used in the United States, is based mainly on the kind and character of soil properties and the arrangement of horizons within the profile. After the soil

Custom Soil Resource Report

scientists classified and named the soils in the survey area, they compared the individual soils with similar soils in the same taxonomic class in other areas so that they could confirm data and assemble additional data based on experience and research.

The objective of soil mapping is not to delineate pure map unit components; the objective is to separate the landscape into landforms or landform segments that have similar use and management requirements. Each map unit is defined by a unique combination of soil components and/or miscellaneous areas in predictable proportions. Some components may be highly contrasting to the other components of the map unit. The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The delineation of such landforms and landform segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, onsite investigation is needed to define and locate the soils and miscellaneous areas.

Soil scientists make many field observations in the process of producing a soil map. The frequency of observation is dependent upon several factors, including scale of mapping, intensity of mapping, design of map units, complexity of the landscape, and experience of the soil scientist. Observations are made to test and refine the soil-landscape model and predictions and to verify the classification of the soils at specific locations. Once the soil-landscape model is refined, a significantly smaller number of measurements of individual soil properties are made and recorded. These measurements may include field measurements, such as those for color, depth to bedrock, and texture, and laboratory measurements, such as those for content of sand, silt, clay, salt, and other components. Properties of each soil typically vary from one point to another across the landscape.

Observations for map unit components are aggregated to develop ranges of characteristics for the components. The aggregated values are presented. Direct measurements do not exist for every property presented for every map unit component. Values for some properties are estimated from combinations of other properties.

While a soil survey is in progress, samples of some of the soils in the area generally are collected for laboratory analyses and for engineering tests. Soil scientists interpret the data from these analyses and tests as well as the field-observed characteristics and the soil properties to determine the expected behavior of the soils under different uses. Interpretations for all of the soils are field tested through observation of the soils in different uses and under different levels of management. Some interpretations are modified to fit local conditions, and some new interpretations are developed to meet local needs. Data are assembled from other sources, such as research information, production records, and field experience of specialists. For example, data on crop yields under defined levels of management are assembled from farm records and from field or plot experiments on the same kinds of soil.

Predictions about soil behavior are based not only on soil properties but also on such variables as climate and biological activity. Soil conditions are predictable over long periods of time, but they are not predictable from year to year. For example, soil scientists can predict with a fairly high degree of accuracy that a given soil will have a high water table within certain depths in most years, but they cannot predict that a high water table will always be at a specific level in the soil on a specific date.

After soil scientists located and identified the significant natural bodies of soil in the survey area, they drew the boundaries of these bodies on aerial photographs and

Custom Soil Resource Report

identified each as a specific map unit. Aerial photographs show trees, buildings, fields, roads, and rivers, all of which help in locating boundaries accurately.


Soil Map

The soil map section includes the soil map for the defined area of interest, a list of soil map units on the map and extent of each map unit, and cartographic symbols displayed on the map. Also presented are various metadata about data used to produce the map, and a description of each soil map unit.

Custom Soil Resource Report Soil Map



Map Scale: 1:26,300 if printed on A landscape (11" x 8.5") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 13N WGS84

MAP LEGEND

Area of Interest (AOI)

 Area of Interest (AOI)

Soils

 Soil Map Unit Polygons

 Soil Map Unit Lines

 Soil Map Unit Points

Special Point Features

-  Blowout
-  Borrow Pit
-  Clay Spot
-  Closed Depression
-  Gravel Pit
-  Gravelly Spot
-  Landfill
-  Lava Flow
-  Marsh or swamp
-  Mine or Quarry
-  Miscellaneous Water
-  Perennial Water
-  Rock Outcrop
-  Saline Spot
-  Sandy Spot
-  Severely Eroded Spot
-  Sinkhole
-  Slide or Slip
-  Sodic Spot

-  Spoil Area
-  Stony Spot
-  Very Stony Spot
-  Wet Spot
-  Other
-  Special Line Features

Water Features

 Streams and Canals

Transportation

-  Rails
-  Interstate Highways
-  US Routes
-  Major Roads
-  Local Roads

Background

 Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:31,700.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
 Web Soil Survey URL:
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Midland County, Texas
 Survey Area Data: Version 21, Aug 24, 2022

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Feb 10, 2022—Feb 13, 2022

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

| Map Unit Symbol | Map Unit Name | Acres in AOI | Percent of AOI |
|------------------------------------|--|----------------|----------------|
| AfA | Amarillo fine sandy loam, 0 to 1 percent slopes | 244.7 | 16.1% |
| AfB | Amarillo fine sandy loam, 1 to 3 percent slopes | 1,079.1 | 70.9% |
| ArB | Arvana fine sandy loam, 1 to 3 percent slopes | 149.2 | 9.8% |
| Kb | Kimbrough loam, 0 to 3 percent slopes | 26.1 | 1.7% |
| Lp | Lipan clay, 0 to 1 percent slopes, frequently ponded | 5.6 | 0.4% |
| MmB | Amarose loamy fine sand, 0 to 3 percent slopes | 16.8 | 1.1% |
| Totals for Area of Interest | | 1,521.7 | 100.0% |

Map Unit Descriptions

The map units delineated on the detailed soil maps in a soil survey represent the soils or miscellaneous areas in the survey area. The map unit descriptions, along with the maps, can be used to determine the composition and properties of a unit.

A map unit delineation on a soil map represents an area dominated by one or more major kinds of soil or miscellaneous areas. A map unit is identified and named according to the taxonomic classification of the dominant soils. Within a taxonomic class there are precisely defined limits for the properties of the soils. On the landscape, however, the soils are natural phenomena, and they have the characteristic variability of all natural phenomena. Thus, the range of some observed properties may extend beyond the limits defined for a taxonomic class. Areas of soils of a single taxonomic class rarely, if ever, can be mapped without including areas of other taxonomic classes. Consequently, every map unit is made up of the soils or miscellaneous areas for which it is named and some minor components that belong to taxonomic classes other than those of the major soils.

Most minor soils have properties similar to those of the dominant soil or soils in the map unit, and thus they do not affect use and management. These are called noncontrasting, or similar, components. They may or may not be mentioned in a particular map unit description. Other minor components, however, have properties and behavioral characteristics divergent enough to affect use or to require different management. These are called contrasting, or dissimilar, components. They generally are in small areas and could not be mapped separately because of the scale used. Some small areas of strongly contrasting soils or miscellaneous areas are identified by a special symbol on the maps. If included in the database for a given area, the contrasting minor components are identified in the map unit descriptions along with some characteristics of each. A few areas of minor components may not have been observed, and consequently they are not mentioned in the descriptions, especially where the pattern was so complex that it

Custom Soil Resource Report

was impractical to make enough observations to identify all the soils and miscellaneous areas on the landscape.

The presence of minor components in a map unit in no way diminishes the usefulness or accuracy of the data. The objective of mapping is not to delineate pure taxonomic classes but rather to separate the landscape into landforms or landform segments that have similar use and management requirements. The delineation of such segments on the map provides sufficient information for the development of resource plans. If intensive use of small areas is planned, however, onsite investigation is needed to define and locate the soils and miscellaneous areas.

An identifying symbol precedes the map unit name in the map unit descriptions. Each description includes general facts about the unit and gives important soil properties and qualities.

Soils that have profiles that are almost alike make up a *soil series*. Except for differences in texture of the surface layer, all the soils of a series have major horizons that are similar in composition, thickness, and arrangement.

Soils of one series can differ in texture of the surface layer, slope, stoniness, salinity, degree of erosion, and other characteristics that affect their use. On the basis of such differences, a soil series is divided into *soil phases*. Most of the areas shown on the detailed soil maps are phases of soil series. The name of a soil phase commonly indicates a feature that affects use or management. For example, Alpha silt loam, 0 to 2 percent slopes, is a phase of the Alpha series.

Some map units are made up of two or more major soils or miscellaneous areas. These map units are complexes, associations, or undifferentiated groups.

A *complex* consists of two or more soils or miscellaneous areas in such an intricate pattern or in such small areas that they cannot be shown separately on the maps. The pattern and proportion of the soils or miscellaneous areas are somewhat similar in all areas. Alpha-Beta complex, 0 to 6 percent slopes, is an example.

An *association* is made up of two or more geographically associated soils or miscellaneous areas that are shown as one unit on the maps. Because of present or anticipated uses of the map units in the survey area, it was not considered practical or necessary to map the soils or miscellaneous areas separately. The pattern and relative proportion of the soils or miscellaneous areas are somewhat similar. Alpha-Beta association, 0 to 2 percent slopes, is an example.

An *undifferentiated group* is made up of two or more soils or miscellaneous areas that could be mapped individually but are mapped as one unit because similar interpretations can be made for use and management. The pattern and proportion of the soils or miscellaneous areas in a mapped area are not uniform. An area can be made up of only one of the major soils or miscellaneous areas, or it can be made up of all of them. Alpha and Beta soils, 0 to 2 percent slopes, is an example.

Some surveys include *miscellaneous areas*. Such areas have little or no soil material and support little or no vegetation. Rock outcrop is an example.

Midland County, Texas

AfA—Amarillo fine sandy loam, 0 to 1 percent slopes

Map Unit Setting

National map unit symbol: f5r6
Elevation: 2,600 to 5,100 feet
Mean annual precipitation: 16 to 21 inches
Mean annual air temperature: 57 to 63 degrees F
Frost-free period: 185 to 220 days
Farmland classification: Farmland of statewide importance

Map Unit Composition

Amarillo and similar soils: 90 percent
Minor components: 10 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Amarillo

Setting

Landform: Plains
Down-slope shape: Linear
Across-slope shape: Linear
Parent material: Loamy eolian deposits

Typical profile

Ap - 0 to 10 inches: fine sandy loam
Bt - 10 to 41 inches: sandy clay loam
Btkk - 41 to 56 inches: sandy clay loam
Btk - 56 to 80 inches: sandy clay loam

Properties and qualities

Slope: 0 to 1 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Well drained
Runoff class: Negligible
Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high
(0.57 to 1.98 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 65 percent
Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)
Sodium adsorption ratio, maximum: 1.0
Available water supply, 0 to 60 inches: Moderate (about 8.1 inches)

Interpretive groups

Land capability classification (irrigated): 2e
Land capability classification (nonirrigated): 3e
Hydrologic Soil Group: B
Ecological site: R077CY036TX - Sandy Loam 16-21" PZ
Hydric soil rating: No

Minor Components

Arvana

Percent of map unit: 4 percent
Landform: Plains
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: R077CY036TX - Sandy Loam 16-21" PZ
Hydric soil rating: No

Posey

Percent of map unit: 4 percent
Landform: Plains
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: R077CY028TX - Limy Upland 16-21" PZ
Hydric soil rating: No

Sharvana

Percent of map unit: 2 percent
Landform: Plains
Down-slope shape: Linear
Across-slope shape: Convex
Ecological site: R077CY037TX - Very Shallow 16-21" PZ
Hydric soil rating: No

AfB—Amarillo fine sandy loam, 1 to 3 percent slopes

Map Unit Setting

National map unit symbol: f5r7
Elevation: 2,600 to 5,100 feet
Mean annual precipitation: 16 to 21 inches
Mean annual air temperature: 57 to 63 degrees F
Frost-free period: 185 to 220 days
Farmland classification: Farmland of statewide importance

Map Unit Composition

Amarillo and similar soils: 90 percent
Minor components: 10 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Amarillo

Setting

Landform: Plains, playa slopes
Down-slope shape: Convex, concave
Across-slope shape: Linear
Parent material: Loamy eolian deposits

Custom Soil Resource Report

Typical profile

Ap - 0 to 10 inches: fine sandy loam
Bt - 10 to 41 inches: sandy clay loam
Btkk - 41 to 56 inches: sandy clay loam
Btk - 56 to 85 inches: sandy clay loam

Properties and qualities

Slope: 1 to 3 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Well drained
Runoff class: Low
Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high
(0.57 to 1.98 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 65 percent
Maximum salinity: Nonsaline to very slightly saline (0.0 to 2.0 mmhos/cm)
Sodium adsorption ratio, maximum: 1.0
Available water supply, 0 to 60 inches: Moderate (about 8.1 inches)

Interpretive groups

Land capability classification (irrigated): 3e
Land capability classification (nonirrigated): 3e
Hydrologic Soil Group: B
Ecological site: R077CY036TX - Sandy Loam 16-21" PZ
Hydric soil rating: No

Minor Components

Arvana

Percent of map unit: 4 percent
Landform: Plains, playa slopes
Down-slope shape: Convex, concave
Across-slope shape: Linear
Ecological site: R077CY036TX - Sandy Loam 16-21" PZ
Hydric soil rating: No

Posey

Percent of map unit: 4 percent
Landform: Plains, playa slopes
Down-slope shape: Convex, concave
Across-slope shape: Linear
Ecological site: R077CY028TX - Limy Upland 16-21" PZ
Hydric soil rating: No

Sharvana

Percent of map unit: 2 percent
Landform: Plains
Down-slope shape: Linear
Across-slope shape: Convex
Ecological site: R077CY037TX - Very Shallow 16-21" PZ
Hydric soil rating: No

ArB—Arvana fine sandy loam, 1 to 3 percent slopes

Map Unit Setting

National map unit symbol: f5rp

Elevation: 2,600 to 5,100 feet

Mean annual precipitation: 16 to 21 inches

Mean annual air temperature: 57 to 63 degrees F

Frost-free period: 185 to 220 days

Farmland classification: Farmland of statewide importance, if irrigated

Map Unit Composition

Arvana and similar soils: 85 percent

Minor components: 15 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Arvana

Setting

Landform: Plains, playa slopes

Down-slope shape: Convex, concave

Across-slope shape: Linear

Parent material: Loamy eolian deposits from the blackwater draw formation of pleistocene age

Typical profile

Ap - 0 to 9 inches: fine sandy loam

Bt - 9 to 26 inches: sandy clay loam

Bkkm - 26 to 37 inches: cemented material

Bkk - 37 to 80 inches: very gravelly loam

Properties and qualities

Slope: 1 to 3 percent

Depth to restrictive feature: 20 to 40 inches to petrocalcic

Drainage class: Well drained

Runoff class: High

Capacity of the most limiting layer to transmit water (Ksat): Very low to moderately low (0.00 to 0.14 in/hr)

Depth to water table: More than 80 inches

Frequency of flooding: None

Frequency of ponding: None

Calcium carbonate, maximum content: 80 percent

Maximum salinity: Nonsaline to slightly saline (0.0 to 5.0 mmhos/cm)

Sodium adsorption ratio, maximum: 5.0

Available water supply, 0 to 60 inches: Low (about 4.0 inches)

Interpretive groups

Land capability classification (irrigated): 3e

Land capability classification (nonirrigated): 3e

Hydrologic Soil Group: C

Ecological site: R077CY036TX - Sandy Loam 16-21" PZ

Custom Soil Resource Report

Hydric soil rating: No

Minor Components

Sharvana

Percent of map unit: 7 percent

Landform: Plains

Down-slope shape: Linear

Across-slope shape: Convex

Ecological site: R077CY037TX - Very Shallow 16-21" PZ

Hydric soil rating: No

Amarillo

Percent of map unit: 6 percent

Landform: Plains, playa slopes

Down-slope shape: Convex, concave

Across-slope shape: Linear

Ecological site: R077CY036TX - Sandy Loam 16-21" PZ

Hydric soil rating: No

Posey

Percent of map unit: 2 percent

Landform: Plains, playa slopes

Down-slope shape: Convex, concave

Across-slope shape: Linear

Ecological site: R077CY028TX - Limy Upland 16-21" PZ

Hydric soil rating: No

Kb—Kimbrough loam, 0 to 3 percent slopes

Map Unit Setting

National map unit symbol: 2qmyr

Elevation: 2,500 to 4,800 feet

Mean annual precipitation: 14 to 16 inches

Mean annual air temperature: 57 to 63 degrees F

Frost-free period: 180 to 220 days

Farmland classification: Not prime farmland

Map Unit Composition

Kimbrough and similar soils: 85 percent

Minor components: 15 percent

Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Kimbrough

Setting

Landform: Plains

Down-slope shape: Linear

Across-slope shape: Linear

Parent material: Loamy eolian deposits derived from sedimentary rock

Custom Soil Resource Report

Typical profile

A - 0 to 3 inches: loam
Bw - 3 to 10 inches: loam
Bkkm1 - 10 to 16 inches: cemented material
Bkkm2 - 16 to 80 inches: cemented material

Properties and qualities

Slope: 0 to 3 percent
Depth to restrictive feature: 4 to 18 inches to petrocalcic
Drainage class: Well drained
Runoff class: Very high
Capacity of the most limiting layer to transmit water (Ksat): Very low to moderately low (0.00 to 0.01 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 95 percent
Maximum salinity: Nonsaline (0.0 to 1.0 mmhos/cm)
Sodium adsorption ratio, maximum: 1.0
Available water supply, 0 to 60 inches: Very low (about 1.4 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 7s
Hydrologic Soil Group: D
Ecological site: R077DY049TX - Very Shallow 12-17" PZ
Hydric soil rating: No

Minor Components

Eunice

Percent of map unit: 6 percent
Landform: Plains
Down-slope shape: Linear
Across-slope shape: Convex
Ecological site: R077DY049TX - Very Shallow 12-17" PZ
Hydric soil rating: No

Spraberry

Percent of map unit: 5 percent
Landform: Plains, playa rims
Down-slope shape: Linear, convex
Across-slope shape: Linear
Ecological site: R077DY049TX - Very Shallow 12-17" PZ
Hydric soil rating: No

Kenhill

Percent of map unit: 4 percent
Landform: Plains
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: R077DY038TX - Clay Loam 12-17" PZ
Hydric soil rating: No

Lp—Lipan clay, 0 to 1 percent slopes, frequently ponded

Map Unit Setting

National map unit symbol: 2tw2k
Elevation: 2,650 to 3,150 feet
Mean annual precipitation: 12 to 17 inches
Mean annual air temperature: 59 to 65 degrees F
Frost-free period: 205 to 240 days
Farmland classification: Not prime farmland

Map Unit Composition

Lipan, frequently ponded, and similar soils: 70 percent
Minor components: 30 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Lipan, Frequently Ponded

Setting

Landform: Playa floors
Microfeatures of landform position: Circular gilgai
Down-slope shape: Concave
Across-slope shape: Concave
Parent material: Clayey lacustrine deposits of quaternary age

Typical profile

Ap - 0 to 6 inches: clay
Bw - 6 to 30 inches: clay
Bss - 30 to 50 inches: clay
BcK - 50 to 80 inches: clay

Properties and qualities

Slope: 0 to 1 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Poorly drained
Runoff class: Negligible
Capacity of the most limiting layer to transmit water (Ksat): Very low to moderately low (0.00 to 0.06 in/hr)
Depth to water table: About 0 to 6 inches
Frequency of flooding: None
Frequency of ponding: Frequent
Calcium carbonate, maximum content: 10 percent
Maximum salinity: Nonsaline (0.0 to 0.5 mmhos/cm)
Available water supply, 0 to 60 inches: High (about 9.3 inches)

Interpretive groups

Land capability classification (irrigated): None specified
Land capability classification (nonirrigated): 6w
Hydrologic Soil Group: D
Ecological site: R077DY041TX - Lakebed 12-17" PZ
Hydric soil rating: Yes

Minor Components

Sparenberg, occasionally ponded

Percent of map unit: 10 percent
Landform: Playa floors
Microfeatures of landform position: Circular gilgai
Down-slope shape: Concave
Across-slope shape: Concave
Ecological site: R077CY027TX - Playa 16-21" PZ
Hydric soil rating: No

Chapel, occasionally ponded

Percent of map unit: 10 percent
Landform: Playa floors
Microfeatures of landform position: Circular gilgai
Down-slope shape: Concave
Across-slope shape: Concave
Ecological site: R077CY027TX - Playa 16-21" PZ
Hydric soil rating: No

Portales

Percent of map unit: 10 percent
Landform: Plains, interdunes, playa steps
Landform position (two-dimensional): Shoulder
Down-slope shape: Concave, linear, convex
Across-slope shape: Linear
Ecological site: R077CY028TX - Limy Upland 16-21" PZ
Hydric soil rating: No

MmB—Amarose loamy fine sand, 0 to 3 percent slopes

Map Unit Setting

National map unit symbol: 1idyj
Elevation: 2,500 to 4,600 feet
Mean annual precipitation: 14 to 16 inches
Mean annual air temperature: 57 to 63 degrees F
Frost-free period: 180 to 220 days
Farmland classification: Not prime farmland

Map Unit Composition

Amarose and similar soils: 85 percent
Minor components: 15 percent
Estimates are based on observations, descriptions, and transects of the mapunit.

Description of Amarose

Setting

Landform: Plains
Down-slope shape: Linear
Across-slope shape: Linear

Custom Soil Resource Report

Parent material: Loamy eolian deposits

Typical profile

A - 0 to 10 inches: loamy fine sand
Bt1 - 10 to 34 inches: sandy clay loam
Bt2 - 34 to 42 inches: fine sandy loam
Btk - 42 to 80 inches: loam

Properties and qualities

Slope: 0 to 3 percent
Depth to restrictive feature: More than 80 inches
Drainage class: Well drained
Runoff class: Low
Capacity of the most limiting layer to transmit water (Ksat): Moderately high to high
(0.57 to 2.00 in/hr)
Depth to water table: More than 80 inches
Frequency of flooding: None
Frequency of ponding: None
Calcium carbonate, maximum content: 55 percent
Maximum salinity: Nonsaline (0.0 to 1.0 mmhos/cm)
Sodium adsorption ratio, maximum: 2.0
Available water supply, 0 to 60 inches: Moderate (about 8.2 inches)

Interpretive groups

Land capability classification (irrigated): 3e
Land capability classification (nonirrigated): 6e
Hydrologic Soil Group: B
Ecological site: R077DY046TX - Sandy 12-17" PZ
Hydric soil rating: No

Minor Components

Elida

Percent of map unit: 8 percent
Landform: Plains, playa slopes
Landform position (two-dimensional): Backslope
Down-slope shape: Linear
Across-slope shape: Linear, concave
Ecological site: R077DY046TX - Sandy 12-17" PZ
Hydric soil rating: No

Douro

Percent of map unit: 4 percent
Landform: Plains
Down-slope shape: Linear
Across-slope shape: Linear
Ecological site: R077DY046TX - Sandy 12-17" PZ
Hydric soil rating: No

Triomas

Percent of map unit: 3 percent
Landform: Plains
Down-slope shape: Convex
Across-slope shape: Linear
Ecological site: R077DY046TX - Sandy 12-17" PZ
Hydric soil rating: No

Custom Soil Resource Report

References

- American Association of State Highway and Transportation Officials (AASHTO). 2004. Standard specifications for transportation materials and methods of sampling and testing. 24th edition.
- American Society for Testing and Materials (ASTM). 2005. Standard classification of soils for engineering purposes. ASTM Standard D2487-00.
- Cowardin, L.M., V. Carter, F.C. Golet, and E.T. LaRoe. 1979. Classification of wetlands and deep-water habitats of the United States. U.S. Fish and Wildlife Service FWS/OBS-79/31.
- Federal Register. July 13, 1994. Changes in hydric soils of the United States.
- Federal Register. September 18, 2002. Hydric soils of the United States.
- Hurt, G.W., and L.M. Vasilas, editors. Version 6.0, 2006. Field indicators of hydric soils in the United States.
- National Research Council. 1995. Wetlands: Characteristics and boundaries.
- Soil Survey Division Staff. 1993. Soil survey manual. Soil Conservation Service. U.S. Department of Agriculture Handbook 18. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_054262
- Soil Survey Staff. 1999. Soil taxonomy: A basic system of soil classification for making and interpreting soil surveys. 2nd edition. Natural Resources Conservation Service, U.S. Department of Agriculture Handbook 436. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053577
- Soil Survey Staff. 2010. Keys to soil taxonomy. 11th edition. U.S. Department of Agriculture, Natural Resources Conservation Service. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053580
- Tiner, R.W., Jr. 1985. Wetlands of Delaware. U.S. Fish and Wildlife Service and Delaware Department of Natural Resources and Environmental Control, Wetlands Section.
- United States Army Corps of Engineers, Environmental Laboratory. 1987. Corps of Engineers wetlands delineation manual. Waterways Experiment Station Technical Report Y-87-1.
- United States Department of Agriculture, Natural Resources Conservation Service. National forestry manual. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/home/?cid=nrcs142p2_053374
- United States Department of Agriculture, Natural Resources Conservation Service. National range and pasture handbook. <http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/landuse/rangepasture/?cid=stelprdb1043084>

Custom Soil Resource Report

United States Department of Agriculture, Natural Resources Conservation Service. National soil survey handbook, title 430-VI. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/soils/scientists/?cid=nrcs142p2_054242

United States Department of Agriculture, Natural Resources Conservation Service. 2006. Land resource regions and major land resource areas of the United States, the Caribbean, and the Pacific Basin. U.S. Department of Agriculture Handbook 296. http://www.nrcs.usda.gov/wps/portal/nrcs/detail/national/soils/?cid=nrcs142p2_053624

United States Department of Agriculture, Soil Conservation Service. 1961. Land capability classification. U.S. Department of Agriculture Handbook 210. http://www.nrcs.usda.gov/Internet/FSE_DOCUMENTS/nrcs142p2_052290.pdf

5.0 BID QUANTITIES



CONSTRUCTION OF WEST COUNTY ROAD 130 EXTENTION



| ITEM | TXDOT ITEM | ITEM DESCRIPTION | QTY | UNIT | UNIT PRICE | TOTAL |
|----------------------------------|------------|--|--------|------|------------|-------|
| 1 | 100 | Preparation of R.O.W. | 116 | Sta | | |
| 2 | 735 | Debris Removal | 1 | L.S. | | |
| 3 | 110 | Earthwork Cut (Complete and In-Place) | 22,940 | C.Y. | | |
| 4 | 132 | Earthwork Fill (Complete and In-Place, 20% Fill Factor Included) | 22,130 | C.Y. | | |
| 5 | N/A | Topsoil (6" Average) Haul Off (Complete and In-Place) | 8,560 | C.Y. | | |
| 6 | SPECIAL | 6" Subgrade Preparation (Complete and In-Place) | 45,470 | S.Y. | | |
| 7 | 247 | Flexible Base (Complete and In-Place) (Includes Roadway and Driveways) | 14,510 | C.Y. | | |
| 8 | 310 | Prime Coat (Complete and In-Place) | 12,270 | Gal | | |
| 9 | 340 | 3" Type C HMA Pavement (Complete and In-Place) (Includes Roadway and Driveway) | 7,060 | Ton | | |
| 10 | 360 | 7" Concrete Pavement (Complete and In-Place) (Includes Aprons and Pipeline Cap) | 1,860 | S.Y. | | |
| 11 | 466 | Headwall-FW, 3X 24" Dia Pipe Culvert (Complete and In-Place) | 4 | Ea | | |
| 12 | 466 | Headwall-FW, 2X 18" Dia Pipe Culvert (Complete and In-Place) | 2 | Ea | | |
| 13 | 466 | Wingwall-FW-0, HW=4' (Complete and In-Place) | 6 | Ea | | |
| 14 | SPECIAL | 24" HP Storm Pipe Culverts (Complete and In-Place) | 230 | L.F. | | |
| 15 | SPECIAL | 18" HP Storm Pipe Culverts (Complete and In-Place) | 364 | L.F. | | |
| 16 | SPECIAL | Flared End Sections for HP Storm Pipe Culverts (Complete and In-Place) | 8 | Ea | | |
| 17 | 432 | 12" Riprap (Stone Protection) (Complete and In-Place) | 50 | C.Y. | | |
| 18 | N/A | Removal of Existing Fence and 2 Existing Gates | 1 | L.S. | | |
| 19 | 552 | 5 Strand Barbed Wire Fence (Steel Post) (Complete and In-Place) | 6,523 | L.F. | | |
| 20 | 552 | Gate Type 1 (Complete and In-Place) | 2 | Ea | | |
| 21 | 649 | Removal of Small Roadside Sign Assemblies(SCR1230) (Complete and In-Place) | 1 | Ea | | |
| 22 | 666 | Retroreflectorized Marking (Type 1) 4" Double Yellow Striped (Complete and In-Place) | 2,220 | L.F. | | |
| 23 | 666 | Retroreflectorized Marking (Type 1) 4" Broken Yellow Striped (Complete and In-Place) | 10,360 | L.F. | | |
| 24 | 666 | Retroreflectorized Marking (Type 1) 4" White Striped (Complete and In-Place) | 23,260 | L.F. | | |
| 25 | 666 | 18" Stop Bar Pavement Marking (Complete and In-Place) | 93 | L.F. | | |
| 26 | 644 | Small Roadside Sign Assemblies (Complete and In-Place) | 14 | Ea | | |
| 27 | 636 | Aluminun Sign Type A (Complete and In-Place) | 74 | S.F. | | |
| 28 | SPECIAL | Solar Powered LED Stop Sign (Complete and In-Place) | 2 | Ea | | |
| 29 | 658 | Object Marker Assemblies (Type OM-2) (Complete and In-Place) | 6 | Ea | | |
| 30 | 164 | Seeding for Pernament Erosion Control (Complete and In-Place) | 2,370 | S.Y. | | |
| 31 | 506 | Erosion Control | 1 | L.S. | | |
| 32 | 502 | Traffic Control | 1 | L.S. | | |
| 33 | 500 | Mobilization | 1 | L.S. | | |
| TOTAL BID | | | | | | |
| CONSTRUCTION START DATE | | | | | | |
| TOTAL CONSTRUCTION CALENDAR DAYS | | | | | | |